GENERAL NOTES: 1. PARCEL OF LAND TO BE DEVELOPED IS LOCATED IN THE TOWN OF CHESTER, SECTION 6 BLOCK 1 LOT 69.4. 2. TOTAL AREA OF PARCEL: 2.77± ACRES. 3. PARCEL IS LOCATED IN THE IP INDUSTRIAL PARK ZONING DISTRICT. 4. PROPOSED USE IS LIGHT INDUSTRIAL USES, INCLUDING MANUFACTURING, ASSEMBLY, CONVERTING, ALTERING, FINISHING, CLEANING OR ANY OTHER PROCESSING OF MATERIALS INVOLVING THE USE OF ONLY OIL, GAS, ELECTRICITY OR THE EQUIVALENT. 5. TOTAL BUILDING SQUARE FOOTAGE IS 30,500 sq.ft. 6. TOTAL NUMBER OF PARKING SPACES IS 27 PARKING SPACES. 7. TOTAL NUMBER OF LOADING DOCKS IS 2. 8. FACILITY TO BE SERVED BY INDIVIDUAL SEPTIC SYSTEM AND WELL. 9. ENTIRE PARCEL IS WITHIN THE CHESTER UNION FREE SCHOOL DISTRICT. 10. ENTIRE PARCEL IS WITHIN THE CHESTER FIRE DISTRICT. 11. THERE ARE NO N.Y.S.D.E.C. WETLANDS OR FEDERAL WETLANDS ONSITE. 12. BUILDING DIMENSIONS AND AREAS ARE APPROXIMATE. FINAL DIMENSIONS AND AREAS WILL BE DEVELOPED AS PART OF THE FINAL BUILDING PLANS. 13. MAXIMUM NUMBER OF EMPLOYEES PER MAX SHIFT IS 24. 14. MAP REFERENCE: "SURVEY & TOPOGRAPHY OF PROPERTY FOR 1657 MANAGEMENT, LLC DATED JULY 27, 2018 AND PREPARED BY JAMES A. 15. CONSTRUCTION OF ANY RETAINING WALL WITH HEIGHT GREATER THAN 4 FEET SHALL REQUIRE A BUILDING PERMIT. 16. PRIOR TO THE START OF CONSTRUCTION, NO SOIL IS TO BE EXCAVATED

AND MOVED OFF-SITE WITHOUT FIRST NOTIFYING THE TOWN OF CHESTER

1. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO CONTACT ALL UTILITY COMPANIES

2. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO FIELD LOCATE AND VERIFY ALL

FOR UTILITY MARK OUTS. CONTRACTOR IS TO ASSUME FULL RESPONSIBILITY FOR

MAINTAINING CONTINUOUS UTILITY SERVICE AND REPAIRS TO UTILITIES IN THE EVENT

EXISTING UTILITIES LOCATIONS, ELEVATIONS, INVERTS, ETC. AND NOTIFY THE DESIGN

3. CONTRACTOR IS TO COORDINATE NEW UTILITY SERVICES WITH ALL UTILITY COMPANIES.

PLANNING BOARD OF WHERE THE MATERIAL IS GOING.


4. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL TRAFFIC MAINTENANCE.
5. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL PROJECT SAFETY REQUIREMENTS.

Р	ROPOSED HOU	RS OF OPERATION
	DAY OF WEEK	HOURS OF OPERATION (2 SHIFTS MAX.)
	MONDAY-FRIDAY	6 A.M10 P.M.
	SATURDAY	9 A.M5 P.M.
	SUNDAY	10 A.M5 P.M.


HIGHWAY DEPARTMENT NOTES:


ENGINEER OF ANY DISCREPANCIES ON THIS PLAN.

- A \$20,000 CASH DRIVEWAY OPENING BOND SHALL BE SECURED IN A FORM ACCEPTABLE BY THE TOWN OF CHESTER FOR BOTH ENTRANCES.
- 2. A \$50,000 BOND SHALL BE SECURED IN A FORM ACCEPTABLE BY THE TOWN OF CHESTER FOR PROTECTION OF EXISTING TOWN ROAD, ELKAY DRIVE

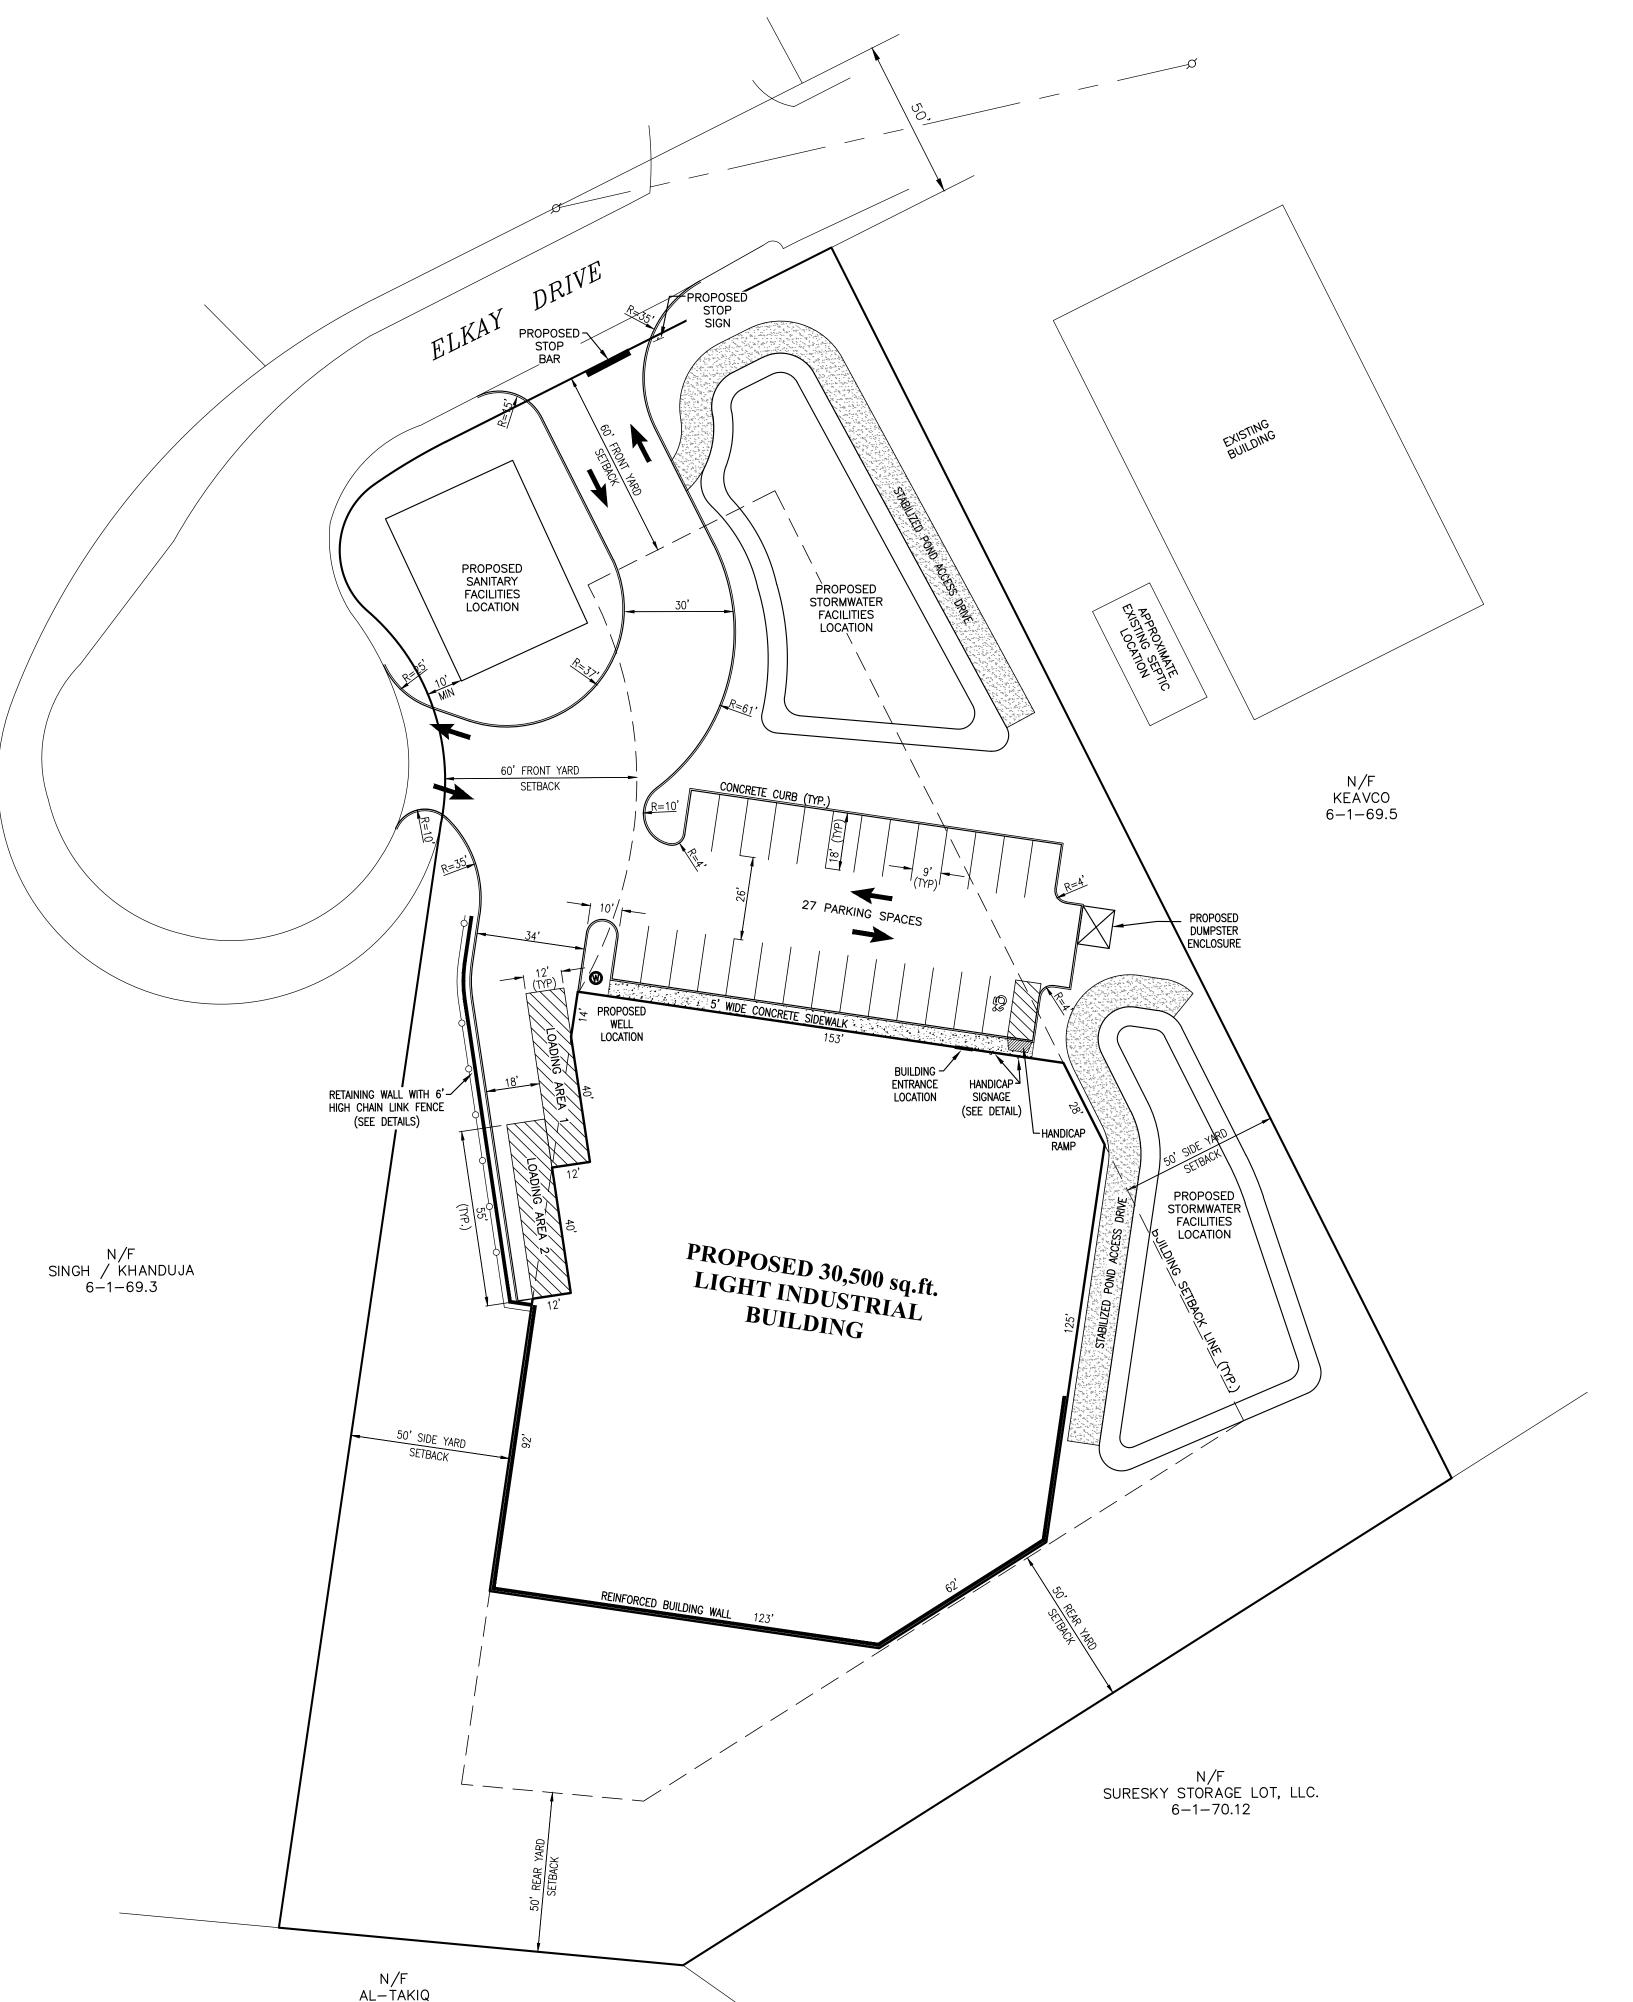

6-1-72

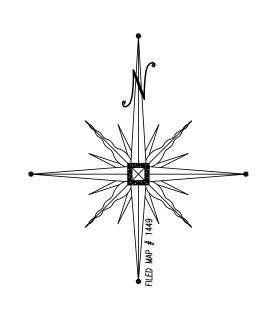

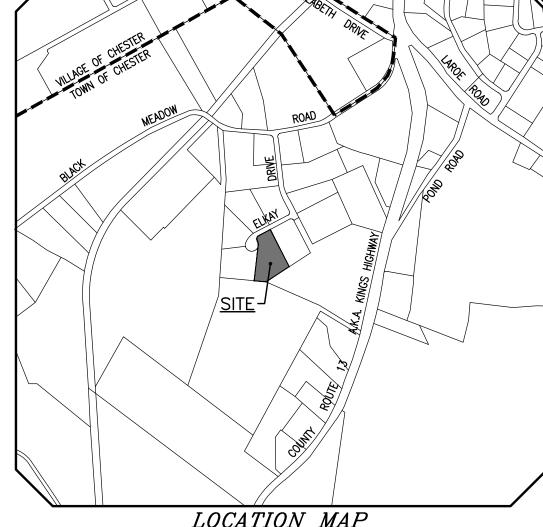

LOCATION MAP

SCALE: 1"=1,000'

BULK REQUIREMENTS

ZONE IP (INDUSTRIAL PARK DISTRICT)

USE GROUP (12) LIGHT INDUSTRIAL USES

RECORD OWNER

1657 MANAGEMENT LLC

P.O. BOX 96

MONROE, NEW YORK 10949

RECORD APPLICANT
1657 MANAGEMENT LLC
P.O. BOX 96
MONROE, NEW YORK 10949

PLAN INDEX

 \underline{TITLE}

COVER SHEET/SITE PLAN EXISTING CONDITIONS PLAN

GRADING PLAN

UTILITY PLAN

EROSION CONTROL PLAN

EROSION CONTROL DETAILS

LIGHTING PLAN

LANDSCAPING PLAN

SITE DETAILS 1

SITE DETAILS 2

SHEET NO.

MIN. REQUIRED PROVIDED LOT AREA (AC.) 2 2.77 LOT WIDTH (FT.) 200 266 FRONT YARD (FT) 60 60 SIDE YARD (FT.) 50 50 TOTAL SIDE YARD (FT.) 100 100 REAR YARD (FT.) 50 50

MAX. PERMITTED

BLDG. HEIGHT (FT).	<i>65</i>	<68
BUILDING COVERAGE (%)	40	<i>25</i> .

11 SANITARY & WATER SUPPLY DETAILS

PARKING CALCULATIONS

INDUSTRIAL/MANUFACTURING USE

2 SPACES PER 3 EMPLOYEES ON THE 2 LARGEST CONSECUTIVE SHIFTS


ASSUME 24 EMPLOYEES PER MAX SHIFT:

2 SPACES/3 EMPL. x 24 EMPLOYEES = 16.0 SPACES

MIN. NUMBER OF SPACES REQUIRED = 16 SPACES

TOTAL NUMBER OF SPACES PROVIDED = 27 SPACES

GRAPHIC SCALE



MAP CHEC	K DATE:	INITIALED BY:			
	REVISI	ONS			
DATE	DATE DESCRIPTION				
11-6-19	SITE PLAN PREPARATION DATE				
01-21-20	SWPPP PREP & FUSCO COMMENTS DATED 12-3-19				
03-17-20	AS PER FUSCO COMMENTS DATED 1-27-20				
05-07-20	AS PER FUSCO COMMENTS	DATED 5-01-20	CJ		

PIETRZAK & PFAU
ENGINEERING & SURVEYING, PLLC
262 GREENWICH AVENUE, SUITE A
GOSHEN, NEW YORK 10924
(845) 294-0606

2 HAMILTON AVENUE
MONTICELLO, NEW YORK 12701
(845) 796-4646

GNATURE

ELKAY DRIVE COMMERCIAL
BUILDING SITE PLAN

TOWN OF CHESTER
COUNTY OF ORANGE, NEW YORK

COVER SHEET/ SITE PLAN

SITE PLAN
SECTION 6 BLOCK 1 LOT 69.4

RAWING TITLE

UNAUTHORIZED ALTERATION OR ADDITION TO A PLAN BEARING A LICENSED LAND SURVEYOR'S OR PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW.

O.C.H.D. SHEET NO.

N/A OF

CAD REFERENCE
1"=30'

DRAWING NUMBER
1 OF
11


PROJECT NUMBER
19139 ENG BASE
19139.01





BEFORE YOU DIG, DRILL OR BLAST!

-CALL TOLL FREE 1-800-962-7962

-NY INDUSTRIAL CODE RULE 753 REQUIRES NO LESS THAN TWO WORKING DAYS NOTICE, BUT NOT MORE THAN TEN DAYS NOTICE.

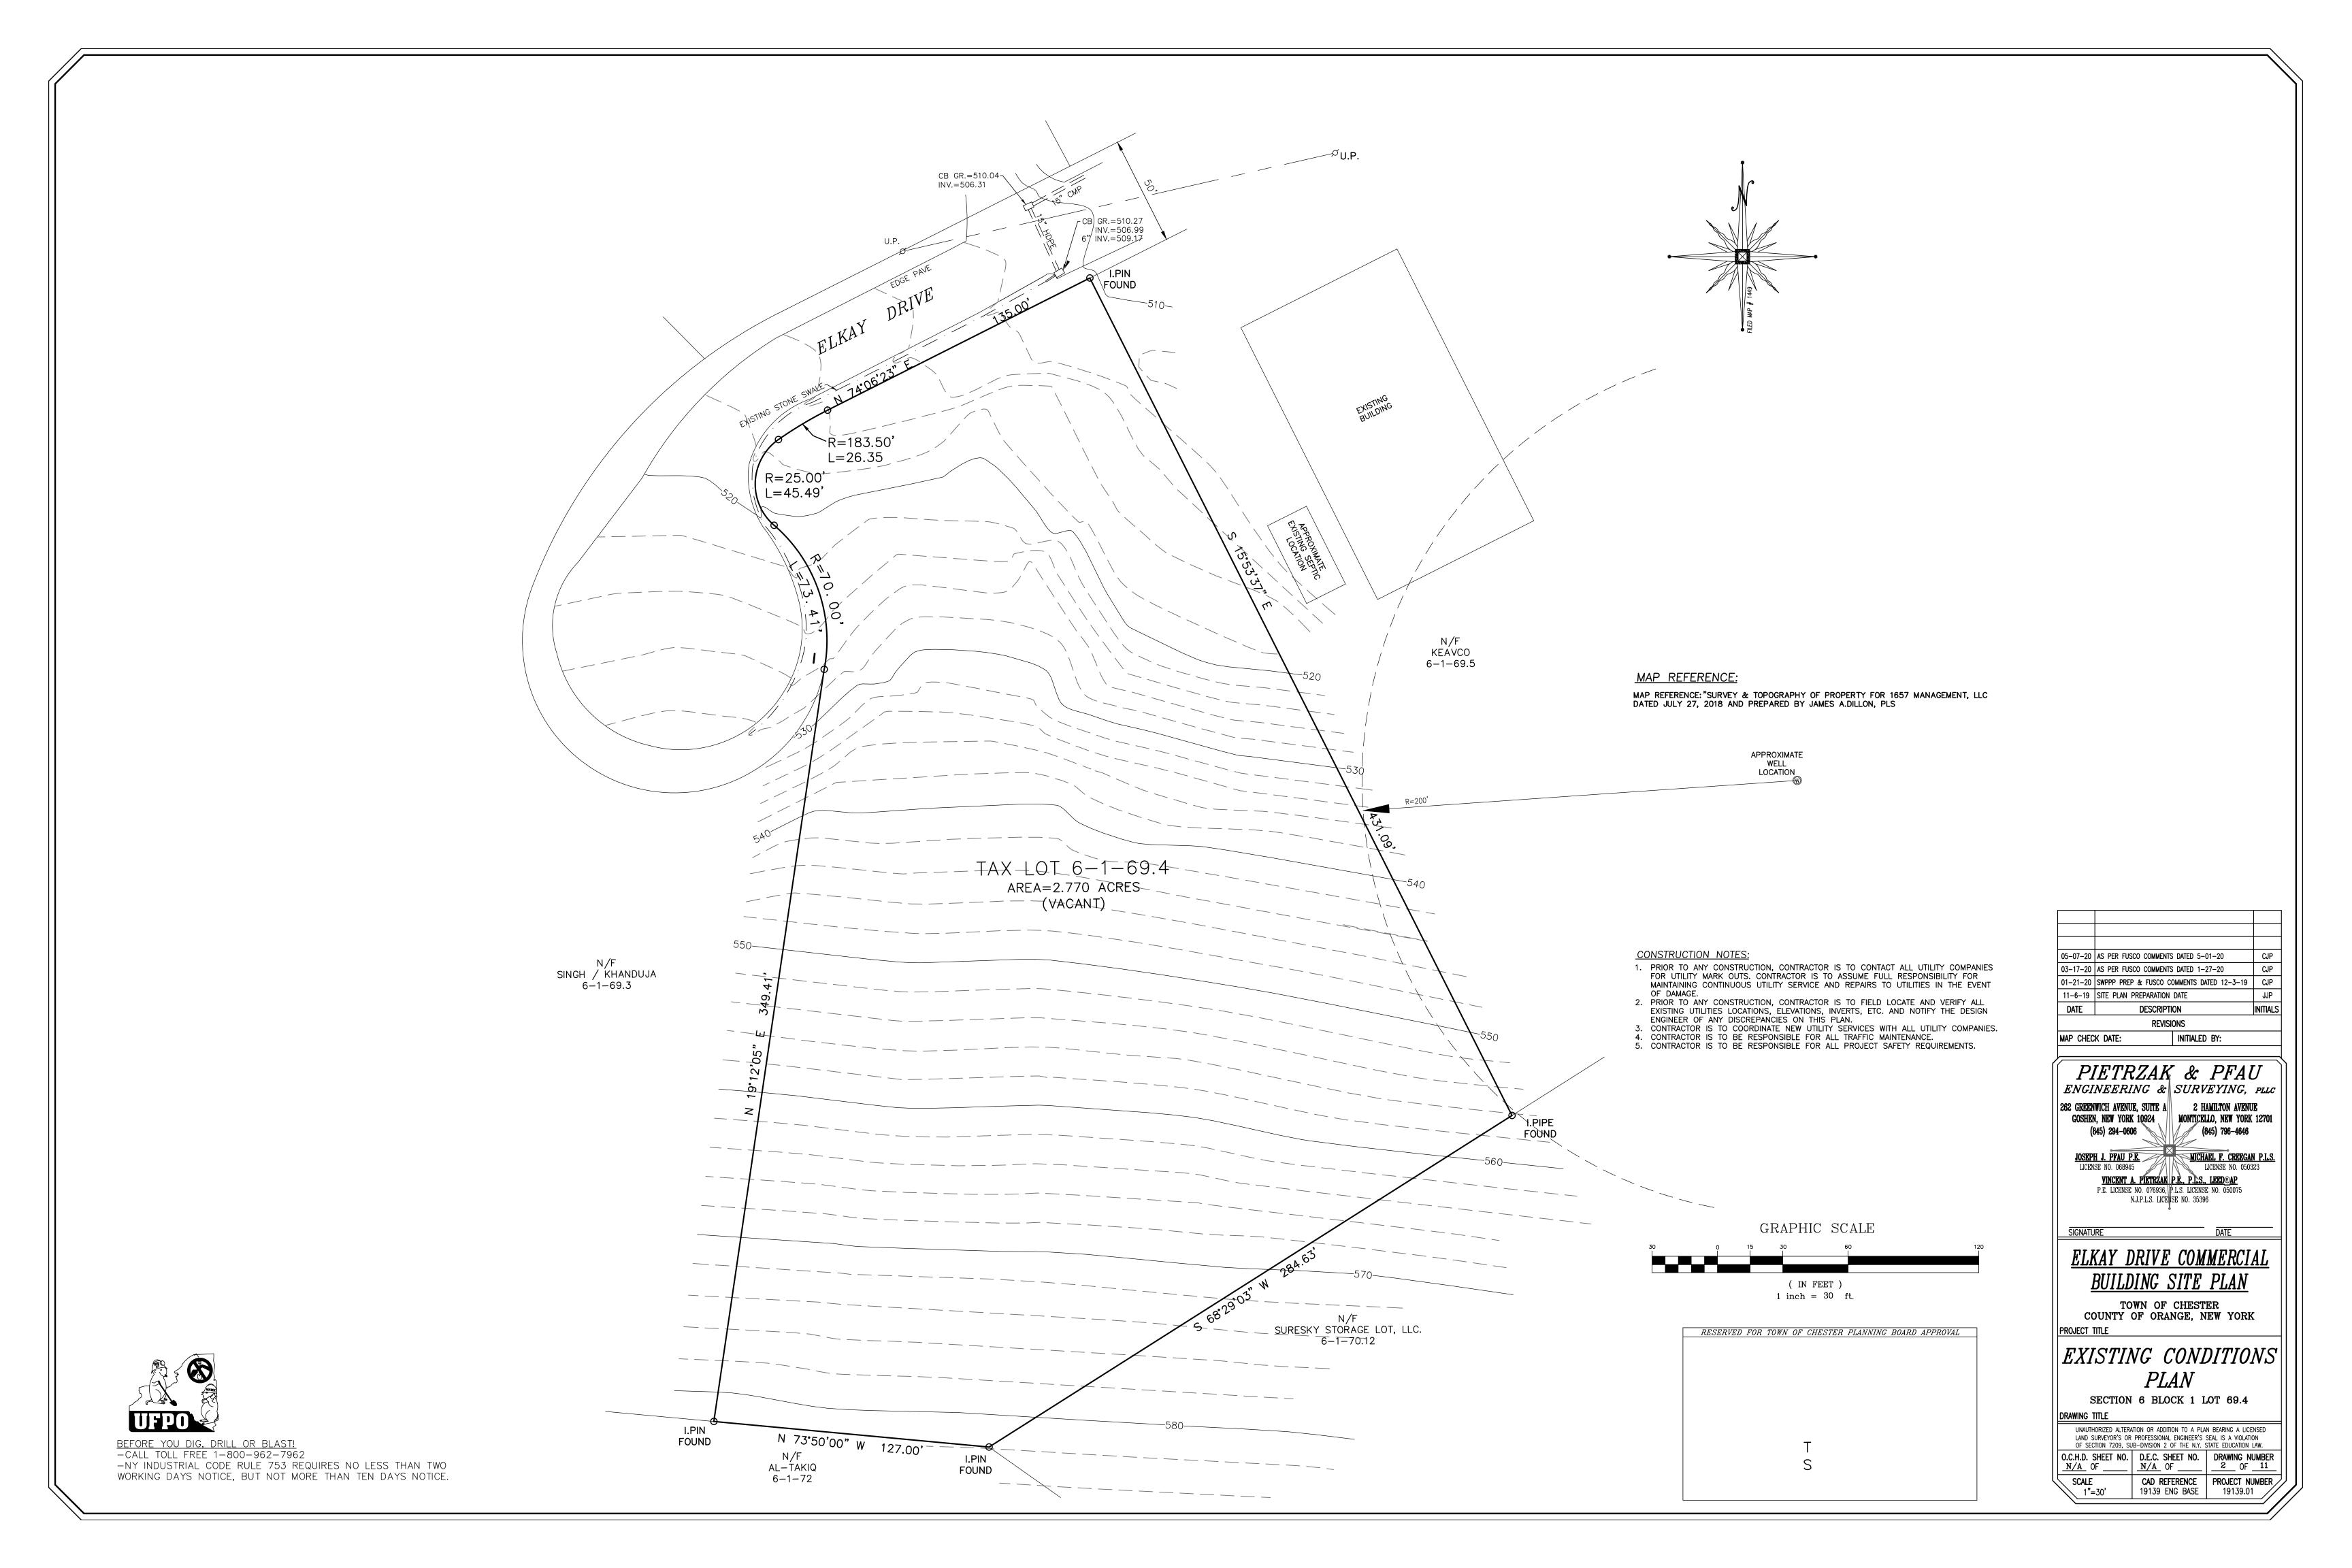

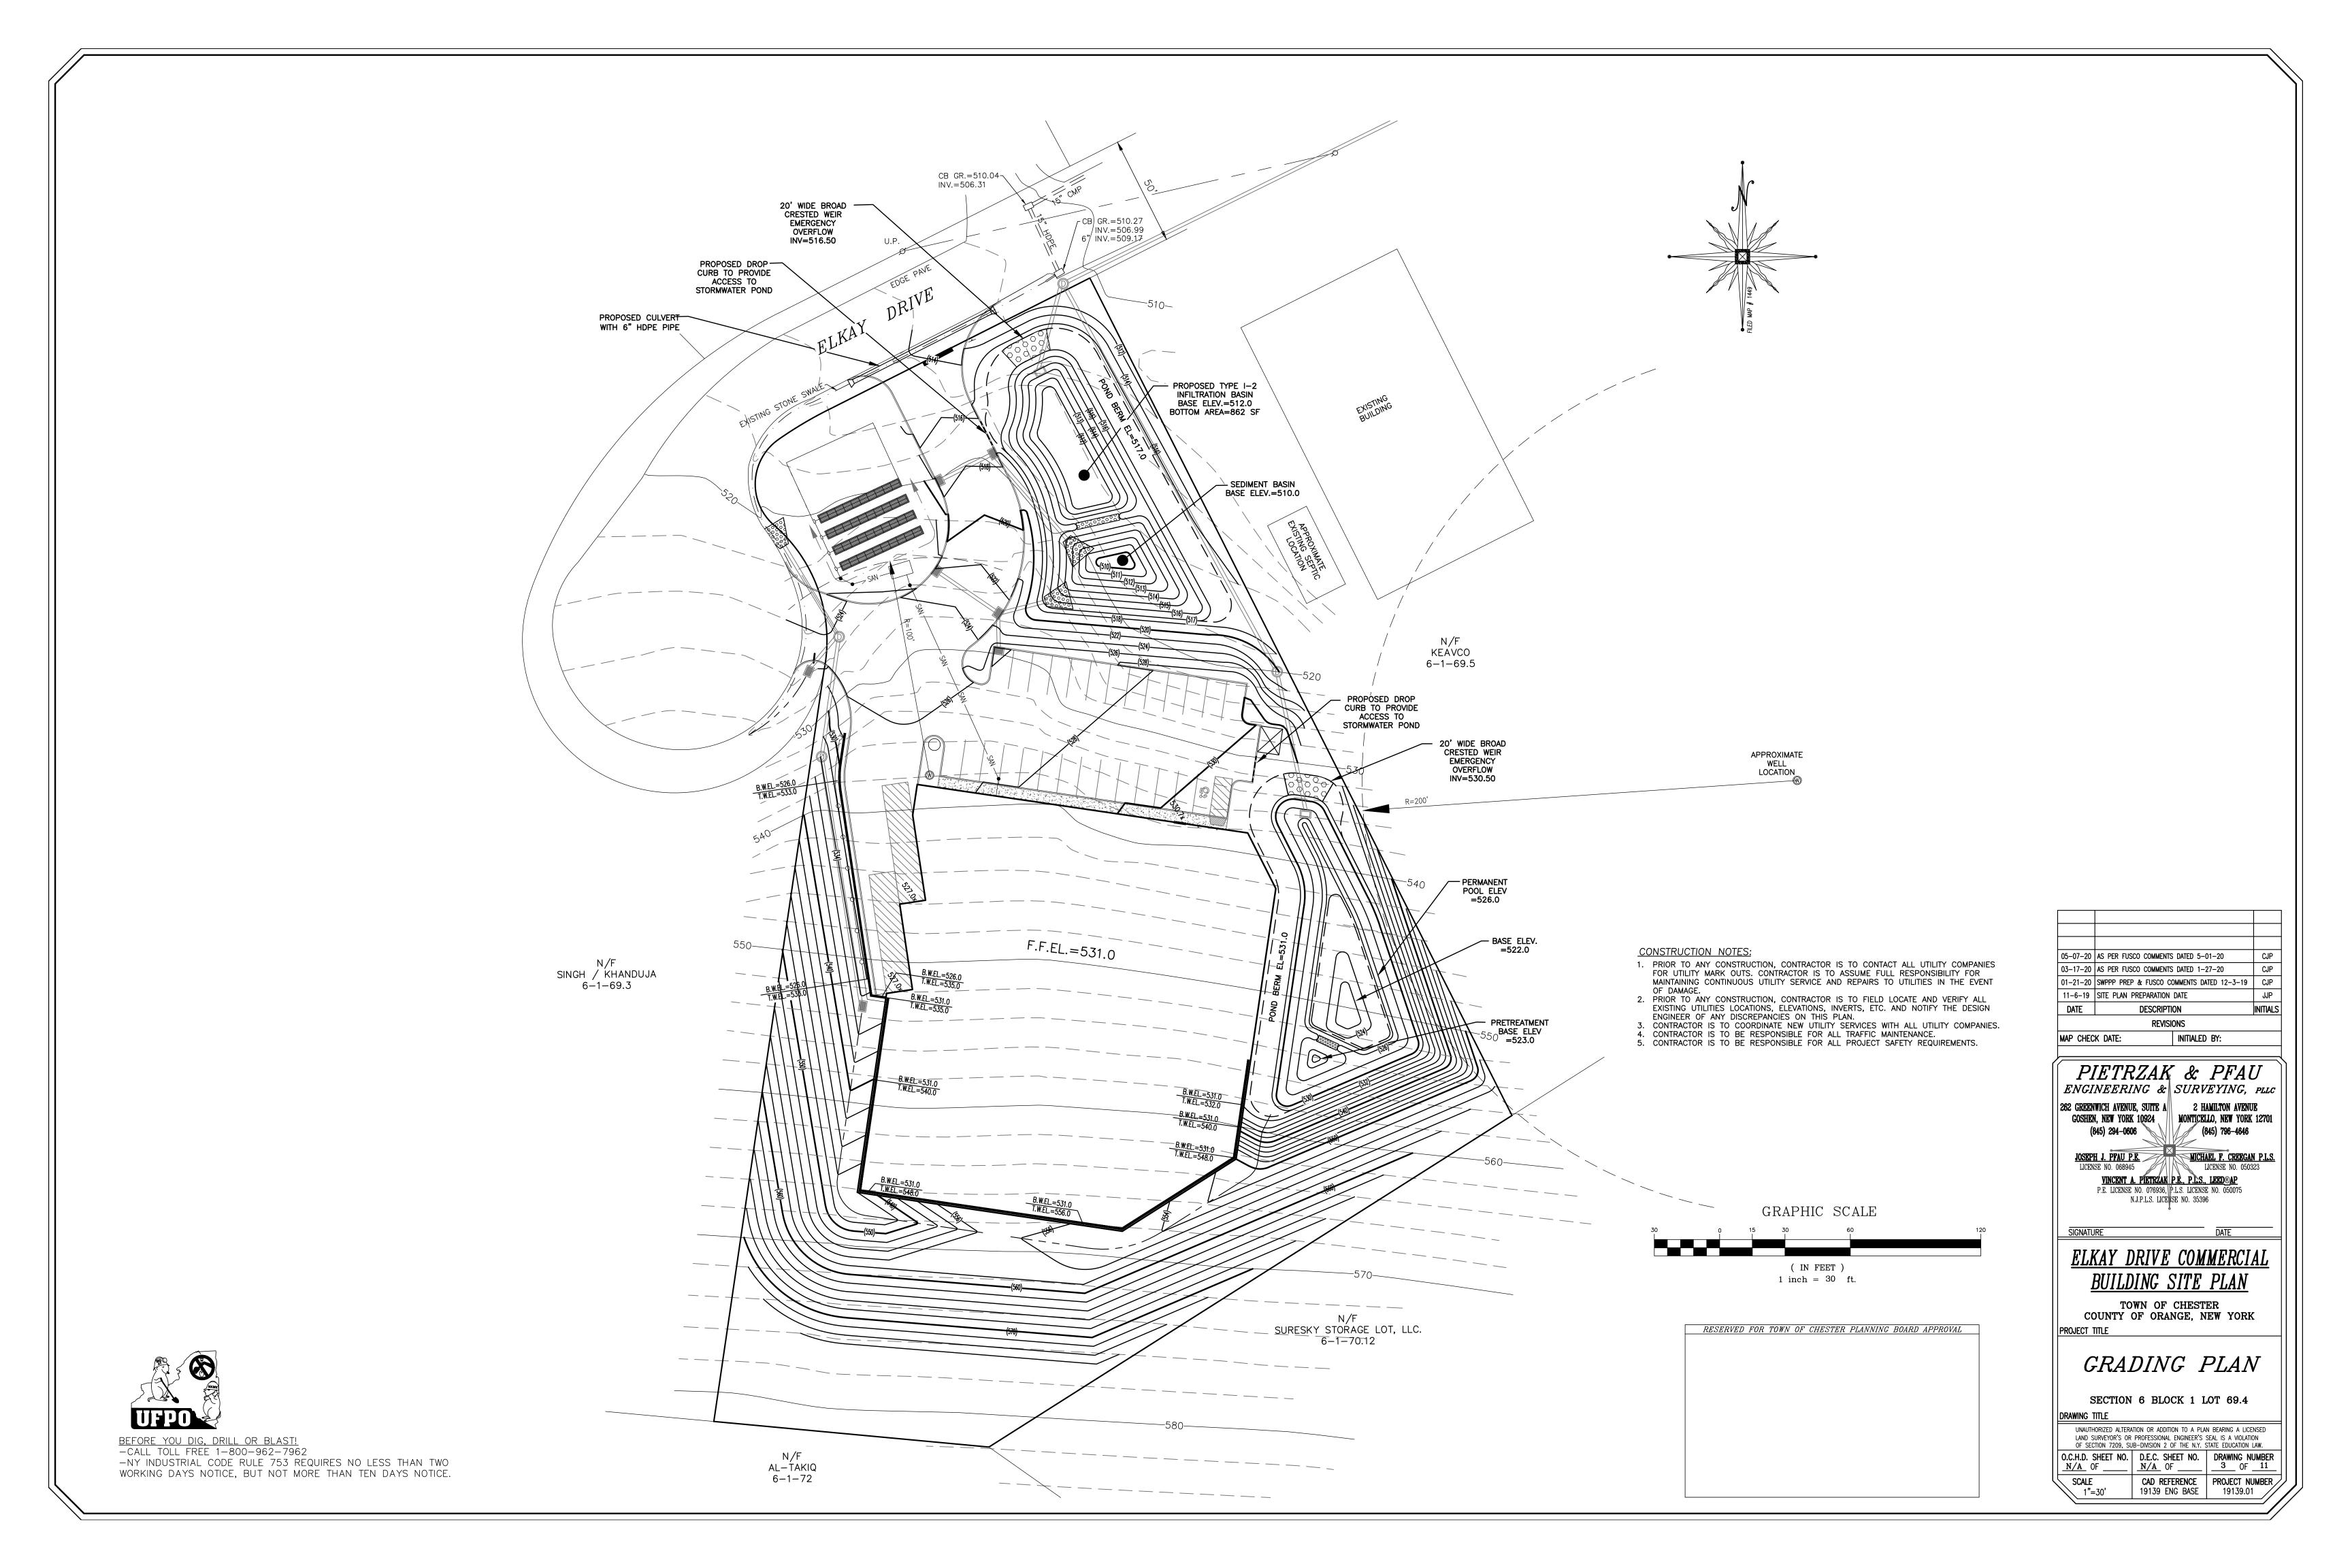

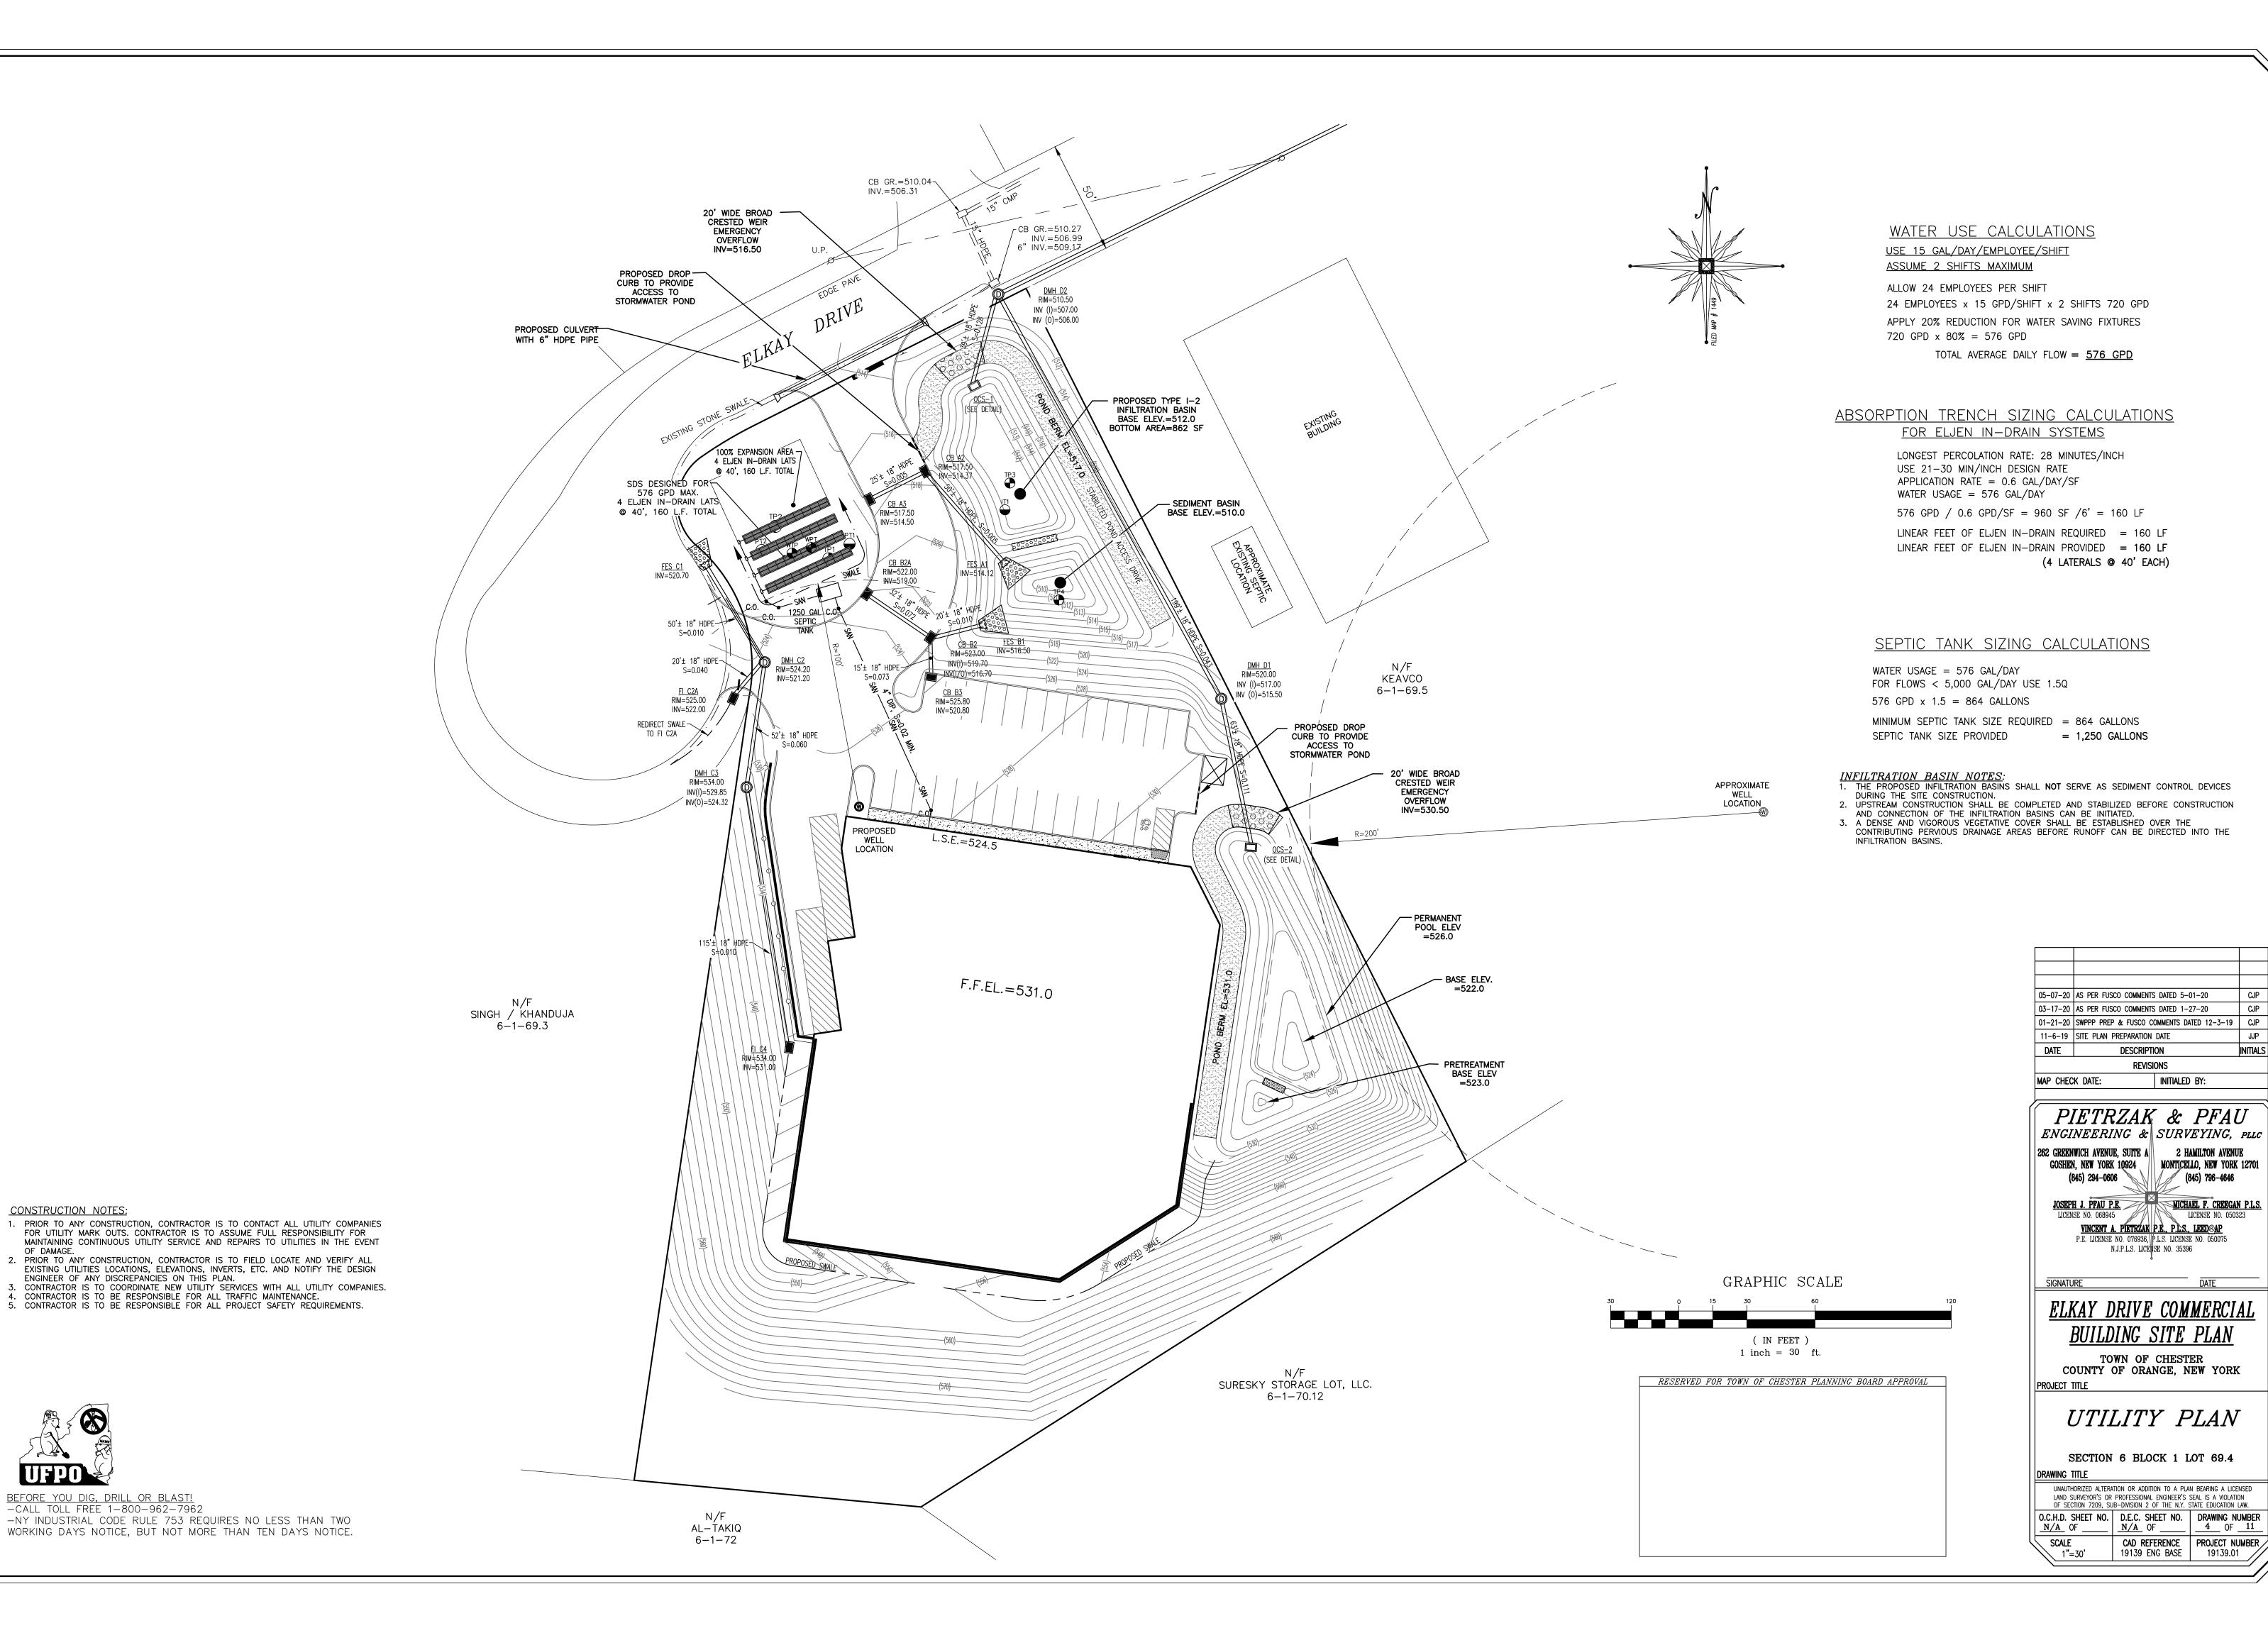

CONSTRUCTION NOTES:

ENGINEER OF ANY DISCREPANCIES ON THIS PLAN.

BEFORE YOU DIG, DRILL OR BLAST! -CALL TOLL FREE 1-800-962-7962 JJP

INITIALS

EROSION CONTROL & CONSTRUCTION SEQUENCE:

MEASURES SHALL BE TAKEN TO PREVENT SOIL EROSION DURING PROJECT CONSTRUCTION. ALL FRESHLY DISTURBED AREAS THAT WILL REMAIN DISTURBED FOR MORE THAN A PERIOD OF FOURTEEN (14) DAYS SHALL BE STABILIZED BY TEMPORARY SEEDING AS INDICATED ON THE TEMPORARY SEEDING SCHEDULE. DISTURBED AREAS SHALL BE MINIMAL IN SIZE AND SHALL NOT EXCEED THE APPROVED CLEARING AND GRADING LIMITS. THE FOLLOWING MEASURES SHALL BE IMPLEMENTED AS

- A. A MEETING WITH TOWN REPRESENTATIVES, INCLUDING THE TOWN ENGINEER, AS WELL AS PROJECT AND SITE CONTRACTORS, PROJECT MANAGER, AND FOREMAN IS TO TAKE PLACE A MINIMUM OF ONE WEEK PRIOR TO CONSTRUCTION.
- B. THE OWNER OR OPERATOR MUST MAINTAIN A COPY OF THE NOI, NOI ACKNOWLEDGEMENT LETTER, SWPPP AND INSPECTION REPORTS AT THE CONSTRUCTION SITE. THE DOCUMENTS MUST BE MAINTAINED IN A SECURE LOCATION, SUCH AS A JOB TRAILER, ON-SITE CONSTRUCTION OFFICE, OR MAILBOX WITH LOCK; THAT IS ACCESSIBLE DURING NORMAL WORKING HOURS TO A PERSON PERFORMING A COMPLIANCE INSPECTION.
- PRIOR TO COMMENCING CONSTRUCTION ACTIVITIES, THE LIMITS OF CLEARING AND GRADING SHALL BE MARKED. FILTER FABRIC SEDIMENTATION BARRIERS (SILT FENCE) SHALL BE PLACED ALONG THE DOWNGRADE PERIMETER OF THE SITE AND ANY OTHER AREAS WHERE SILT FENCE IS INDICATED AS TO BE INSTALLED "PRIOR TO CONSTRUCTION" ON THE APPROVED PLANS. INSTALLATION IS TO BEGIN AT THE DOWNSTREAM PORTIONS OF THE SITE THEN WORKING UPSTREAM.
- STABILIZED CONSTRUCTION ENTRANCES SHALL BE BUILT IN THE AREAS SHOWN ON THE APPROVED PLANS AND ANYWHERE A CONSTRUCTION ACCESS ROAD INTERSECTS A PUBLIC THOROUGHFARE. STABILIZED ENTRANCES SHALL BE BUILT IN ACCORDANCE WITH THE STABILIZED CONSTRUCTION ENTRANCE DETAIL.
- UPON COMPLETION OF CLEARING AND GRUBBING ACTIVITIES, TOPSOIL SHALL BE STRIPPED AND STOCKPILED FROM ALL AREAS TO BE DISTURBED. STOCKPILED TOPSOIL SHALL BE STABILIZED BY TEMPORARY SEEDING AND SURROUNDED WITH A PERIMETER SILT FENCE.
- TEMPORARY EROSION CONTROL DEVICES SHALL BE INSTALLED PRIOR TO COMMENCING EARTH MOVING ACTIVITIES. THIS INCLUDES SEDIMENTATION TRAPS OR BASINS, TYPE "B" DIVERSION SWALES (WITH CHECK DAMS IF APPLICABLE), AND SILT FENCE. INSTALLATION SHALL BEGIN AT DOWNSTREAM PORTIONS OF THE SITE THEN WORKING UPSTREAM.
- IMMEDIATELY AFTER COMPLETION OF ROUGH GRADING, REMAINING TEMPORARY EROSION CONTROL SHALL BE INSTALLED AS SPECIFIED ON THE APPROVED PLANS. THIS INCLUDES ANY REMAINING SILT FENCE AND TYPE "A" DIVERSION SWALES (WITH CHECK DAMS IF APPLICABLE). AREAS NOT REQUIRING FURTHER EARTHWORK SHALL BE FINE GRADED, TOPSOILED, AND STABILIZED AS EARLY AS POSSIBLE.
- ANY PROPOSED STORM DRAINAGE SHALL BE INSTALLED AND INCORPORATED INTO THE EROSION CONTROL AS SPECIFIED ON THE APPROVED PLANS. STORM DRAINAGE COMPONENTS SHALL BE PROTECTED FROM SILTATION AS INDICATED.
- UPON COMPLETION OF CONSTRUCTION ACTIVITIES, REMAINING AREAS SHALL BE FINE GRADED, TOPSOILED, AND STABILIZED. PERMANENT VEGETATION AND LANDSCAPING SHALL BE ESTABLISHED.
- TEMPORARY EROSION CONTROL DEVICES SHALL BE REMOVED ONCE UPSTREAM AREAS HAVE BEEN PERMANENTLY STABILIZED. REMOVAL OF TEMPORARY EROSION CONTROL DEVICES SHALL BEGIN WITH THE MOST UPSTREAM PORTIONS OF THE SITE THEN WORKING DOWNSTREAM. THE TEMPORARY SEDIMENTATION BASINS ARE TO BE REMOVED, RE-GRADED, AND STABILIZED LAST. ANY SEDIMENTATION BASINS THAT ARE PLANNED TO BE USED AS A FOREBAY FOR A STORMWATER MANAGEMENT DEVICE SHOULD BE CLEANED AND RESHAPED TO THE PROPOSED DIMENSIONS SHOWN ON THE APPROVED PLAN AT THIS TIME.
- K. ALL NEWLY SEEDED VEGETATIVE COVER SHALL BE MAINTAINED. WASHOUTS OR POORLY GROWING AREAS SHALL BE CORRECTED AS THEY OCCUR.

WINTER WEATHER STABILIZATION NOTES:

THE WINTER CONSTRUCTION PERIOD IS CONSIDERED TO BE ALL CONSTRUCTION ACTIVITIES INVOLVED WITH ONGOING LAND DISTURBANCE AND EXPOSURE BETWEEN NOVEMBER 15TH TO THE FOLLOWING APRIL 1ST.

- 1. THE OWNER / OPERATOR AND SITE CONTRACTOR SHALL PREPARE A SNOW MANAGEMENT PLAN WITH ADEQUATE STORAGE FOR SNOW AND CONTROL OF MELT WATER, REQUIRING CLEARED SNOW TO BE STORED IN A MANNER NOT AFFECTING ONGOING CONSTRUCTION ACTIVITIES.
- ENLARGE AND STABILIZE ACCESS POINTS TO PROVIDE FOR SNOW MANAGEMENT AND STOCKPILING. SNOW MANAGEMENT ACTIVITIES MUST NOT DESTROY OR DEGRADE INSTALLED EROSION AND SEDIMENT CONTROL PRACTICES.
- A MINIMUM 25 FOOT BUFFER SHALL BE MAINTAINED FROM ALL PERIMETER CONTROLS SUCH AS SILT FENCE. MARK SILT FENCE WITH TALL STAKES THAT ARE VISIBLE ABOVE THE SNOW PACK.
- EDGES OF DISTURBED AREAS THAT DRAIN TO A WATERBODY WITHIN 100 FEET WILL HAVE 2 ROWS OF SILT FENCE, 5 FEET APART, INSTALLED ON THE CONTOUR.
- DRAINAGE STRUCTURES MUST BE KEPT OPEN AND FREE OF SNOW AND ICE DAMS. ALL DEBRIS, ICE DAMS, OR DEBRIS FROM PLOWING OPERATIONS, THAT RESTRICT THE FLOW OF RUNOFF AND MELTWATER, SHALL BE REMOVED.
- SEDIMENT BARRIERS MUST BE INSTALLED AT ALL APPROPRIATE PERIMETER AND SENSITIVE LOCATIONS. SILT FENCE AND OTHER PRACTICES REQUIRING EARTH
- SOIL STOCKPILES MUST BE PROTECTED BY THE USE OF ESTABLISHED VEGETATION, ANCHORED STRAW MULCH, ROLLED STABILIZATION MATTING, OR OTHER DURABLE COVERING. A BARRIER MUST BE INSTALLED AT LEAST 15 FEET FROM THE TOE OF THE STOCKPILE TO PREVENT SOIL MIGRATION AND TO CAPTURE LOOSE SOIL.
- IN AREAS WHERE SOIL DISTURBANCE ACTIVITY HAS TEMPORARILY OR PERMANENTLY CEASED, THE APPLICATION OF SOIL STABILIZATION MEASURES SHOULD BE INITIATED BY THE END OF THE NEXT BUSINESS DAY AND COMPLETED WITHIN THREE (3) DAYS. ROLLED EROSION CONTROL BLANKETS MUST BE USED ON ALL SLOPES 3 HORIZONTAL TO 1 VERTICAL OR STEEPER.
- 9. IF STRAW MULCH ALONE IS USED FOR TEMPORARY STABILIZATION, IT SHALL BE APPLIED AT DOUBLE THE STANDARD RATE OF 2 TONS PER ACRE, MAKING THE APPLICATION RATE 4 TONS PER ACRE. OTHER MANUFACTURED MULCHES SHOULD BE APPLIED AT DOUBLE THE MANUFACTURER'S RECOMMENDED RATE.
- 10. TO ENSURE ADEQUATE STABILIZATION OF DISTURBED SOIL IN ADVANCE OF A MELT EVENT, AREAS OF DISTURBED SOIL SHOULD BE STABILIZED AT THE END OF EACH WORK DAY UNLESS:
- a. WORK WILL RESUME WITHIN 24 HOURS IN THE SAME AREA AND NO PRECIPITATION IS FORECAST OR;
- b. THE WORK IS IN DISTURBED AREAS THAT COLLECT AND RETAIN RUNOFF, SUCH AS OPEN UTILITY TRENCHES, FOUNDATION EXCAVATIONS, OR WATER MANAGEMENT AREAS
- 11. USE STONE PATHS TO STABILIZE ACCESS PERIMETERS OF BUILDINGS UNDER CONSTRUCTION AND AREAS WHERE CONSTRUCTION VEHICLE TRAFFIC IS ANTICIPATED. STONE PATHS SHOULD BE A MINIMUM 10 FEET IN WIDTH BUT WIDER AS NECESSARY TO ACCOMMODATE EQUIPMENT.

THE SITE SHALL BE INSPECTED FREQUENTLY TO ENSURE THAT THE EROSION AND SEDIMENT CONTROL PLAN IS PERFORMING ITS WINTER STABILIZATION FUNCTION. IF THE SITE WILL NOT HAVE EARTH DISTURBING ACTIVITIES ONGOING DURING THE WINTER SEASON, ALL BARE EXPOSED SOIL MUST BE STABILIZED BY ESTABLISHED

VEGETATION, STRAW OR OTHER ACCEPTABLE MULCH, MATTING, ROCK, OR OTHER APPROVED MATERIAL SUCH AS ROLLED EROSION CONTROL PRODUCTS. SEEDING OF

AREAS WITH MULCH COVER IS PREFERRED BUT SEEDING ALONE IS NOT ACCEPTABLE FOR PROPER STABILIZATION. COMPLIANCE INSPECTIONS MUST BE PERFORMED AND REPORTS FILED PROPERLY IN ACCORDANCE WITH THE SWPPP FOR ALL SITES UNDER A WINTER SHUTDOWN.

GENERAL EROSION CONTROL NOTES AND MAINTENANCE REQUIREMENTS

- THE MAINTENANCE OF EROSION CONTROL DEVICES WILL BE THE RESPONSIBILITY OF THE OWNER/OPERATOR AND SITE CONTRACTOR. THE JOB SUPERINTENDENT WILL MONITOR THE CONDITION OF ALL THE DEVICES, CLEAN OR REPLACE STRUCTURES AS CLIMATIC CONDITIONS REQUIRE. THE OWNER/OPERATOR WILL ALSO BE SUBJECT TO THE DIRECTIVE OF THE DESIGN ENGINEER AND MUNICIPAL REPRESENTATIVES TO INCLUDE MUNICIPAL ENGINEER, HIGHWAY SUPERINTENDENT AND BUILDING INSPECTOR
- ALL CONTRACTORS SHALL PERFORM ALL WORK IN ACCORDANCE WITH THE APPROVED PLANS AND MAY BE SUBJECT TO ADDITIONAL EROSION CONTROL REQUIREMENTS AS CONDITIONS MAY ARISE IN THE FIELD, OR AS DIRECTED BY THE DESIGN ENGINEER AND/OR MUNICIPAL REPRESENTATIVES. THE EROSION CONTROL PLAN IS A "LIVING" DOCUMENT.
- THE CONTRACTOR SHALL MAINTAIN ALL EROSION CONTROL DEVICES IN ACCORDANCE WITH THE APPROVED PLANS, MANUFACTURER'S RECOMMENDATIONS, AND AS DIRECTED BY THE DESIGN ENGINEER AND MUNICIPAL REPRESENTATIVES.
- NO EROSION CONTROL STRUCTURES SHALL BE REMOVED UNTIL ALL WORK UPSTREAM THEREFROM HAS BEEN COMPLETED. INCLUDING STABILIZATION, AND APPROVED BY THE DESIGN ENGINEER AND MUNICIPAL REPRESENTATIVES.
- WHEREVER FEASIBLE, NATURAL VEGETATION SHOULD BE RETAINED AND PROTECTED.
- ONLY THE SMALLEST PRACTICAL AREA OF LAND SHOULD BE EXPOSED AT ANY ONE TIME DURING CONSTRUCTION.
- WHEN LANDS IS DISTURBED DURING CONSTRUCTION, THE EXPOSURE SHALL BE KEPT TO THE SHORTEST PRACTICAL PERIOD OF TIME.
- ALL CONSTRUCTION EQUIPMENT SHALL HAVE PROPERLY SIZED AND MAINTAINED MUFFLERS.
- ALL CONSTRUCTION EQUIPMENT SHALL BE TURNED OFF WHEN NOT IN USE.

DISTURBANCE MUST BE INSTALLED BEFORE THE GROUND FREEZES.

• FILTER FABRIC IS TO BE MIRAFI 140, AS MANUFACTURED BY THE CELANESE CORPORATION, OR APPROVED EQUAL.

STREAMS, DRAINAGE SWALES, AND EMBANKMENTS

- ALL CONSTRUCTION ACTIVITIES IN OR EXISTING AROUND DRAINAGE SWALES OR WETLANDS ARE TO BE PROVIDED WITH TEMPORARY EROSION CONTROL STRUCTURES AS SHOWN IN DETAIL, LOCATED IMMEDIATELY DOWNSTREAM FROM SUCH ACTIVITY. THESE STRUCTURES ARE TO BE IN PLACE AS SHOWN PRIOR TO THE START OF
- CONSTRUCTION EQUIPMENT SHALL NOT UNNECESSARILY CROSS LIVE STREAMS OR DRAINAGE SWALES EXCEPT BY MEANS OF BRIDGES AND CULVERTS OR OTHER APPROVED METHODS.
- ALL EMBANKMENTS TO BE GRADED AND SEEDED IMMEDIATELY UPON BEING LAID BACK.
- STABILIZATION OF THE SWALES WILL INCLUDE SEEDING AND STRAW MULCH ON SLOPES LESS THAN 5% AND JUTE NETTING OR EQUAL ON SLOPES EXCEEDING 5%.
- TOPSOIL AND/OR EARTH STOCKPILE SHALL BE LOCATED OUTSIDE OF EXISTING DRAINAGE SWALES, WETLANDS AND ADJACENT AREAS. SILT FENCES WILL BE PLACED. ALONG THE TOE OF THE PILES AND THESE PILES SHALL RECEIVE TEMPORARY SEEDING.



-CALL TOLL FREE 1-800-962-7962 -NY INDUSTRIAL CODE RULE 753 REQUIRES NO LESS THAN TWO WORKING DAYS NOTICE, BUT NOT MORE THAN TEN DAYS NOTICE



TEMPORARY SEEDING SHALL BE APPLIED ON CONSTRUCTION SITES TO PROTECT AN AREA, OR SECTION, WHERE FINAL GRADING IS COMPLETE, WHEN PREPARING FOR WINTER WORK SHUTDOWN, OR TO PROVIDE COVER WHEN PERMANENT SEEDINGS AREA LIKELY TO FAIL DUE TO MID-SUMMER HEAT AND DROUGHT. WATER MANAGEMENT PRACTICES MUST BE INSTALLED AS APPROPRIATE FOR SITE CONDITIONS. THE AREA MUST BE ROUGH GRADED AND SLOPES PHYSICALLY STABLE. LARGE DEBRIS AND ROCKS ARE USUALLY REMOVED. SEEDBED MUST BE SEEDED WITHIN 24 HOURS OF DISTURBANCE OR SCARIFICATION OF THE SOIL SURFACE WILL BE NECESSARY PRIOR TO SEEDING.

- SEED MIX (SPRING, SUMMER OR EARLY FALL)

---2H:1V SLOPE TO BE

PROPOSED

SILT FENCE

(TYP.)

STABILIZED-

CONSTRUCTION

ENTRANCE

TEMPORARY

CULVERT

SOIL STOCKPILE

AREA (TYP.)

TEMPORARY

CULVERT

STABILIZED

CONSTRUCTION

ENTRANCE

PROPOSED

DIVERSION

SWALE (TYP.)

2H: 1V SLOPE TO BE

STABILIZED BY SLOPE

STABILIZATION BLANKETS

(SEE DETAIL

AL-TAKIQ

6-1-72

SINGH / KHANDUJA

6-1-69.3

550-

STABILIZED BY SLOPE

(SEE DETAIL)

STABILIZATION BLANKETS

,328)

· PROPOSED `

STAGING

AREA

UTILIZE PROPOSED BASIN -

AS SEDIMENT BASIN W/

TEMPORARY RISER.

(SEE DETAILS)

PROPOSED

DIVERSION

SWALE (TYP.)

-PROPOSED

INLET

PROTECTION

THE INFILTRATION BASIN IS TO BE

GRADED TO THE 517' ELEVATION AND

THE REMAINING BASIN VOLUME IS NOT

TO BE EXCAVATED UNTIL ALL

UPSTREAM AREAS HAVE ACHIEVED

FINAL STABILIZATION. (DENSE &

VIGOROUS VEGETATIVE COVER

ESTABLISHED OVER CONTRIBUTING

PERVIOUS DRAINAGE AREA)

´UTÌLIZÈ PROPOSÉD

\INFILTRATION PRETREATMENT

BASIN AS SEDIMENT BASIN

#1 W/ TEMPORARY RISER

(SEE DETAILS)

SURESKY STORAGE LOT, LLC.

6-1-70.12

KEAVCO

6-1-69.5

1H:1V SLOPE TO BE

STABILIZED BY SLOPE

(SEE DETAIL)

STABILIZATION BLANKE

STABILIZED WITH TEMPORARY SEEDING

- RYEGRASS (ANNUAL OR PERENNIAL) AT 30LBS/ACRE OR 0.7LB/1000 SQFT
- SEED MIX (LATE FALL OR EARLY WINTER) CERTIFIED 'AROOSTOOK' WINTER RYE (CEREAL RYE) AT 100LBS/ACRE OR 2.5LBS/1000 SQFT
- MULCH THE AREA WITH STRAW AT 2 TONS/ACRE (90LBS/1000SQFT OR 2 BALES). MULCH ANCHORING WILL BE REQUIRED WHERE WIND OR AREAS OF CONCENTRATED WATER ARE OF CONCERN. WOOD FIBER HYDROMULCH OR OTHER SPRAYABLE PRODUCTS APPROVED FOR EROSION CONTROL (NYLON WEB OR MESH) MAY BE USED IF APPLIED ACCORDING TO MANUFACTURERS' SPECIFICATIONS. CAUTION IS ADVISED WHEN USING NYLON OR OTHER SYNTHETIC PRODUCTS, AS THEY MAY BE DIFFICULT TO REMOVE PRIOR TO FINAL SEEDING.

PERMANENT SEEDING:

ALL WATER CONTROL MEASURES WILL BE INSTALLED AS NEEDED PRIOR TO FINAL GRADING AND SEEDBED PREPARATION. ANY SEVERELY COMPACTED SECTIONS WILL REQUIRE CHISELING OR DISKING TO PROVIDE AN ADEQUATE ROOTING ZONE, TO A MINIMUM DEPTH OF 12", PER THE SOIL RESTORATION STANDARD PROVIDED IN THE NEW YORK STATE STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL DATED NOVEMBER 2016. THE SEEDBED MUST BE PREPARED TO ALLOW GOOD SOIL TO SEED CONTACT, WITH THE SOIL NOT TOO SOFT AND NOT TOO COMPACT. ADEQUATE SOIL MOISTURE MUST BE PRESENT TO ACCOMPLISH THIS. IF SURFACE IS POWDER DRY OR STICKY WET, POSTPONE OPERATIONS UNTIL MOISTURE CHANGES TO A FAVORABLE CONDITION, IF SEEDING IS ACCOMPLISHED WITHIN 24 HOURS OF FINAL GRADING, ADDITIONAL SCARIFICATION IS GENERALLY NOT NEEDED, ESPECIALLY ON DITCH AND STREAM BANKS. REMOVE ALL STONES OR OTHER DEBRIS FROM THE SURFACE THAT ARE GREATER THAN 4 INCHES, OR THAT WILL INTERFERE WITH FUTURE MOWING OR MAINTENANCE.

SOIL AMENDMENTS SHOULD BE INCORPORATED INTO THE UPPER 2 INCHES OF SOIL WHEN FEASIBLE. SOIL SHOULD BE TESTED TO DETERMINE THE AMOUNTS OF AMENDMENTS NEEDED. APPLY GROUND AGRICULTURAL LIMESTONE TO ATTAIN A PH OF 6.0 IN THE UPPER INCHES OF SOIL. FERTILIZER SHOULD BE APPLIED IN ACCORDANCE WITH SOIL TESTING. IF SOIL MUST BE FERTILIZED BEFORE RESULTS OF A SOIL TEST CAN BE OBTAINED TO DETERMINE FERTILIZER NEEDS, APPLY COMMERCIAL FERTILIZER AT 600 LBS. PER ACRE OF 5-5-10 OR EQUIVALENT. IF MANURE IS USED, APPLY A QUANTITY TO MEET THE NUTRIENTS OF THE ABOVE FERTILIZER. THIS REQUIRES AN APPROPRIATE MANURE ANALYSIS PRIOR TO APPLYING TO THE SITE. DO NOT USE MANURE ON SITES TO BE PLANTED WITH TREFOIL OR IN THE PATH OF CONCENTRATED WATER FLOW.

THE OPTIMUM TIMING FOR PERMANENT SEEDING IS EARLY SPRING. PERMANENT SEEDING MAY BE MADE ANY TIME OF YEAR IF PROPERLY MULCHED AND ADEQUATE MOISTURE IS PROVIDED. LATE JUNE THROUGH EARLY AUGUST IS NOT A GOOD TIME TO SEED, BUT MAY FACILITATE COVERING THE LAND WITHOUT ADDITIONAL DISTURBANCE IF CONSTRUCTION IS COMPLETED. PORTIONS OF THE SEEDING MAY FAIL DUE TO DROUGHT AND HEAT. THESE AREAS MAY NEED RESEEDING IN LATE SUMMER/FALL OR THE FOLLOWING SPRING.

BROADCASTING, DRILLING, CULTIPACK TYPE SEEDING, OR HYDROSEEDING ARE ACCEPTABLE METHODS. PROPER SOIL TO SEED CONTACT IS KEY TO SUCCESSFUL SEEDINGS.

MULCHING IS ESSENTIAL TO OBTAIN A UNIFORM STAND OF SEEDED PLANTS. OPTIMUM BENEFITS OF MULCHING NEW SEEDINGS ARE OBTAINED WITH THE USE OF SMALL GRAIN STRAW APPLIED AT A RATE OF 2 TONS PER ACRE, AND ANCHORED WITH A NETTING OR TACKIFIER. APPLY STRAW (CEREAL GRAIN) MULCH AFTER SOIL AMENDMENTS AND PLANTING IS ACCOMPLISHED OR SIMULTANEOUSLY IF HYDROSEEDING IS USED. APPLY STRAW MULCH AT 2 TON/ACRE (90LBS/1000SQFT) AND ANCHORED WITH WOOD FIBER MULCH (HYDROMULCH) AT 500—750 LBS/ACRE (11—17 LBS/1000SQFT). THE WOOD FIBER MULCH MUST BE APPLIED THROUGH A HYDROSEEDER IMMEDIATELY AFTER MULCHING.

WATERING MAY BE ESSENTIAL TO ESTABLISH A NEW SEEDING WHEN A DROUGHT CONDITION OCCURS SHORTLY AFTER A NEW SEEDING

THE OPTIMUM TIMING FOR PERMANENT SEEDING IS EARLY SPRING. LATE JUNE THROUGH EARLY AUGUST IS NOT A GOOD TIME TO SEED DUE TO DROUGHT AND HEAT. PERMANENT SEED MIXTURES SHOULD NOT BE USED DURING WINTER/COLD WEATHER MONTHS.

	GENERAL SEED MIX:	VARIETY	LBS. / ACRE	LBS. / 1000 SQ.
	RED CLOVER ¹ OR	ACCLAIM, RALLY, RED HEAD II, RENEGADE	8 ²	0.20
	COMMON WHITE CLOVER1	COMMON	8	0.20
	<u>PLUS</u>			
	CREEPING RED FESCUE	COMMON	20	0.45
	<u>PLUS</u>			
Ε	SMOOTH BROMEGRASS OR	COMMON	2	0.05
TS	RYEGRASS (PERENNIAL)	PENNFINE / LINN	5	0.10
	¹ ADD INOCULANT IMMEDIATEL ² MIX 4 LBS EACH OF EMPIF	Y PRIOR TO SEEDING RE AND PARDEE <u>OR</u> 4 LBS OF BIRDSFOOT A	ND 4 LBS WHITE	

CLOVER PER ACRE. ALL SEEDING RATES ARE GIVEN FOR PURE LIVE SEED (PLS)

- 1. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO CONTACT ALL UTILITY COMPANIES FOR UTILITY MARK OUTS. CONTRACTOR IS TO ASSUME FULL RESPONSIBILITY FOR MAINTAINING CONTINUOUS UTILITY SERVICE AND REPAIRS TO UTILITIES IN THE EVENT OF DAMAGE PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO FIELD LOCATE AND VERIFY ALL
- EXISTING UTILITIES LOCATIONS, ELEVATIONS, INVERTS, ETC. AND NOTIFY THE DESIGN ENGINEER OF ANY DISCREPANCIES ON THIS PLAN. CONTRACTOR IS TO COORDINATE NEW UTILITY SERVICES WITH ALL UTILITY COMPANIES.
- CONTRACTOR IS TO BE RESPONSIBLE FOR ALL TRAFFIC MAINTENANCE. -5. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL PROJECT SAFETY REQUIREMENTS.

(IN FEET

1 inch = 30 ft

RESERVED FOR TOWN OF CHESTER PLANNING BOARD APPROVAL

03-17-20 AS PER FUSCO COMMENTS DATED 1-27-20 01-21-20 SWPPP PREP & FUSCO COMMENTS DATED 12-3-19 CJP 11-6-19 SITE PLAN PREPARATION DATE DATE DESCRIPTION REVISIONS

05-07-20 AS PER FUSCO COMMENTS DATED 5-01-20

MAP CHECK DATE: INITIALED BY: JJP

INITIALS

PIETRZAK & PFAU ENGINEERING & SURVEYING, PLLC 2 HAMILTON AVENUE 262 GREENWICH AVENUE, SUITE A GOSHEN, NEW YORK 10924 || MONTICELLO, NEW YORK 12701 (845) 294-0606 **(845)** 796–4646 <u>Joseph J. PFAU P.E.</u> MICHAEL F. CREEGAN P.L.S <u>vincent a. Pietrzak P.E., P.E.S., Leed®ap</u> P.E. LICENSE NO. 076936, P.L.S. LICENSE NO. 050075 N.J.P.L.S. LICE ISE NO. 35396


ELKAY DRIVE COMMERCIA BUILDING SITE PLAN TOWN OF CHESTER

COUNTY OF ORANGE, NEW YORK

EROSION CONTROL PLAN SECTION 6 BLOCK 1 LOT 69.4

LINAUTHORIZED ALTERATION OR ADDITION TO A PLAN BEARING A LICENSED LAND SURVEYOR'S OR PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209. SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW O.C.H.D. SHEET NO. | D.E.C. SHEET NO. | DRAWING NUMBER _ | <u>_N/A</u>_ OF ____ CAD REFERENCE | PROJECT NUMBER /


1"=30' 19139 ENG BASE 19139.01

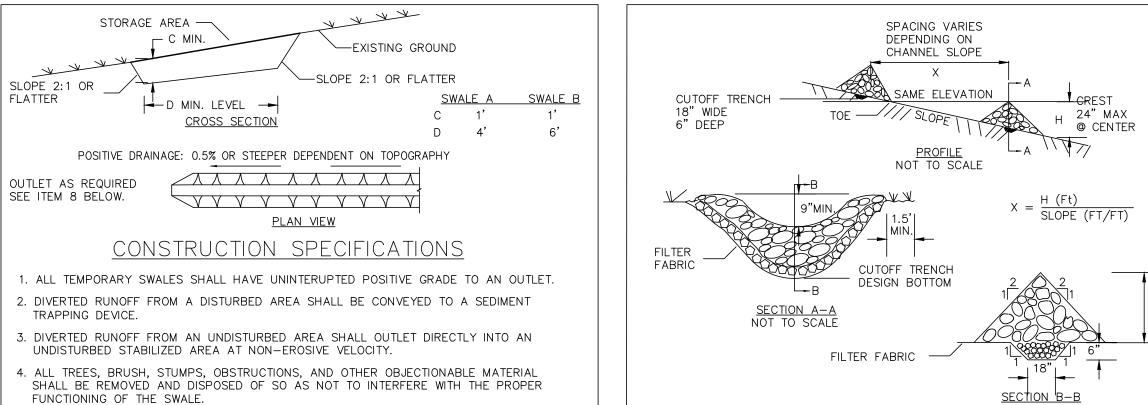

- 5. THE SWALE SHALL BE EXCAVATED OR SHAPED TO LINE, GRADE, AND CROSS SECTION AS REQUIRED TO MEET THE CRITERIA SPECIFIED HEREIN AND BE FREE OF BANK PROJECTIONS OR OTHER IRREGULARITIES WHICH WILL IMPEDE NORMAL FLOW.
- 6. FILLS SHALL BE COMPACTED BY EARTH MOVING EQUIPMENT.
- 7. ALL EARTH REMOVED AND NOT NEEDED FOR CONSTRUCTION SHALL BE PLACED SO THAT IT WILL NOT INTERFERE WITH THE FUNCTIONING OF THE SWALE. 8. STABILIZATION SHALL BE AS PER THE FLOW CHANNEL STABILIZATION CHART BELOW:
- TREATMENT GRADE B(5 AC -10AC) 0.5 - 3.0%SEED AND STRAW MULCH SEED AND STRAW MULCH 3.1-5.0% SEED USING JUTE OR EXCELSION SEED AND STRAW MULCH SEED WITH JUTE OR EXCELSIOR, SOD LINED WITH 4-8" RIP-RAP OR 5.1-8.0%
- RECYCLED CONCRETE EQUIVALENT 8.1-20.% LINED WITH 4-8" RIP-RAP ENGINEERED DESIGN 9. PFRIODIC INSPECTION AND REQUIRED MAINTENANCE MUST BE PROVIDED AFTER EACH

RAIN EVENT.	-KOVIDED
U.S. DEPARTMENT OF AGRICULTURE NATURAL RESOURCES CONSERVATION SERVICE NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE	Т

TEMPORARY SWALE



OF THE DOWNSTREAM DAM IS AT THE SAME ELEVATION OF THE TOE OF THE

PROTECT THE CHANNEL DOWNSTREAM OF THE LOWEST CHECK DAM FROM SCOUR

CHECK DAMS ARE NOT SUBJECT TO DAMAGE OR BLOCKAGE FROM DISPLACED STONE.

5. ENSURE THAT CHANNEL APPURTENANCES SUCH AS CULVERT ENTRANCES BELOW


3. EXTEND THE STONE A MINIMUM OF 1.5 FEET BEYOND THE DITCH BANKS TO

GRADES AND LOCATIONS SHOWN IN THE PLAN.

AND EROSION WITH STONE OR LINER AS APPROPRIATE.

PREVENT CUTTING AROUND THE DAM.

UPSTREAM DAM.

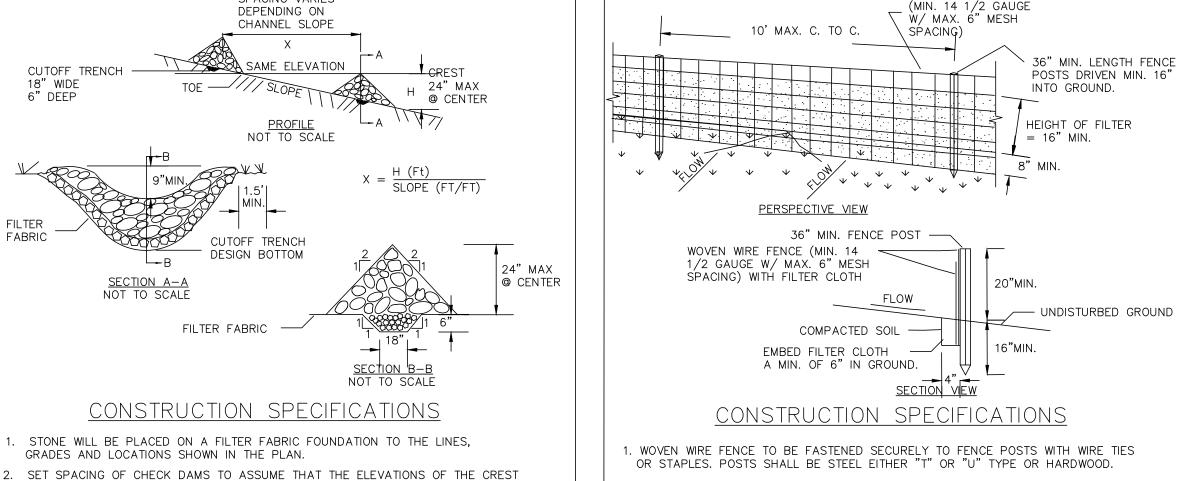

- 2. FILTER CLOTH TO BE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.
- FENCE SHALL BE WOVEN WIRE, 12 1/2 GAUGE, 6" MAXIMUM MESH OPENING. 3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-

WOVEN WIRE FENCE

- LAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N, OR APPROVED EQUIVALENT.
- 4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
- 5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

U.S. DEPARTMENT OF AGRICULTURE NATURAL RESOURCES CONSERVATION SERVICE NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE	SILT FENCE
---	------------

ADAPTED FROM DETAILS PROVIDED BY: USDA - NRCS. FABRIC NEW YORK STATE DEPARTMENT OF TRANSPORTATION, NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION, NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

- GATHER EXCESS

CONSTRUCTION SPECIFICATIONS

STAKES EVENLY AROUND INLET 3 FEET APART AND DRIVE A M 18 INCHES DEEP. SPANS GREATER THAN 3 FEET MAY BE BRIDGED HE USE OF WIRE MESH BEHIND THE FILTER FABRIC FOR SUPPORT.

SHALL BE EMBEDDED 1 FOOT MINIMUM BELOW GROUND AND LED. IT SHALL BE SECURELY FASTENED TO THE STAKES AND FRAME.

AT CORNERS

3. STAKE MATERIALS WILL BE STANDARD 2" \times 4" WOOD OR EQUIVALENT. METAL WITH A MINIMUM LENGTH OF 3 FEET.

6. A 2" x 4" WOOD FRAME SHALL BE COMPLETED AROUND THE CREST OF THE FABRIC FOR OVER FLOW STABILITY.

MAXIMUM DRAINAGE AREA 1 ACRE

STAKE -

2"X4" WOOD FRAME

WITH GATE

FRAME

DROP INLET PROTECTION


BURIED FABRIC (12"

DRIVE STAKES

BELOW GRADE

A MIN. OF 18"

BELOW GRADE)

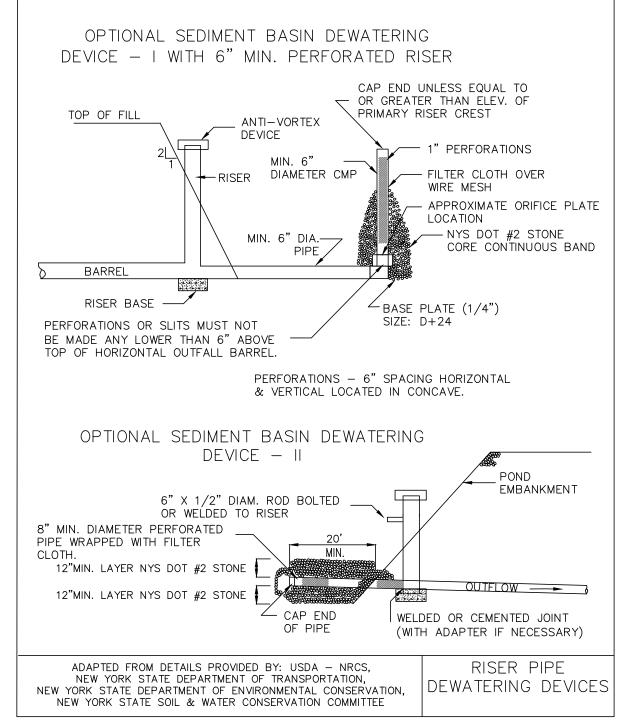

SEDIMENT BASIN DESIGN SIZE TABLE PROVIDED REQUIRED DRAINAGE BASIN PER TRIB ACRE BASIN VOLUME BASIN VOLUME

(CU. FT.)

3.600

3,600

(CU. FT.)

11,412

4,000

(CU. FT.)

4,013

CJP


JJP

INITIALS

25,050

AREA (AC.)


3.17

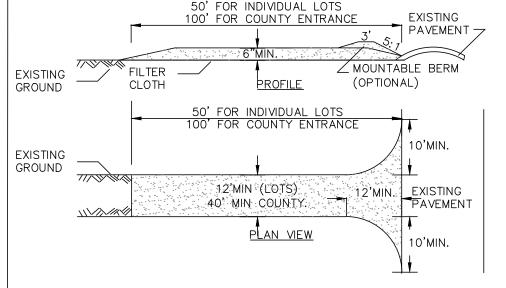


CONSTRUCTION SPECIFICATIONS


- 1. STONE SIZE USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT. . LENGTH - NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE
- A 30 FOOT MINIMUM LENGTH WOULD APPLY). 3. THICKNESS - NOT LESS THAN SIX (6) INCHES.
- 4. WIDTH TWELVE (12) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS. TWENTY-FOUR (24) FOOT IF SINGLE
- ENTRANCE TO SITE. 5. FILTER CLOTH - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING
- OF STONE. 6. SURFACE WATER — ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CON—
- STRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY, ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACTED ONTO PUBLIC RIGHTS-OF-WAY
- 8. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON A AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- 9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH


U.S. DEPARTMENT OF AGRICULTURE NATURAL RESOURCES CONSERVATION SERVICE NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE	STABILIZED CONSTRUCTION ENTRANCE

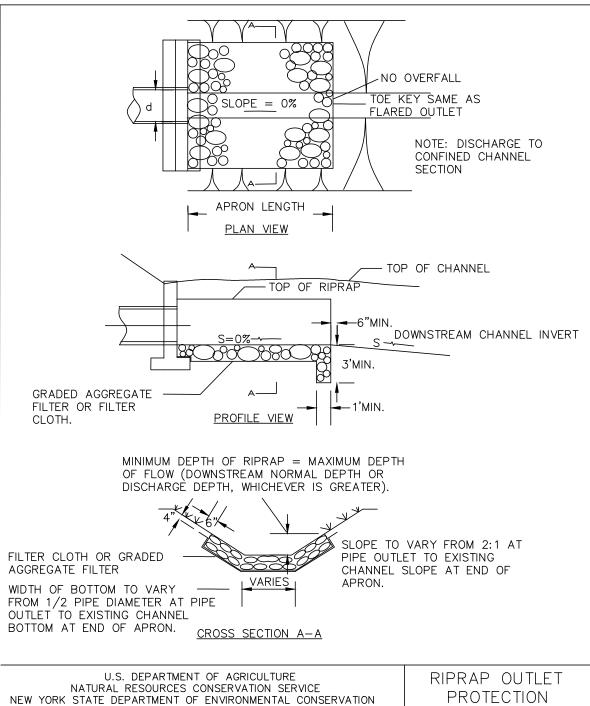


NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE

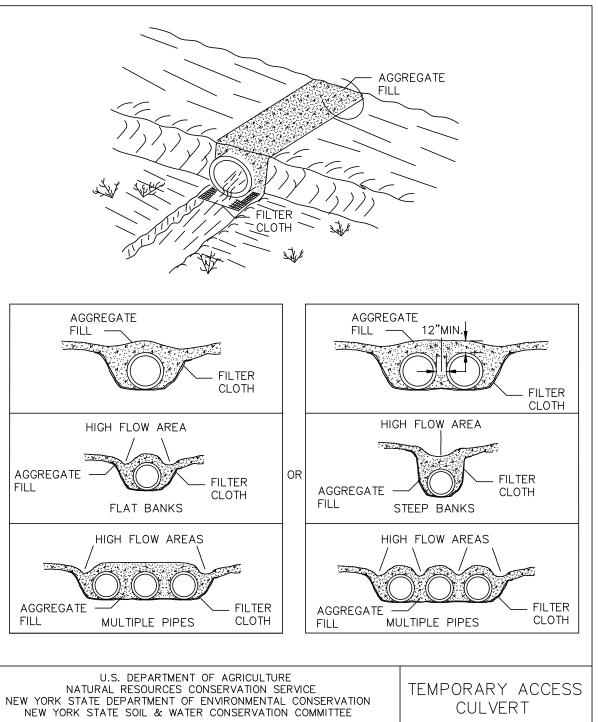

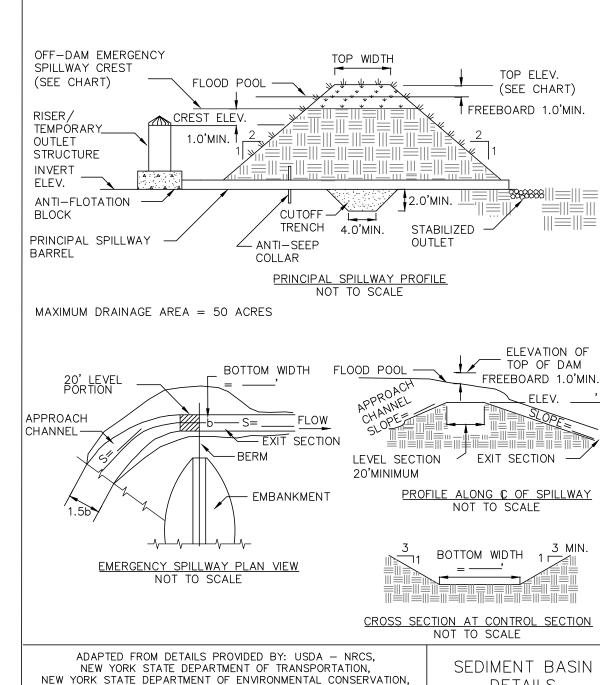

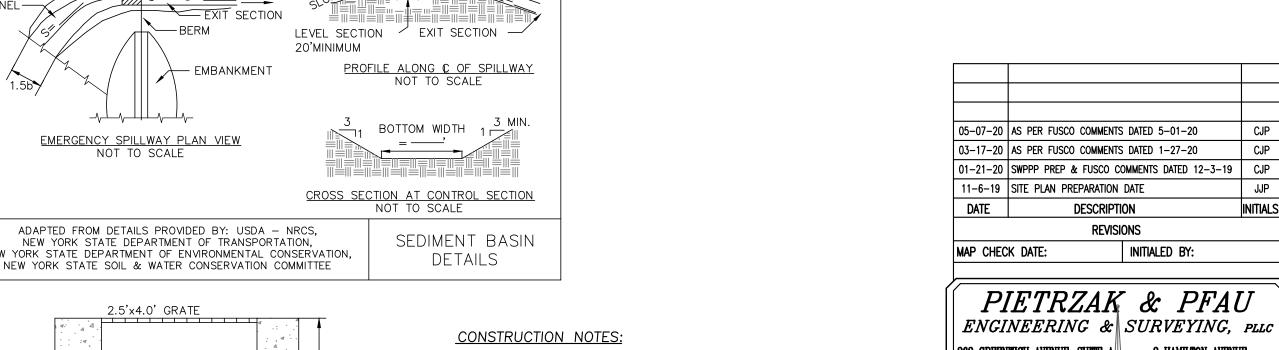


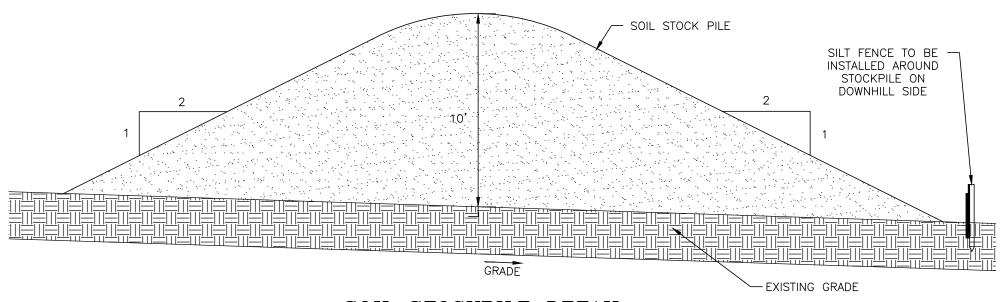

SOIL STOCKPILE DETAIL




<u>BEFORE YOU DIG, DRILL OR BLAST</u> -CALL TOLL FREE 1-800-962-7962 -NY INDUSTRIAL CODE RULE 753 REQUIRES NO LESS THAN TWO WORKING DAYS NOTICE, BUT NOT MORE THAN TEN DAYS NOTICE

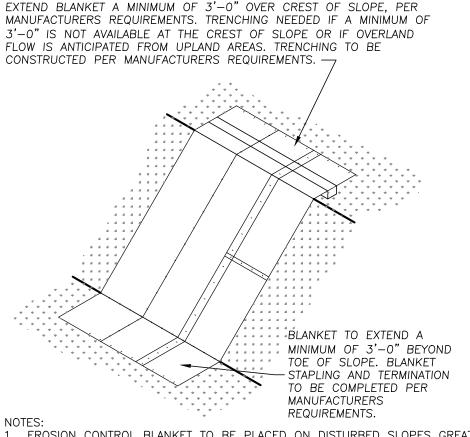

EXAMPLE

- 1. EROSION CONTROL BLANKET TO BE PLACED ON DISTURBED SLOPES GREATER THAN PHORIZONTAL TO 1 VERTICAL, AS SHOWN ON THE EROSION CONTROL PLAN.
- 2. FOR SLOPES OF 2H:1V EROSION CONTROL BLANKET TO BE CURLEX I (EXCELSIOR EROSION CONTROL BLANKETS) OR APPROVED EQUAL. 3. FOR SLOPES OF 1H:1V - EROSION CONTROL BLANKET TO BE CURLEX III
- (EXCELSIOR EROSION CONTROL BLANKETS) OR APPROVED EQUAL. 4. EROSION CONTROL BLANKET IS TO BE INSTALLED PER MANUFACTURERS

SLOPE STABILIZATION BLANKET DETAIL

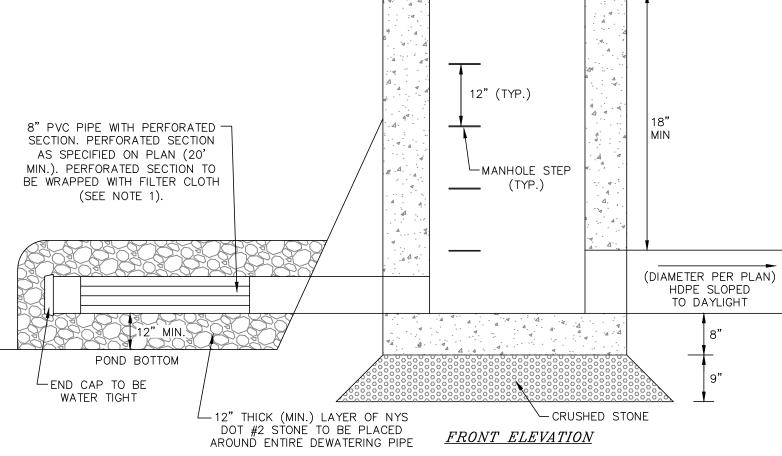

1. FILTER CLOTH IS TO HAVE A SIEVE SIZE BETWEEN #40-80 (MIRAFI FW402, OR APPROVED EQUAL). FILTER CLOTH IS TO COVER PIPE AT LEASE 6" PAST PERFORATIONS AND IS TO BE SECURED WITH STRAPPING OR A CONNECTING BAND ON EACH END. 2. UPON FINAL STABILIZATION OF ALL UPSTREAM AREAS, THE TEMPORARY OUTLET STRUCTURE IS

PROPOSED TEMPORARY OUTLET STRUCTURE


N.T.S. FOR SEDIMENT BASIN DETAIL

TO BE REMOVED AND THE SEDIMENT BASIN IS TO BE REMOVED OR CLEANED AND REGRADED

1. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO CONTACT ALL UTILITY COMPANIES FOR UTILITY MARK OUTS. CONTRACTOR IS TO ASSUME FULL RESPONSIBILITY FOR MAINTAINING CONTINUOUS UTILITY SERVICE AND REPAIRS TO UTILITIES IN THE EVENT OF DAMAGE 2. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO FIELD LOCATE AND VERIFY ALL EXISTING UTILITIES LOCATIONS, ELEVATIONS, INVERTS, ETC. AND NOTIFY THE DESIGN ENGINEER OF ANY DISCREPANCIES ON THIS 3. CONTRACTOR IS TO COORDINATE NEW UTILITY SERVICES WITH ALL UTILITY COMPANIES. 4. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL TRAFFIC MAINTENANCE. 5. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL PROJECT SAFETY

REQUIREMENTS.

RESERVED FOR TOWN OF CHESTER PLANNING BOARD APPROVAL

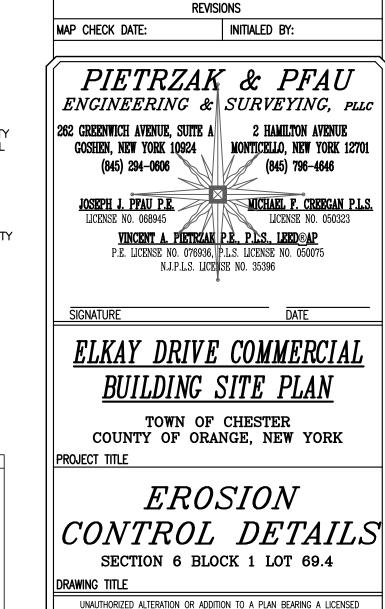

LAND SURVEYOR'S OR PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW.

O.C.H.D. SHEET NO. | D.E.C. SHEET NO. | DRAWING NUMBER


19139 ENG BASE


19139.01


CAD REFERENCE | PROJECT NUMBER /

_ | <u>_N/A</u>_ OF ____

1"=30'

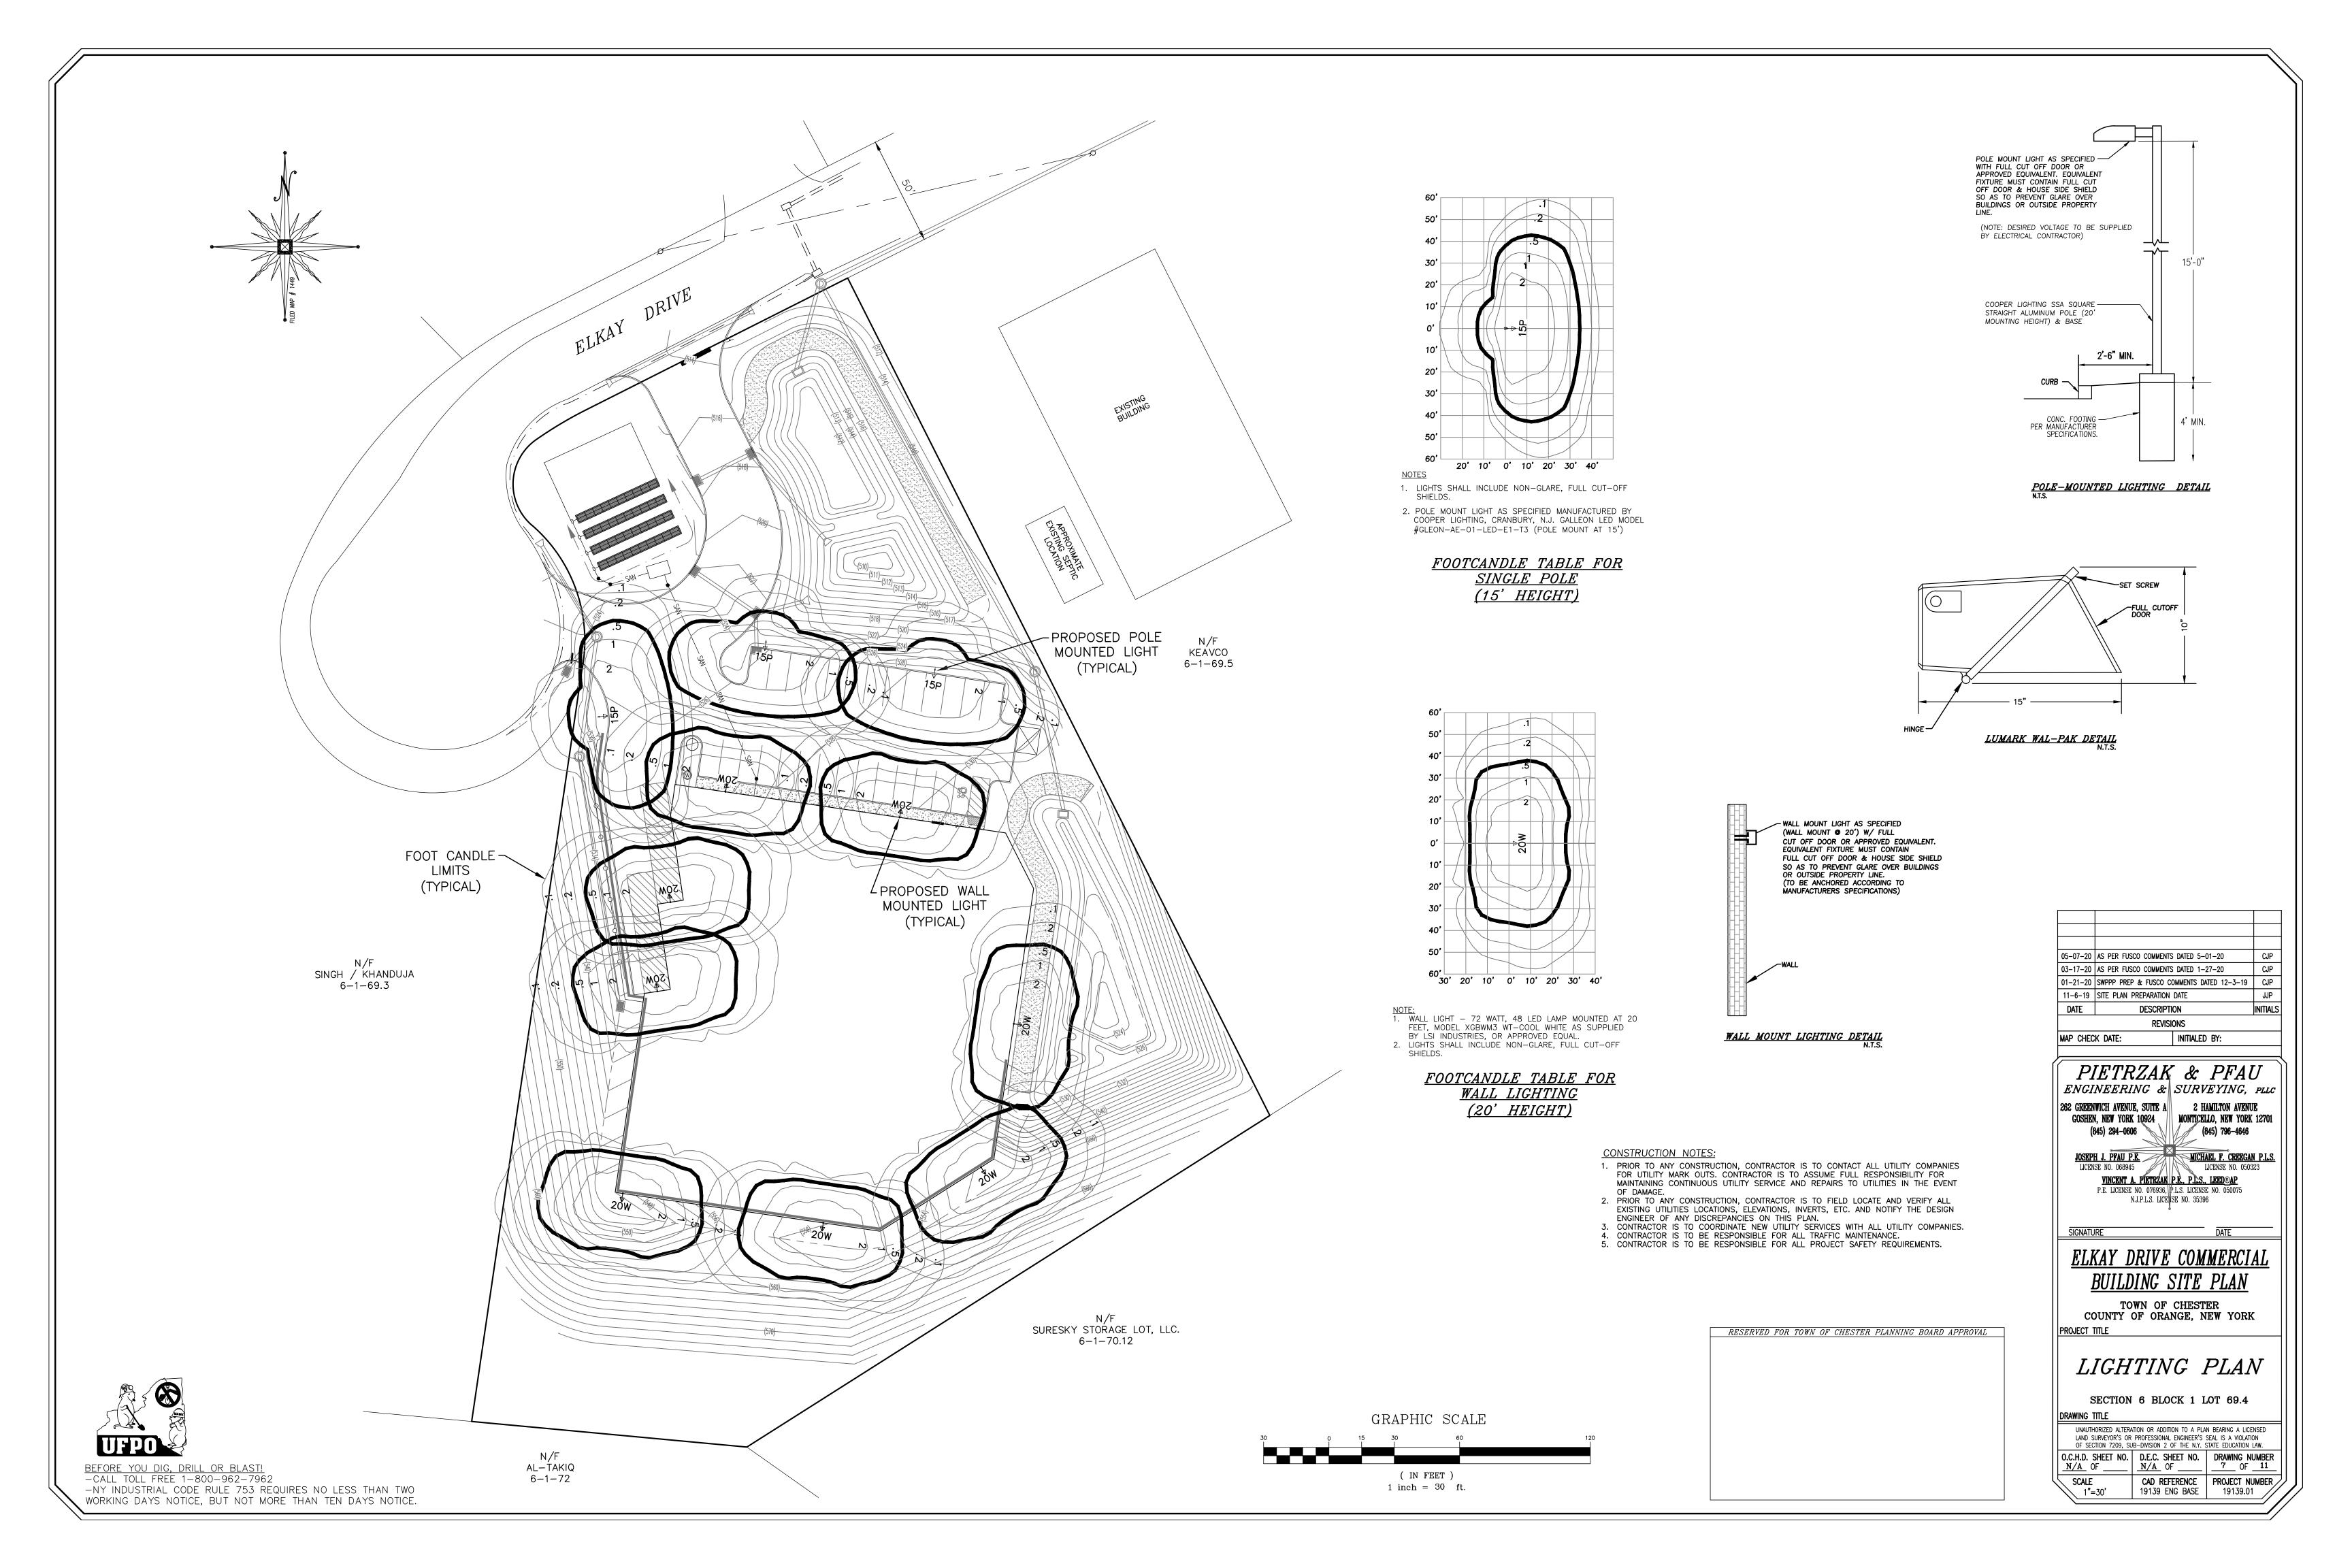

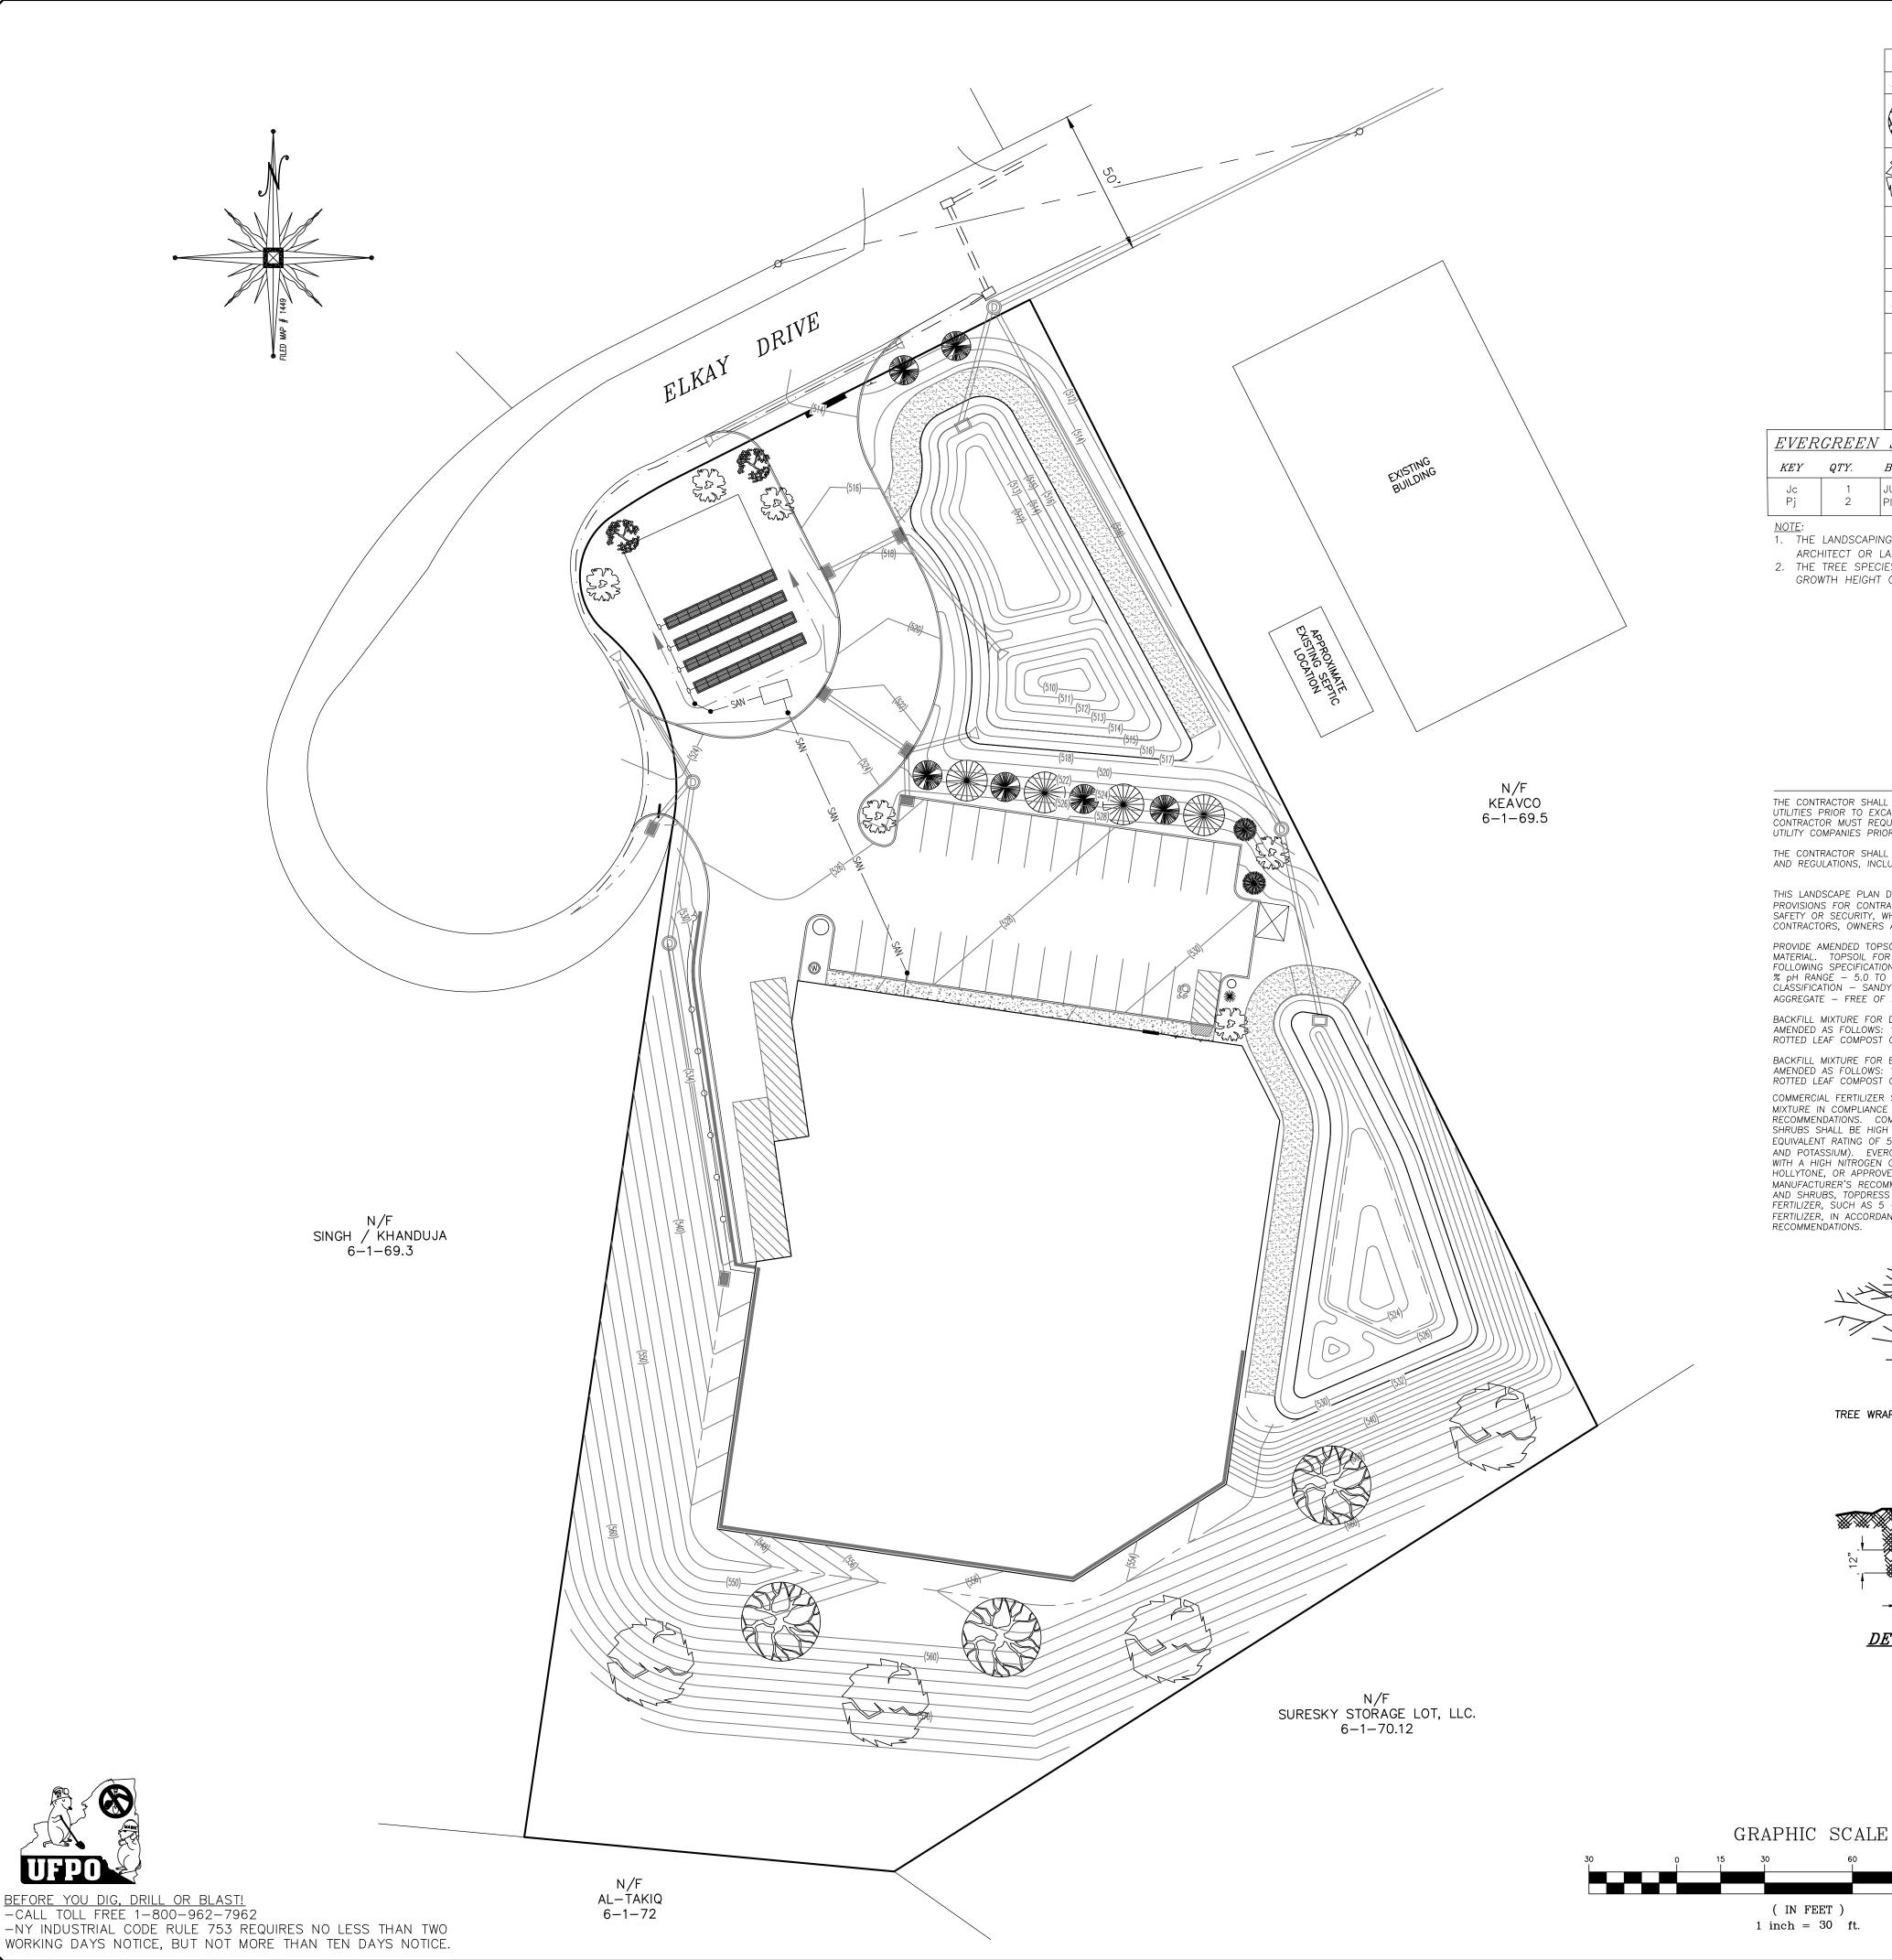

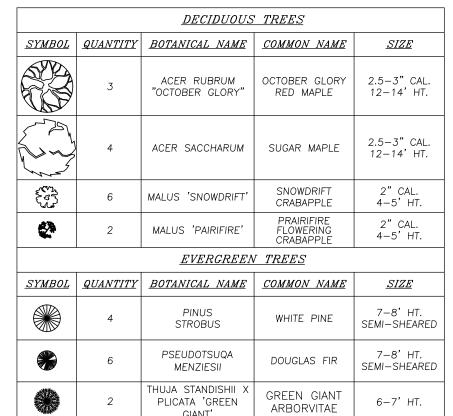

					OIAIII					
EVERGREEN SHRUBS										
KEY	QTY.	BOTANICA	L NAME			COMMON NAME	M1	N. SI	ZE	REMARKS
Jc Pj	1 2	JUNIPERUS PIERIS JAF		"GOLD		GOLD COAST JUNIPEI JAPANESE ANDROMEI	_	0" — . 0" — .	· .	CONTAINER B&B

PLANTING NOTES

WITH A GARDEN SPADE.

OR OTHER SHREDDED WOOD MULCH IS NOT ACCEPTABLE. ALL BED LINES SHALL BE SMOOTHLY AND UNIFORMLY DEFINED

ENGINEER FOR COMPLIANCE WITH THE PLANT LIST.

OF NURSERYMEN, WASHINGTON, D.C.

PLANT BEDS, HEDGES, GROUPINGS, ETC. SHALL BE UNIFORMLY

ALL PLANT MATERIAL SHALL BE SUBJECT TO INSPECTION BY A LANDSCAPE ARCHITECT OR ENGINEER AT ITS SOURCE, PRIOR TO

SHIPMENT TO THE JOBSITE. ALL SPECIMEN ORNAMENTALS, DECIDUOUS TREES, EVERGREEN TREES SHALL BE INSPECTED BY THE LANDSCAPE CONTRACTOR AND/OR A LANDSCAPE ARCHITECT OR

ALL PLANT MATERIAL SHALL BE HIGH QUALITY, SPECIMEN GRADE

STANDARD FOR PLANT MATERIAL SHALL BE AMERICAN STANDARD FOR NURSERY STOCK, PUBLISHED BY THE AMERICAN ASSOCIATION

WITHOUT SPECIFIC AUTHORIZATION OF THE BUILDING INSPECTOR.

ALL TREES MUST MEET THE STANDARDS OF THE AMERICAN STANDARD FOR NURSERY STOCK. ALL TREES SHALL MEASURE AT LEAST 2 TO 2.5 INCHES IN DIAMETER AS MEASURED AT A POINT 6 INCHES ABOVE THE TOP OF THE BALL, NOR LESS THAN 10 FEET HIGH UNLESS OTHERWISE SPECIFIED.

ANY TREE IMPROPERLY PLANTED OR NOT MEETING THESE SPECIFICATIONS

WRITTEN DEMAND FOR SUCH REPLACEMENT OR WITHIN A MORE EXTENDED EXTENDED PERIOD AS MAY BE SPECIFIED.

WILL BE SUBJECT TO REMOVAL. ANY TREE THAT DOES NOT SURVIVE OR IS IN AN UNHEALTHY CONDITION AT THE END OF ONE (1) YEAR SHALL BE REPLACED. SAID REPLACEMENT SHALL BE MADE WITHIN SIXTY (60) DAYS FOLLOWING

MATERIAL, IN VIGOROUS HEALTHY CONDITION. REFERENCED

MULCHED OVER THE ENTIRE BED AREA WITH 3 THICK DOUBLE SHREDDED OAK BARK MULCH, BLACK IN COLOR. PALETTE MULCH

1. THE LANDSCAPING VEGETATION SPECIES SPECIFIED MAY BE MIXED AND MATCHED AT THE LANDSCAPE ARCHITECT OR LANDSCAPER'S DISCRETION, SO LONG AS THE QUANTITY OF VEGETATION SHOWN IS MET.

2. THE TREE SPECIES PROVIDED IN THE FRONT OF THE PROPOSED BUILDING SHALL BE LIMITED TO A MAXIMUM

GROWTH HEIGHT OF 20 TO 25 FEET.

THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING

THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES

THIS LANDSCAPE PLAN DOES NOT CONTAIN OR IMPLY ANY

PROVISIONS FOR CONTRACTORS,' LABORERS', OR TRANSIENTS' SAFETY OR SECURITY, WHICH IS THE SOLE RESPONSIBILITY OF

PROVIDE AMENDED TOPSOIL BACKFILL FOR ALL NEWLY PLANTED MATERIAL. TOPSOIL FOR BACKFILL SHALL COMPLY WITH THE FOLLOWING SPECIFICATIONS: ORGANIC MATTER CONTENT — MIN. 5

BACKFILL MIXTURE FOR DECIDUOUS TREES AND SHRUBS SHALL BE AMENDED AS FOLLOWS: 1 PART APPROVED TOPSOIL TO 2 PARTS

BACKFILL MIXTURE FOR EVERGREEN TREES AND SHRUBS SHALL BE AMENDED AS FOLLOWS: 1 PART APPROVED TOPSOIL TO 3 PARTS

RECOMMENDATIONS. COMMERCIAL FERTILIZER FOR ALL TREES AND SHRUBS SHALL BE HIGH PHOSPHOROUS FERTILIZER WITH AN EQUIVALENT RATING OF 5 - 10- 5 (NITROGEN, PHOSPHOROUS

AND POTASSIUM). EVERGREEN TREES AND SHRUBS TOPDRESS WITH A HIGH NITROGEN GRANULAR FERTILIZER SUCH AS HOLLYTONE, OR APPROVED EQUAL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. FOR DECIDUOUS TREES

ROTTED LEAF COMPOST OR PEAT MOSS, THOROUGHLY MIXED.

ROTTED LEAF COMPOST OR PEAT MOSS, THOROUGHLY MIXED. COMMERCIAL FERTILIZER SHALL BE ADDED TO THE BACKFILL

MIXTURE IN COMPLIANCE WITH THE MANUFACTURER'S

AND REGULATIONS, INCLUDING LOCAL ORDINANCES GOVERNING THE

CONTRACTOR MUST REQUEST FIELD LOCATIONS FROM THE VARIOUS COMPLETED.

UTILITIES PRIOR TO EXCAVATING FOR PLANTING WORK.

UTILITY COMPANIES PRIOR TO BEGINNING THE WORK.

CONTRACTORS, OWNERS AND OPERATORS.

CLASSIFICATION - SANDY LOAM OR LOAM

AGGREGATE - FREE OF STONES 1/2" OR GREATER

% pH RANGE - 5.0 TO 6.5

(IN FEET)

TOPSOIL & SEEDING NOTES

- 1. AREAS DESIGNATED TO BE TOPSOILED AND SEEDED SHALL BE TREATED AS FOLLOWS:
- A. ESTABLISH SUBGRADE TO A SMOOTH, UNIFORM SURFACE ELEVATION 4 INCHES BELOW FINISHED GRADE. REMOVE ALL SURFACE STONES 2' OR GREATER FROM THE TOP 2' OF THE SUBGRADE.

B. SPREAD HIGH PHOSPHOROUS GRANULAR FERTILIZER OVER THE

- SUBGRADE AT A RATE OF 5 POUNDS PER 1000 SQUARE FEET. C. SPREAD APPROVED TOPSOIL OVER THE ENTIRE AREA TO A UNIFORM 4 " DEPTH (MINIMUM), TO THE REQUIRED FINISHED GRADE ELEVATIONS. REMOVE ALL STONES 3/4" DIA. OR GREATER FROM THE ENTIRE DEPTH OF TOPSOIL. APPLY PULVERIZED LIMESTONE TO THE TOPSOIL AT A RATE DETERMINED BY SOIL
- TESTING TO MEET REQUIRED PH REQUIREMENTS. D. SPREAD HIGH NITROGEN FERTILIZER (20 - 10 - 10) OVER THE ENTIRE AREA AND RAKE INTO THE TOP 1" OF SOIL, AT A RATE OF
- 3 POUNDS PER 1000 SQUARE FEET. E. SPREAD SEED MIXTURE UNIFORMLY OVER THE ENTIRE AREA AT A RATE OF 5 POUNDS PER 1000 SQUARE FEET. LIGHTLY RAKE SEED INTO THE TOP 1/4" OF SOIL. MIST THE ENTIRE SEED BED THOROUGHLY WITH CARE NOT TO CREATE EROSION OF SEEDBED.
- F. STRAW MULCH (UNIFORMLY BLOWN ON) TO A 1/2 BLANKET AND IMMEDIATELY WATER THE MULCH BLANKET.
- . TOPSOIL SHALL BE AS SPECIFIED UNDER PLANTING NOTES.
- 3. SEED MIXTURE SHALL BE AS SHOWN IN SEEDING SCHEDULE. 4. CONTRACTOR SHALL SUBMIT SEED CERTIFICATION PRIOR TO SEEDING.

SEEDING SCHEDULE

SEED RATE IS 200 POUNDS PER ACRE OR 5 POUNDS PER 1000 SQUARE FEET. SEED SHALL NOT CONTAIN IN EXCESS OF 0.5% WEED SEED. THE SEED SHALL HAVE A MINIMUM PURITY AND GERMINATION PERCENTAGES AS FOLLOWS:

3228 311122 111172 71			
<u>GRASSES</u>	% MINIMUM SEED PURITY	% MINIMUM GERMINATION	<u>% MIX</u>
"RELIANT" HARD FESCUE	96	85	65
FESCUE, RED (CHEWING OR CREEPING)	97	80	20
RYEGRASS, PERENNIAL	98	90	15


PALMER PERENNIAL 20% RYEGRASS, CROWNVETCH 60%, JAMESTOWN CHEWING FESCUE 20% SEED RATE IS 200 POUNDS PER ACRE OR 5 POUNDS PER 1000 SQUARE FEET. SEED CONTAINING PROHIBITED OR RESTRICTED NOXIOUS WEEDS WILL NOT BE ACCEPTED. SEED SHALL NOT CONTAIN IN EXCESS OF 0.5% WEED SEED. THE SEED SHALL HAVE A MINIMUM PURITY AND GERMINATION PERCENTAGES AS FOLLOWS:

	<u>GRASSES</u>	% MINIMUM SEED PURITY	% MINIMUM GERMINATION	% MIX
	CROWNVETCH	95	68	60
ITING NOTES	FESCUE, RED (CHEWING OR CREEPING)	97	80	20
ALL PLANT MATERIAL SHALL BE THOROUGHLY WATERED IN DURING BACKFILLING AND AFTER PLANTING/MULCHING HAS BEEN	RYEGRASS, PERENNIAL	98	90	15

WHERE INNOCULANT IS TO BE USED FOR TREATING LEGUME SEED, THE INNOCULANT SHALL NOT BE USED LATER THAN THE DATE INDICATED ON THE CONTAINER. TWICE THE SUPPLIERS RECOMMENDED RATE OF INNOCULANT SHALL BE USED WHEN SEED IS BROADCAST, FOUR TIMES THE RECOMMENDED RATE IF HYDROSEEDED.

CONSTRUCTION NOTES:

- 1. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO CONTACT ALL UTILITY COMPANIES FOR UTILITY MARK OUTS. CONTRACTOR IS TO ASSUME FULL RESPONSIBILITY FOR MAINTAINING CONTINUOUS UTILITY SERVICE AND REPAIRS TO UTILITIES IN THE EVENT
- 2. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO FIELD LOCATE AND VERIFY ALL EXISTING UTILITIES LOCATIONS, ELEVATIONS, INVERTS, ETC. AND NOTIFY THE DESIGN ENGINEER OF ANY DISCREPANCIES ON THIS PLAN.
- CONTRACTOR IS TO COORDINATE NEW UTILITY SERVICES WITH ALL UTILITY COMPANIES. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL TRAFFIC MAINTENANCE. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL PROJECT SAFETY REQUIREMENTS TREES SHALL NOT BE PLANTED BETWEEN MAY 15 AND SEPTEMBER 15

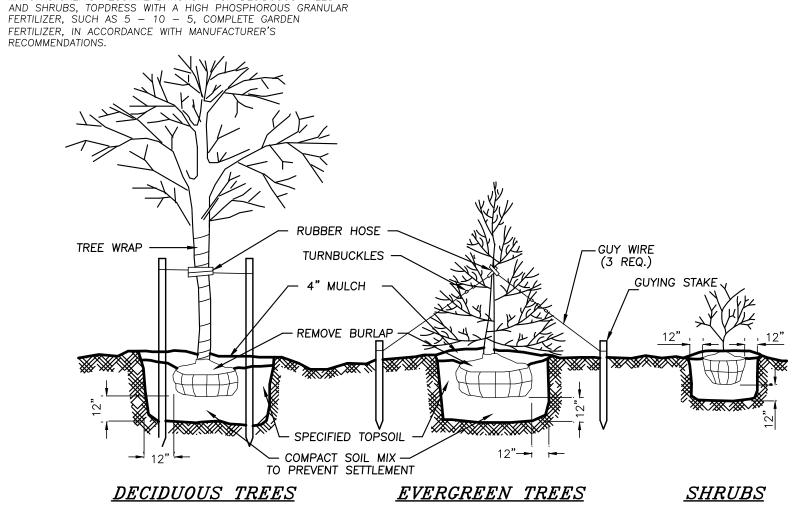

PLANTING & GUYING DETAIL

RESERVED FOR TOWN OF CHESTER PLANNING BOARD APPROVAL

05-07-20 AS PER FUSCO COMMENTS DATED 5-01-20 03-17-20 AS PER FUSCO COMMENTS DATED 1-27-20 CJP 01-21-20 SWPPP PREP & FUSCO COMMENTS DATED 12-3-19 CJP 11-6-19 SITE PLAN PREPARATION DATE JJP INITIALS DATE DESCRIPTION REVISIONS MAP CHECK DATE: INITIALED BY:

PIETRZAK & PFAU ENGINEERING & SURVEYING, PLLC 262 GREENWICH AVENUE, SUITE A 2 HAMILTON AVENUE GOSHEN, NEW YORK 10924 | MONTICELLO, NEW YORK 12701 (845) 796–4646 (845) 294-0606 <u>Joseph J. Pfau P.E.</u> MICHAEL F. CREEGAN P.L.S. LICENSE NO. 068945 VINCENT A. PIETRZAK P.E., P.L.S., LEED®AP P.E. LICENSE NO. 076936, P.L.S. LICENSE NO. 050075 N.J.P.L.S. LICE ISE NO. 35396


> ELKAY DRIVE COMMERCIAL BUILDING SITE PLAN TOWN OF CHESTER


COUNTY OF ORANGE, NEW YORK


LANDSCAPING PLAN

SECTION 6 BLOCK 1 LOT 69.4


LAND SURVEYOR'S OR PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW. O.C.H.D. SHEET NO. D.E.C. SHEET NO. DRAWING NUMBER <u>N/A</u> OF _____ | <u>N/A</u> OF ____ CAD REFERENCE | PROJECT NUMBER / 19139 ENG BASE | 19139.01 1"=30'

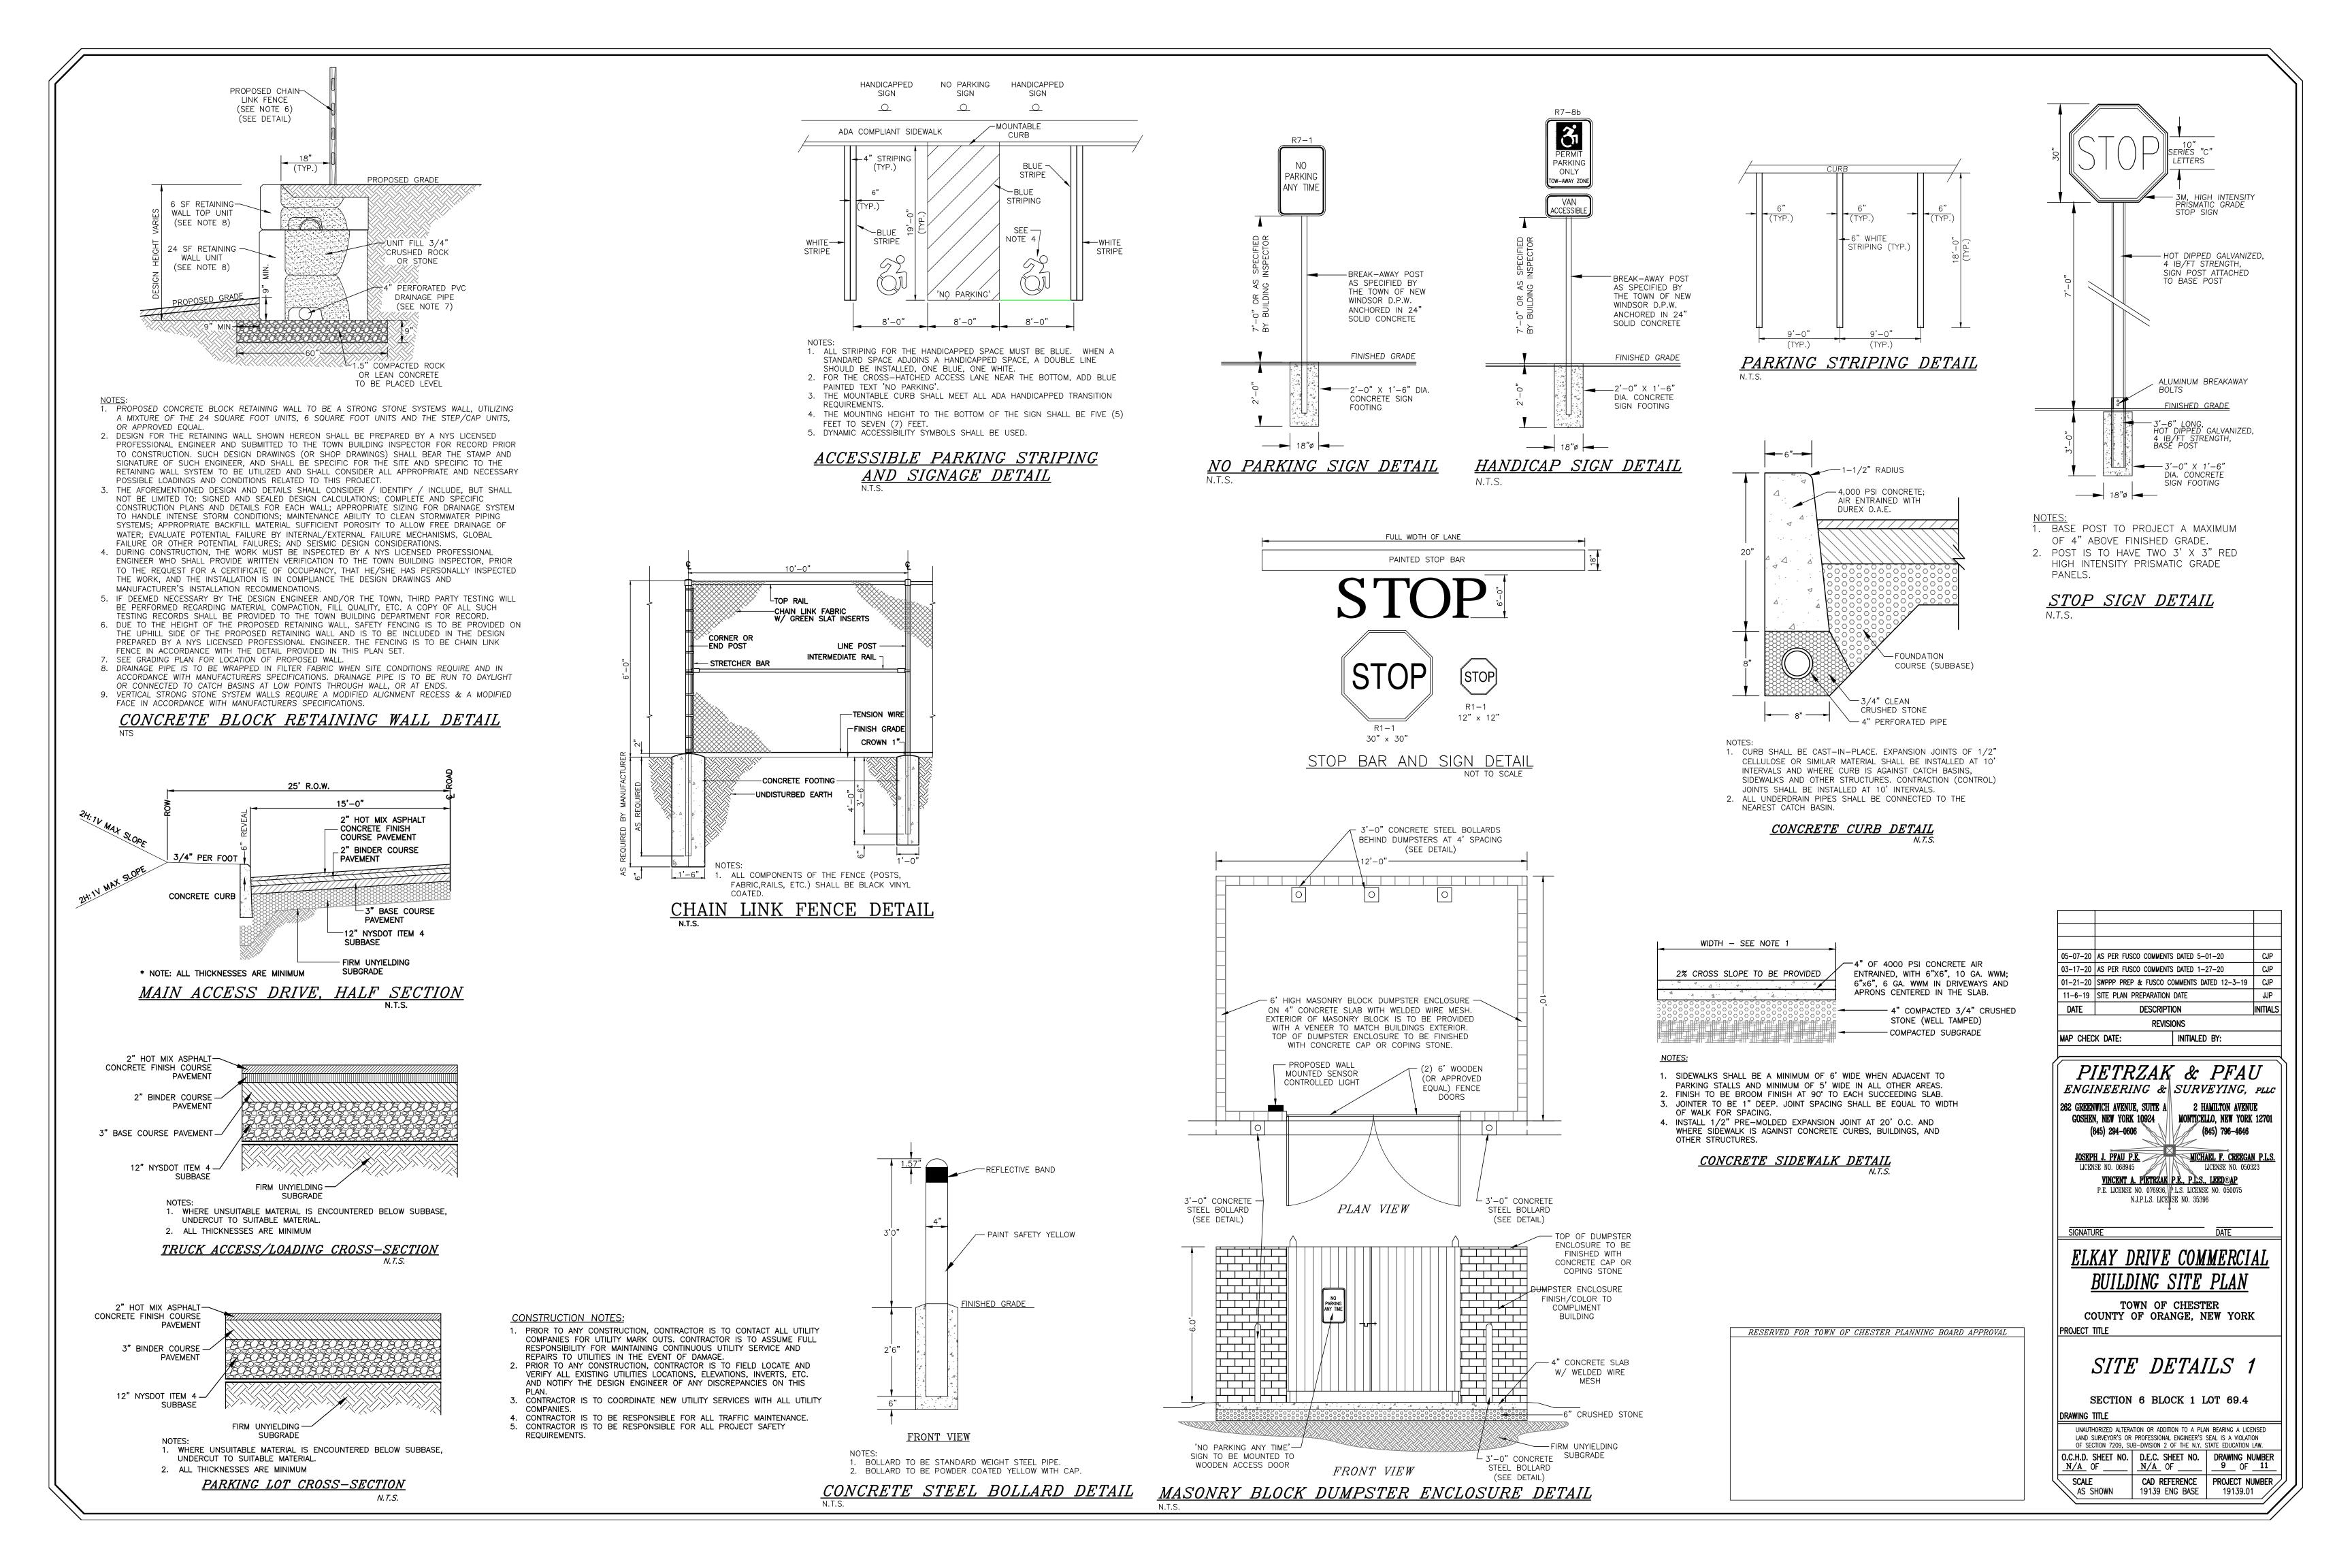

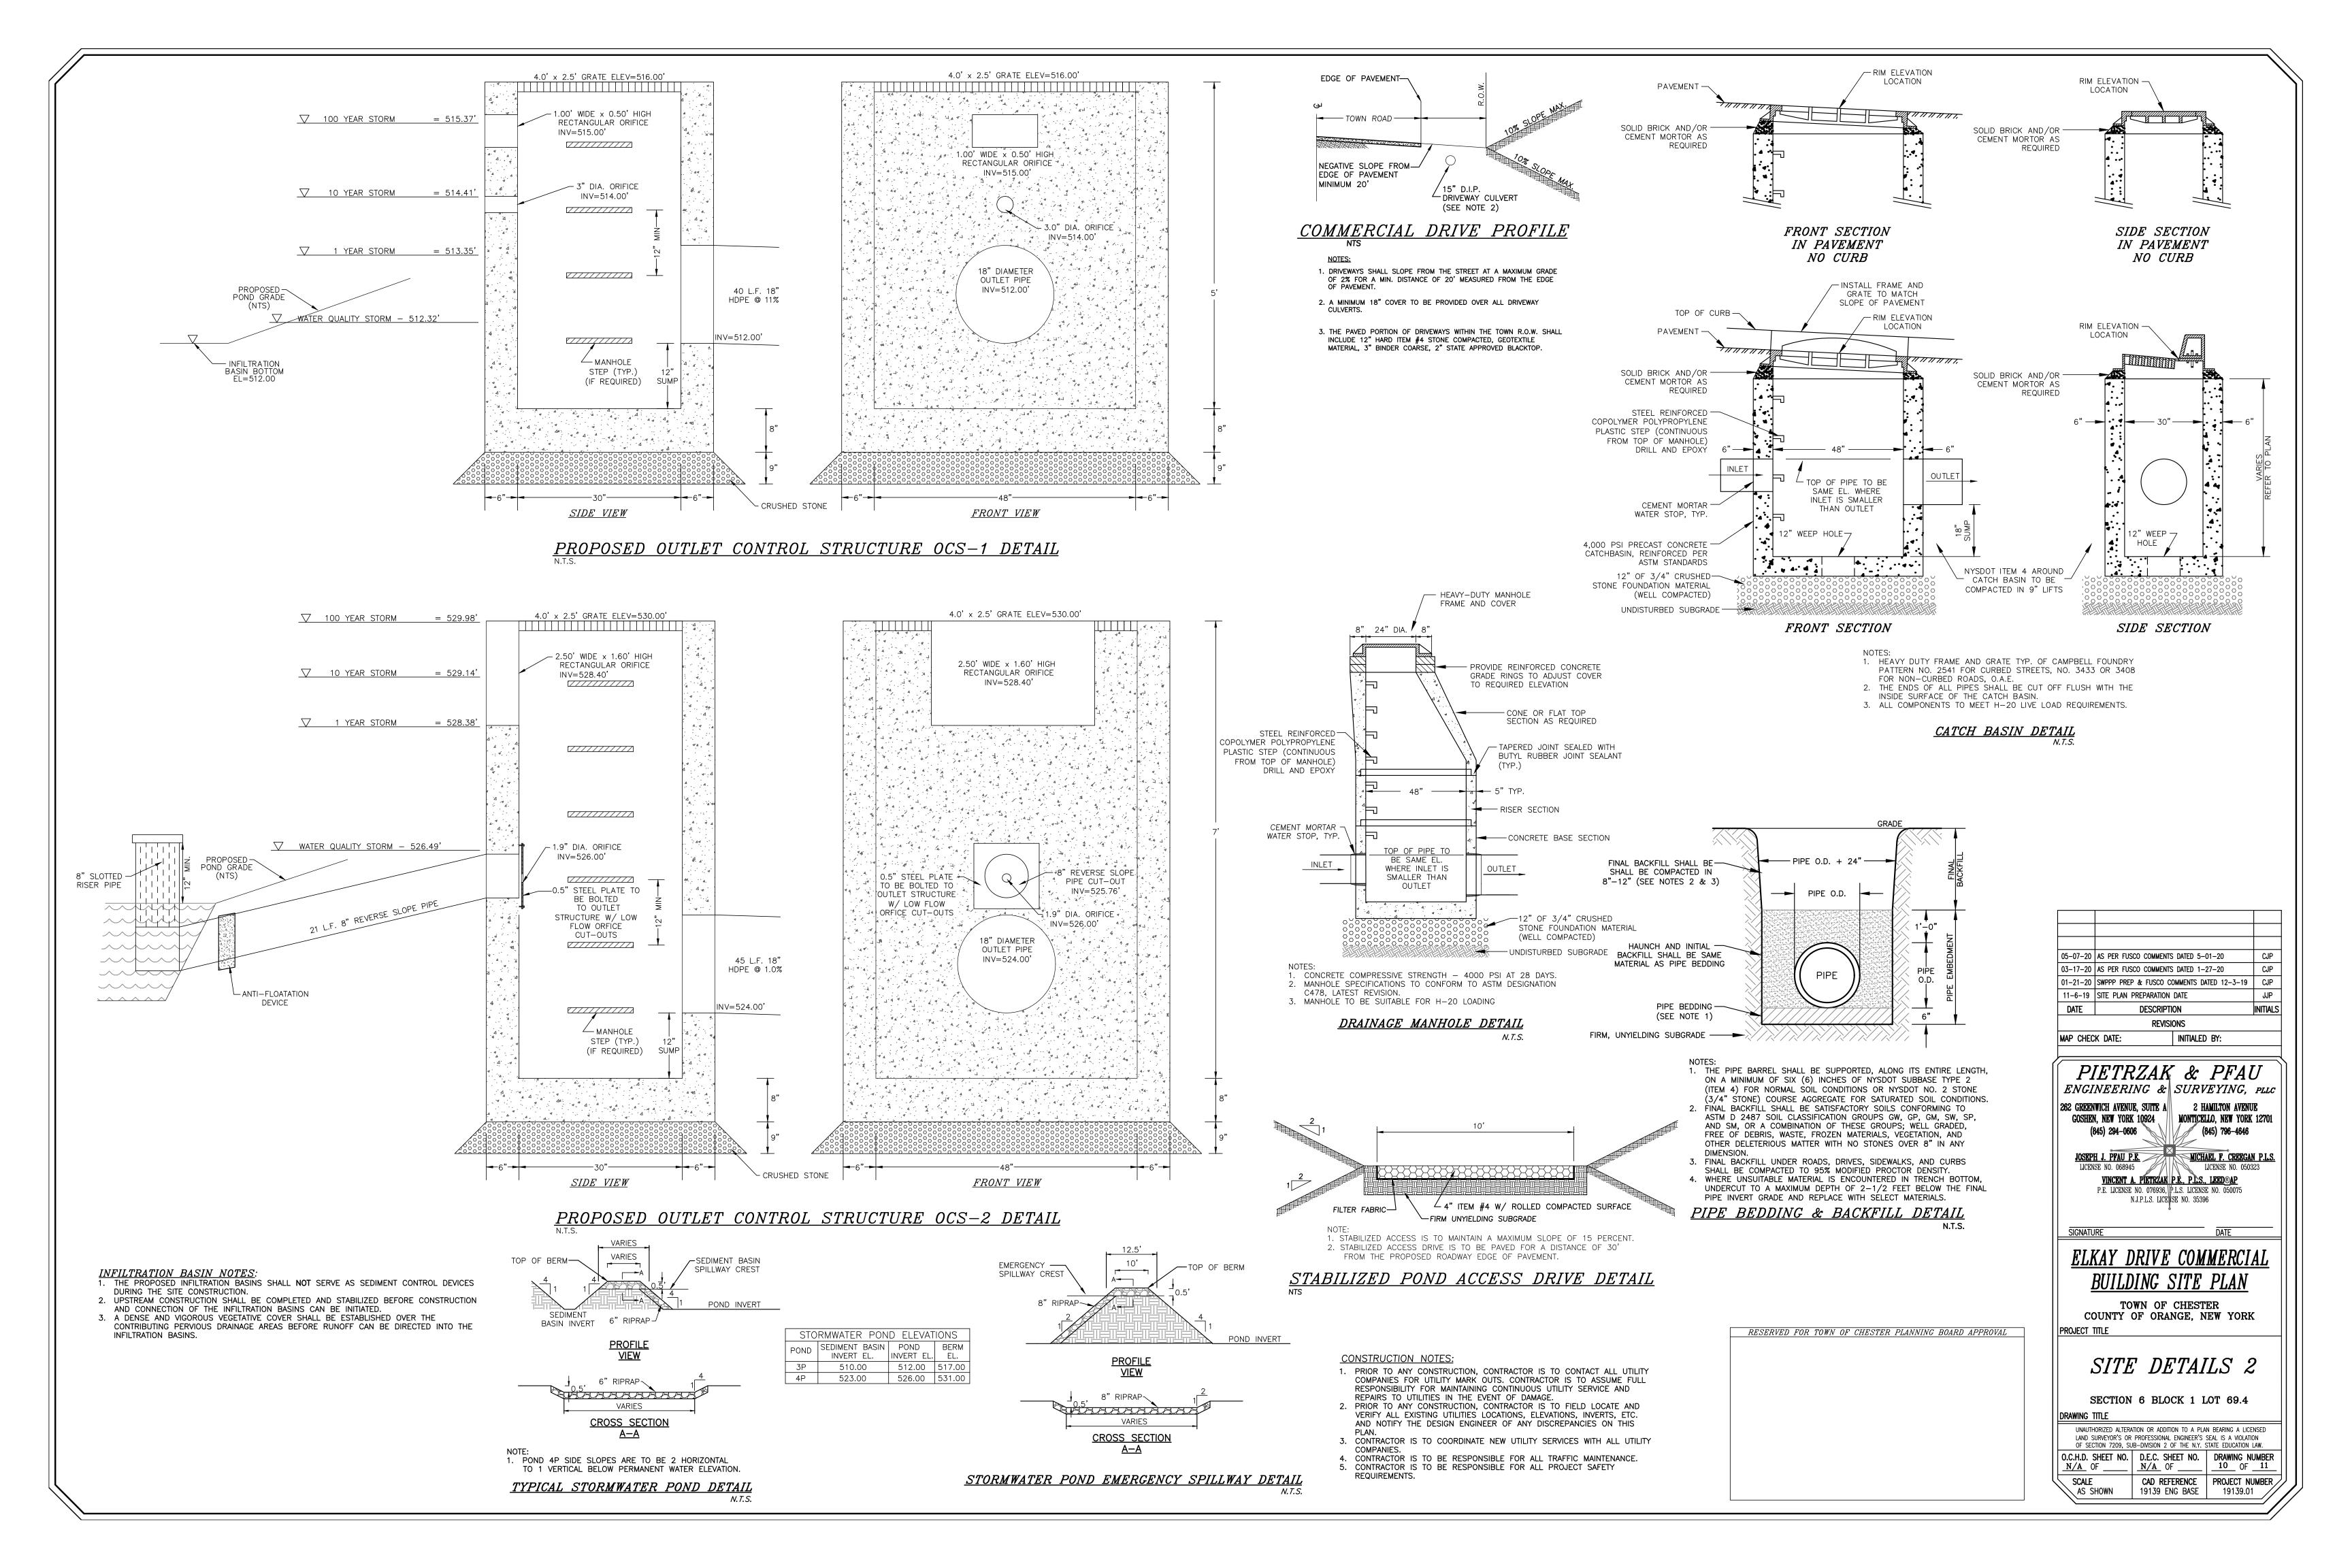


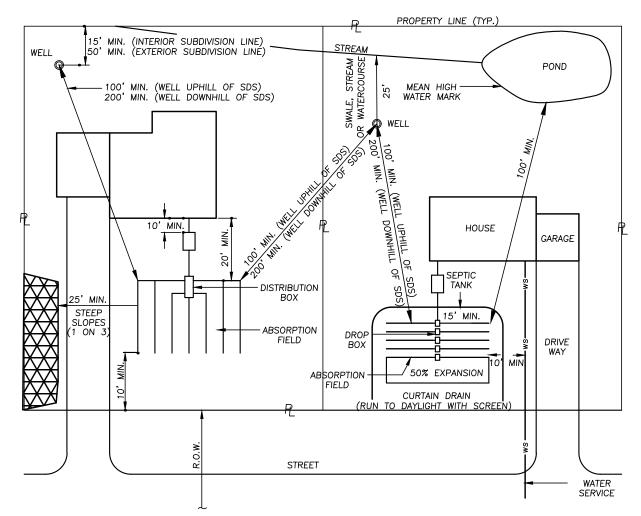

TYPICAL SEPARATION DISTANCE REQUIREMENTS

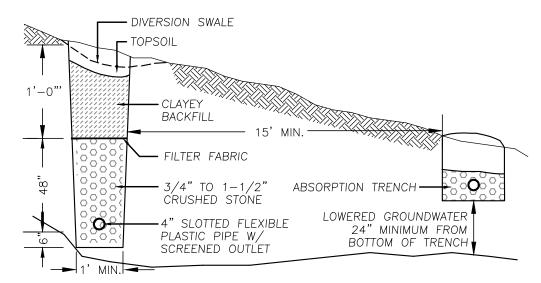


CURTAIN DRAIN DETAIL

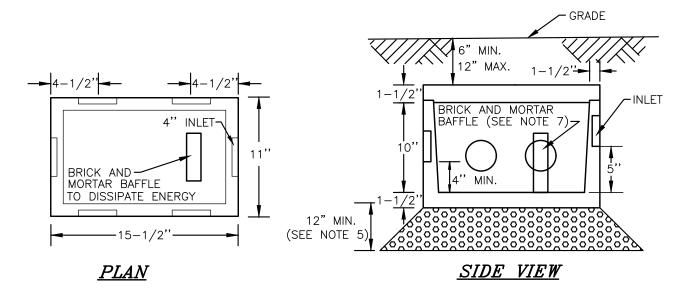

- 1. DROP BOX TO BE AS MANUFACTURED BY WOODARD'S CONCRETE PRODUCTS, INC. MODEL NO. DB-6DB OR APPROVED EQUAL.
- 2. CONCRETE TO TEST 4,000 PSI AT 28 DAYS. 3. ALL OUTLETS NOT USED SHALL REMAIN PLUGGED.
- 4. BOX TO BE INSTALLED WITH A MIN. 6" AND MAX. 12" EARTH COVER.
- 5. BOX TO BE INSTALLED ON 12" MIN OF SAND, PEA GRAVEL, OR TRENCH AGGREGATE.
- 6. PIPE JOINTS TO BE SEALED WITH POLYLOK SEAL OR EQUAL. 7. BRICK AND MORTAR BAFFLE TO BE INSTALLED IN THE CENTER, FOUR (4) INCHES FROM

5-OUTLET DROP BOX DETAIL

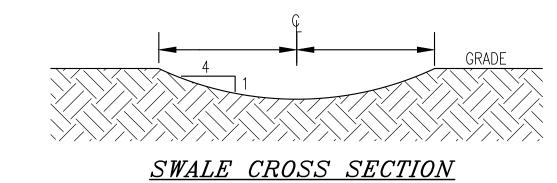

SOIL TEST RESULTS & SEPTIC SYSTEM DESIGN							
DEEP TEST PIT #1 RESULTS	DEEP TEST PIT #2 RESULTS	WITNESSED DEEP TEST PIT RESULTS	PERC RATE	SEPTIC SYSTEM DESIGN			
0"-4" TOPSOIL 4"-42" BROWN SILTY SAND WITH SMALL STONES 42"-66" LIGHT BROWN SANDY GRAVEL WITH LARGE STONES	0"-3" TOPSOIL 3"-72" LIGHT BROWN SILTY SAND	0"-10" TOPSOIL 10"-24" DARK BROWN SANDY LOAM 24"-64" SILTY LOAM WITH SMALL STONES	PT1: 22 MIN. DEPTH 24" PT2: 28 MIN. DEPTH 24"	ELJEN SYSTEM DESIGNED FOR: - WATER USAGE Q = 576 GAL/DAY - 21-30 MIN/INCH DESIGN RATE REQUIRED: 160 L.F. TOTAL PROVIDED: 160 L.F. TOTAL			
NO MOTTLING, NO BEDROCK, NO GROUNDWATER	NO MOTTLING, NO BEDROCK, NO GROUNDWATER	NO MOTTLING, NO BEDROCK, NO GROUNDWATER	WPT: 4 MIN. DEPTH 24"	4 LATS. @ 40', 160 L.F. TOTAL SEPTIC TANK SIZE: 1,250 GAL.			


SOIL TESTING AND SEPTIC SYSTEM DESIGN NOTES:

- PERCOLATION TESTS WERE PERFORMED BY PIETRZAK & PFAU, PLLC ON 11/21/19. PERCOLATION TESTS WERE PERFORMED AT A DEPTH OF 24" UNLESS NOTED OTHERWISE. DEEP TEST PITS WERE WITNESSED BY PIETRZAK & PFAU, PLLC ON 11/21/19.
- ONE DEEP PIT TEST WAS WITNESSED BY FUSCO ENGINEERING AND PIETRZÁK & PFAU, PLLC ON
- 5. ONE PERCOLATION TEST IN 24 INCHES OF EXISTING SOIL WAS WITNESSED BY FUSCO ENGINEERING ON

SOIL INFILTRATION TEST RESULTS		
DEEP TEST PIT #3 RESULTS	DEEP TEST PIT #4 RESULTS	INFILTRATION RATE (IN.)
0"-6" TOPSOIL 6"-102" LIGHT BROWN SILTY SAND	0"-6" TOPSOIL 6"-60" CLAYEY SAND WITH LARGE STONES 60"-78" BROWN SILTY SAND 78"-102" PEA GRAVEL WITH SAND	RATE: 22"/HR DEPTH 24"
NO MOTTLING, NO BEDROCK, NO GROUNDWATER	NO MOTTLING, NO BEDROCK, NO GROUNDWATER	

SOIL INFILTRATION TESTING NOTES:


- INFILTRATION TEST WAS PERFORMED BY PIETRZAK & PFAU, PLLC ON 3/9/20. INFILTRATION TEST WAS PERFORMED AT A DEPTH OF 60" BELOW EXISTING GRADE, AT THE BOTTOM OF
- THE PROPOSED BASIN ONCE EXCAVATED.
- 3. DEEP TEST PITS WERE WITNESSED BY PIETRZAK & PFAU, PLLC ON 3/9/20.

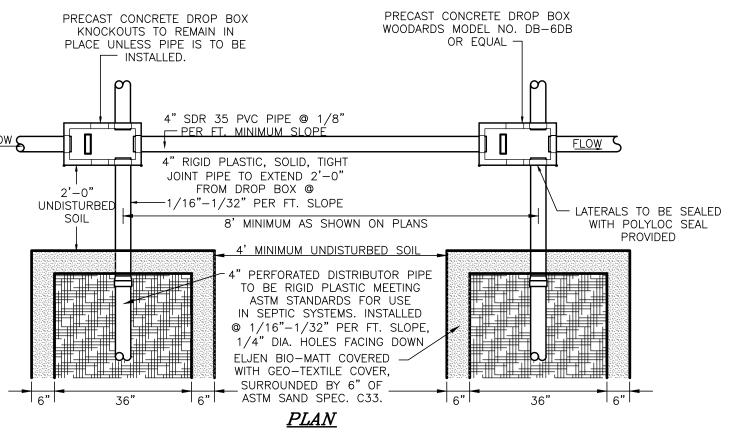


1. ABSORPTION FIELDS SHALL NOT BE BUILT UNDER DRIVEWAYS, PARTS OF BUILDINGS, OR UNDER

- ABOVE GROUND POOLS, OR OTHER AREAS SUBJECT TO HEAVY LOADINGS. THE SAND BEDDING SHALL BE COVERED WITH THE GEOTEXTILE FABRIC PROVIDED WITH EACH UNIT.
- 3. TRENCHES SHALL NOT BE CONSTRUCTED IN WET SOIL.
- 4. SIDES AND BOTTOM OF TRENCH SHALL BE RAKED IMMEDIATELY PRIOR TO PLACING SAND. 5. THE END OF ALL DISTRIBUTOR PIPES SHALL BE PLUGGED.
- 6. HEAVY EQUIPMENT SHALL BE KEPT OFF THE AREA OF THE FIELD EXCEPT FOR ACTUAL CONSTRUCTION OF TEH FIELD. THERE SHALL BE NO UNNECESSARY MOVEMENT OF CONSTRUCTION
- EQUIPMENT IN THE AREA OF THE PROPOSED FIELD, BEFORE OR AFTER CONSTRUCTION. 7. DISTRIBUTION LATERALS SHALL BE SLOPED AT 1/16"-1/32" PER FOOT.
- 8. ABSORPTION TRENCH BOTTOM TO BE SET LEVEL.
- 9. DISTRIBUTION LATERALS ARE TO BE SET WITH PERFORATIONS FACING DOWN.

ELJEN IN-DRAIN SYSTEM DROP BOX/ABSORPTION TRENCH DETAIL

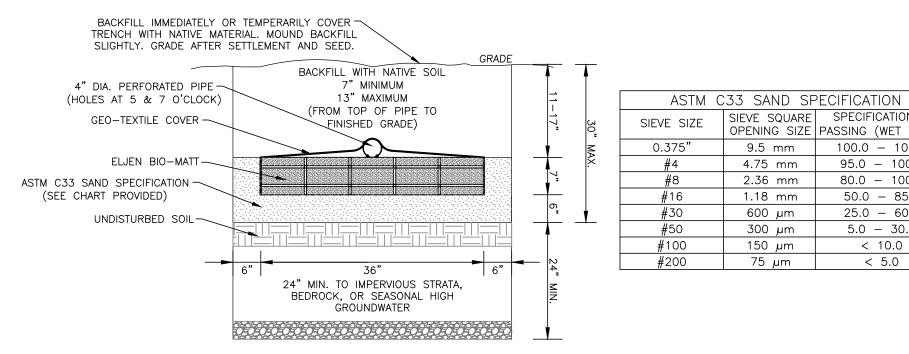



ELJEN IN-DRAIN CROSS SECTION DETAIL

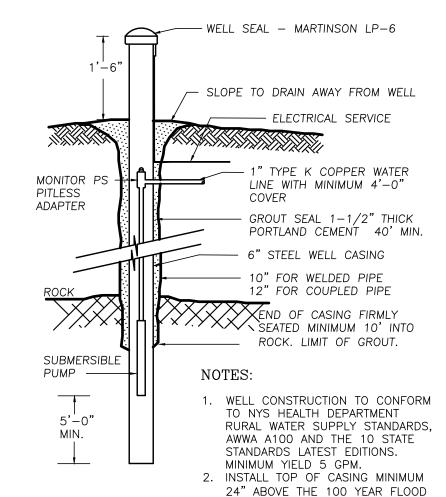

- WELL DETAIL 3. ANTICIPATED DEPTHS OF WELL CASINGS ARE 40' AND THROUGH
 - BEDROCK 4. DIAMETER OF DRILL HOLES TO BE
 - 10"-12" THROUGH OVERBURDEN, AND 6" THROUGH ROCK. 5. IF WATER IS ENCOUNTERED AT A DEPTH OF LESS THAN 50 FEET, THE MINIMUM CASING AND


REQUIREMENT SHALL BE 50 FEET.

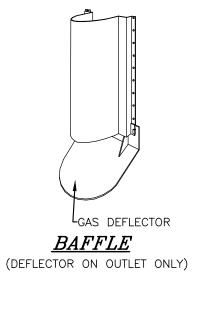

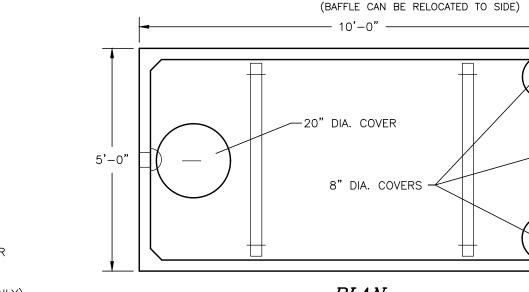

<u>PLAN</u>

(3)-4" DIA. KNOCKOUT INLETS -

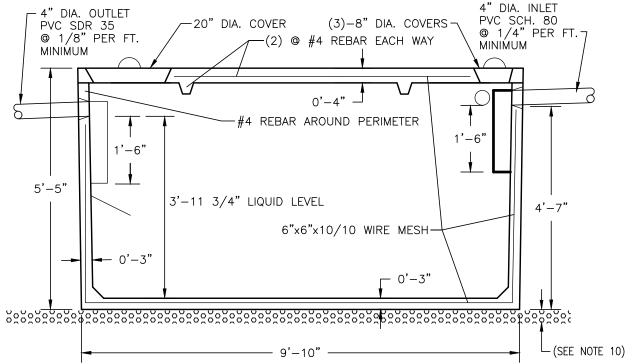


<u>SECTION</u>

- BUILDING SEWER TO BE SCHEDULE 80 PVC. SEPTIC TANK TO BE INSTALLED A MINIMUM OF TEN (10) FEET
- FROM BUILDING FOUNDATION. LOCATION STAKE TO BE SET IN GROUND DIRECTLY ABOVE THE
- INLET END COVER. SEPTIC TANK TO BE COVERED WITH EARTH TO A MINIMUM DEPTH OF 6" AND A MAXIMUM DEPTH OF 12".
- PRECAST CONCRETE TO REACH 4000 PSI STRENGTH @ 28 DAYS. TANK CONSTRUCTION JOINTS TO BE SEALED WITH BUTYL RUBBER BASE CEMENT.
- INLET INVERT TO BE 3" HIGHER THAN OUTLET INVERT.
 INLET AND OUTLET JOINTS TO BE SEALED WITH PORTLAND
- CEMENT GROUT. PRECAST CONCRETE SEPTIC TANK TO BE AS MANUFACTURED BY
- 10. 3" MINIMUM OF SAND, PEA GRAVEL OR TRENCH AGGREGATE FOR

WOODARD'S CONCRETE PRODUCTS, INC. MODEL ST1250 OR EQUAL.

11. SEPTIC TANKS SHOULD BE INSPECTED PERIODICALLY AND PUMPED EVERY 2-3 YEARS.

1,250 GALLON SEPTIC TANK DETAIL

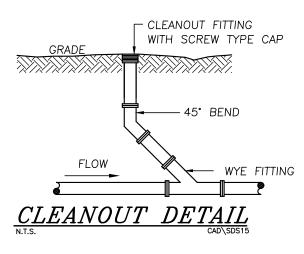

CONSTRUCTION NOTES:

SIEVE SQUARE SPECIFICATION %

9.5 mm

4.75 mm

2.36 mm

1.18 mm 600 µm

300 µm

150 µm

OPENING SIZE PASSING (WET SIEVE)

100.0 - 100.0

95.0 - 100.0

80.0 - 100.0


50.0 - 85.0

25.0 - 60.0

5.0 - 30.0

< 10.0

- 1. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO CONTACT ALL UTILITY COMPANIES FOR UTILITY MARK OUTS. CONTRACTOR IS TO ASSUME FULL RESPONSIBILITY FOR MAINTAINING CONTINUOUS UTILITY SERVICE AND
- REPAIRS TO UTILITIES IN THE EVENT OF DAMAGE. 2. PRIOR TO ANY CONSTRUCTION, CONTRACTOR IS TO FIELD LOCATE AND VERIFY ALL EXISTING UTILITIES LOCATIONS, ELEVATIONS, INVERTS, ETC. AND NOTIFY THE DESIGN ENGINEER OF ANY DISCREPANCIES ON THIS
- 3. CONTRACTOR IS TO COORDINATE NEW UTILITY SERVICES WITH ALL UTILITY COMPANIES.
- 4. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL TRAFFIC MAINTENANCE.
 5. CONTRACTOR IS TO BE RESPONSIBLE FOR ALL PROJECT SAFETY REQUIREMENTS.

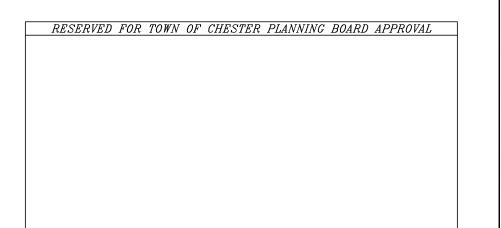

01-21-20 SWPPP PREP & FUSCO COMMENTS DATED 12-3-19 CJP 11-6-19 SITE PLAN PREPARATION DATE JJP INITIALS Date DESCRIPTION REVISIONS MAP CHECK DATE: INITIALED BY: PIETRZAK & PFAU ENGINEERING & SURVEYING, PLLC 262 GREENWICH AVENUE, SUITE A 2 HAMILTON AVENUE GOSHEN, NEW YORK 10924 | MONTICELLO, NEW YORK 12701 (845) 294-0606 (845) 796-4646

CJP

05-07-20 AS PER FUSCO COMMENTS DATED 5-01-20 03-17-20 AS PER FUSCO COMMENTS DATED 1-27-20

MICHAEL F. CREEGAN P.L.S. JOSEPH J. PFAU P.E. LICENSE NO. 068945 LICENSE NO. 050323 VINCENT A. PIETRZAK P.E., P.L.S., LEED®AP P.E. LICENSE NO. 076936, P.L.S. LICENSE NO. 050075 N.J.P.L.S. LICE ISE NO. 35396

ELKAY DRIVE COMMERCIAL BUILDING SITE PLAN

TOWN OF CHESTER COUNTY OF ORANGE, NEW YORK

SANITARY & WATER SUPPLY DETAILS SECTION 6 BLOCK 1 LOT 69.4

UNAUTHORIZED ALTERATION OR ADDITION TO A PLAN BEARING A LICENSED LAND SURVEYOR'S OR PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW. O.C.H.D. SHEET NO. | D.E.C. SHEET NO. | DRAWING NUMBER <u>N/A</u> OF _____ | <u>N/A</u> OF ____ CAD REFERENCE | PROJECT NUMBER / SCALE X AS SHOWN 19139 ENG BASE 19139.01