


Plan View

NOT TO SCALE

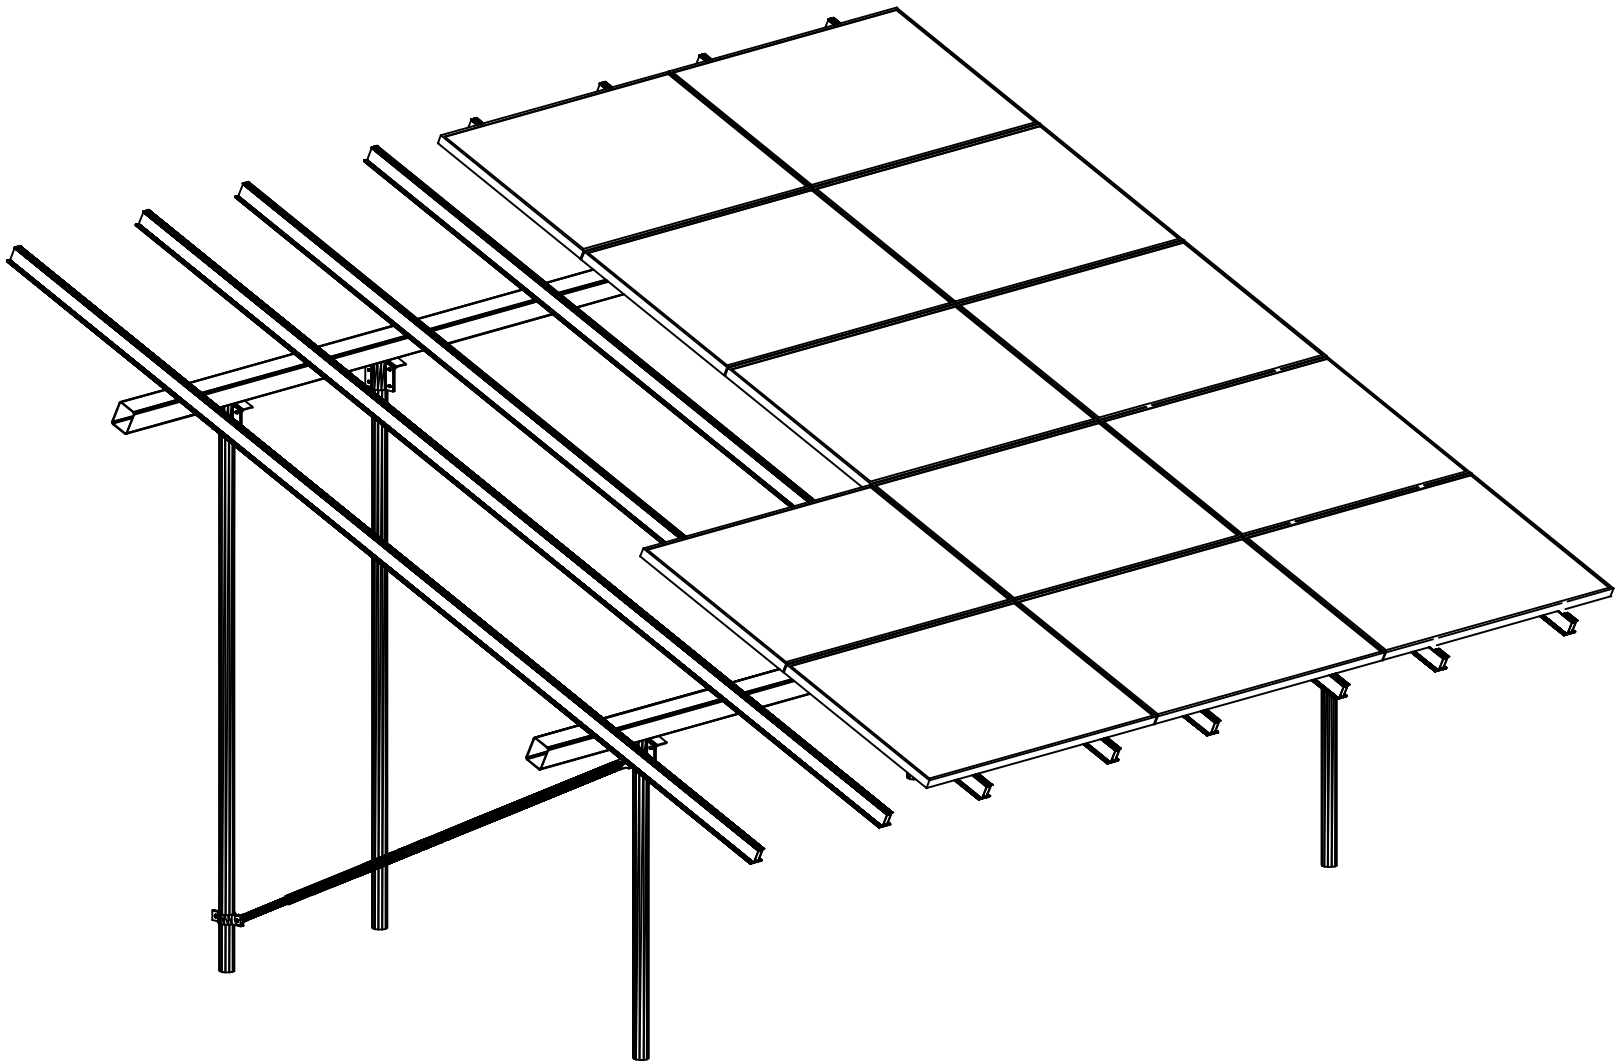

Site Design Conditions

Basic Wind Speed: (Risk Category II)	111 MPH	Max. Leg Axial Bearing:	3,040 lbs.
Basic Wind Speed: (Risk Category I)	103 MPH	Max. Leg Uplift:	1,885 lbs.
Exposure Category:	C	Max. Lateral Resistance:	1,390 lbs.
Ground Snow Load:	30 PSF	Top Rail Max. Loading:	89.2 plf
Flat Roof Snow Load: (if applicable)	N/A	Helical Pile Depth:	60" Min
Site Contour:	<5 Degree Slope	Lateral Resistance Plate Size:	Not Req'd

All design work has been performed in accordance with the 2020 Building Code of New York State effective May 12, 2020, including but not limited to, the 2018 International Building Code with state directed modifications.

Net design pressures were calculated in accordance with ASCE 7-16 section 27.4.3, "Open Buildings with Monoslope, Pitched, or Troughed Roofs". All load cases were evaluated in determining the limiting design conditions. The data table above provides the results for the limiting load case. Maximum leg reaction forces represent the highest load condition seen by any leg in the structure. All legs in the structure are designed to meet the maximum load conditions.

5Lx4C Sub-Array Design Conditions

Front Leg Height:	34½"	Array Tilt Angle:	25 Degrees
Rear Leg Height:	82"	Overall Array East-West Dim:	20'-6"
North-South Pile Spacing:	102"	Number of Modules/Sub-Array:	15
West Span Pile Spacing:	N/A	Number of Future Modules/Sub-Array:	5
East Span Pile Spacing:	N/A	Number of Sub-Arrays:	1
Quantity Center Spans:	1	Module Columns/Sub-Array:	4
Center Span Pile Spacing:	11'-9"	Number of Module Rows:	5
East & West Overhang:	4'-0"	Module Orientation:	Landscape
Overall Beam Length:	19'-9"	Module Column Spacing	¼"
Front Edge Ground Clearance:	24"	Module Row Spacing	¼"
Horizontal Rail Material:	5"x4"x¼" HSS	Module Model:	SPR-X22-360-E-AC
Top Rail Material:	SF Rails	Module Size:	41.18" x 61.34"
Qty Rails per Panel:	2	Individual Module Rating:	360 watt
Top Rail Length:	212"	Sub Array Power Rating:	5.4 kw
Top Rail Center Span:	112½"	Total Power Rating:	5.4 kw
Top Rail Overhangs:	49¾"		

1 Additional North Column is to be installed per field direction. The Column is to support equipment mounting needs. It is not required for North beam support.

Sheet 1 of 3


Date	Revision	Drawn By:	Review By:
04/27/2021	Original	MM	JD

New York State Solar Farm

Project:  
Dysinger Residence  
46 Odyssey Dr  
Chester, NY 10918


Solar Foundations USA

1142 River Road, New Castle, DE 19720 Ph: (855) 738-7200 Fax: (866) 644-5665

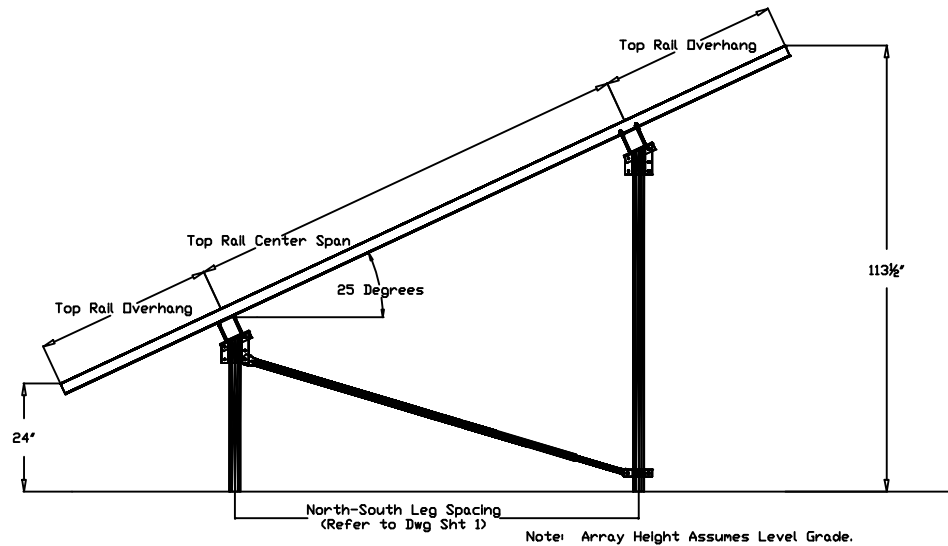


**SIDE ELEVATION DETAIL**

NOT TO SCALE

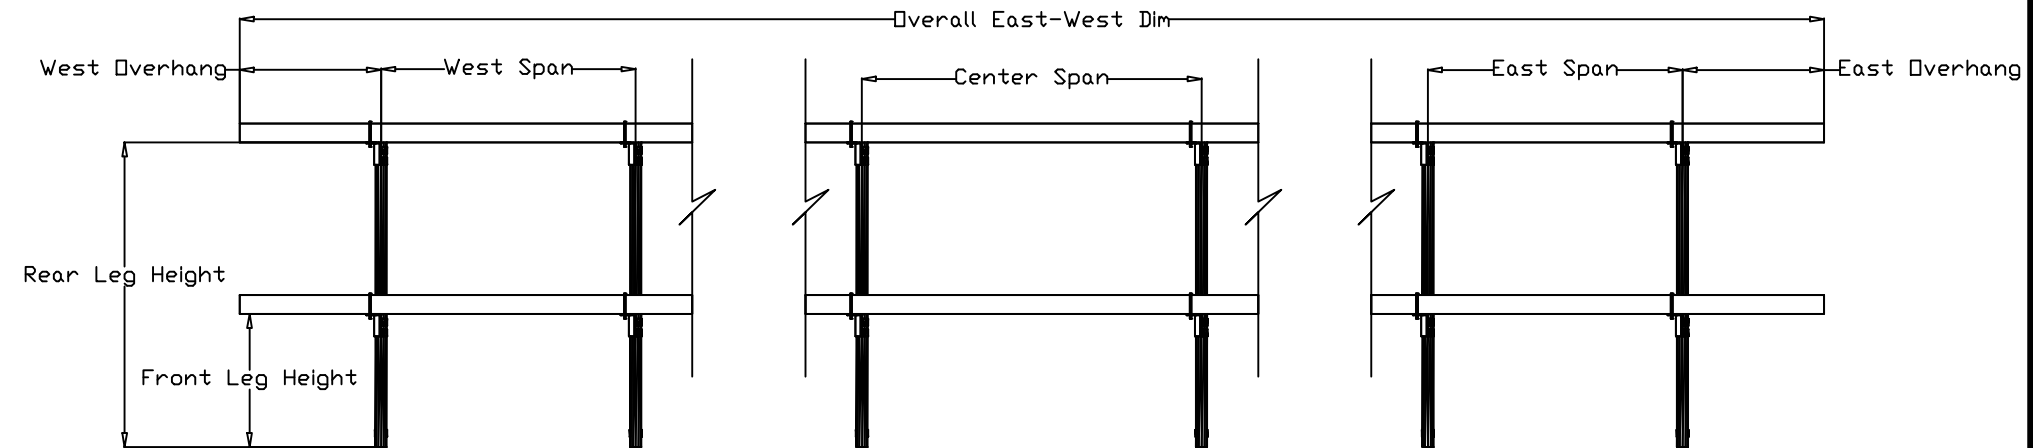


Refer to Dwg Sheet 1 for East-West Pile Spans and Front and Rear Leg Heights.  
**POST SPACING ELEVATION DETAIL**

NOT TO SCALE

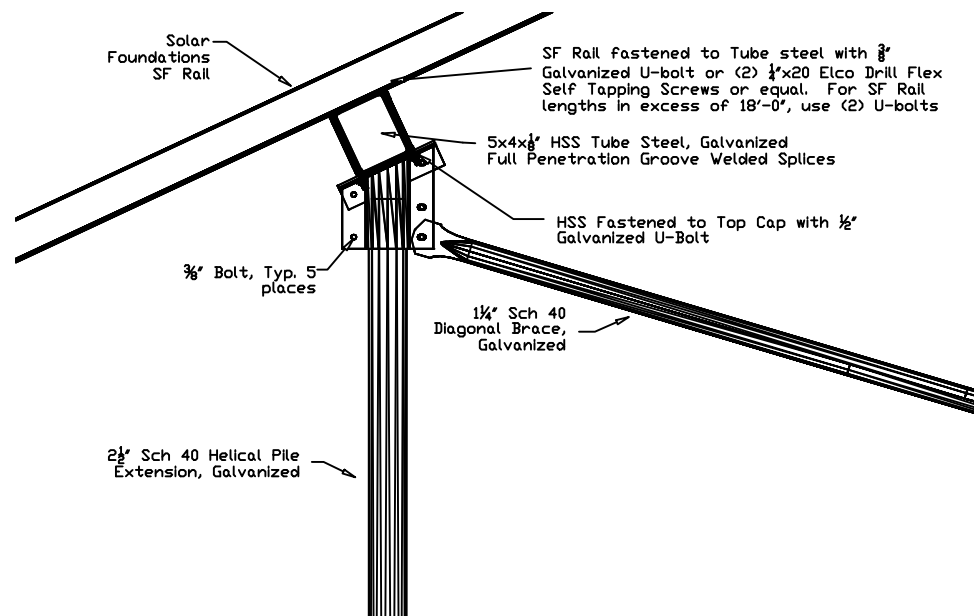


**LOWER CAP DETAIL**

NOT TO SCALE

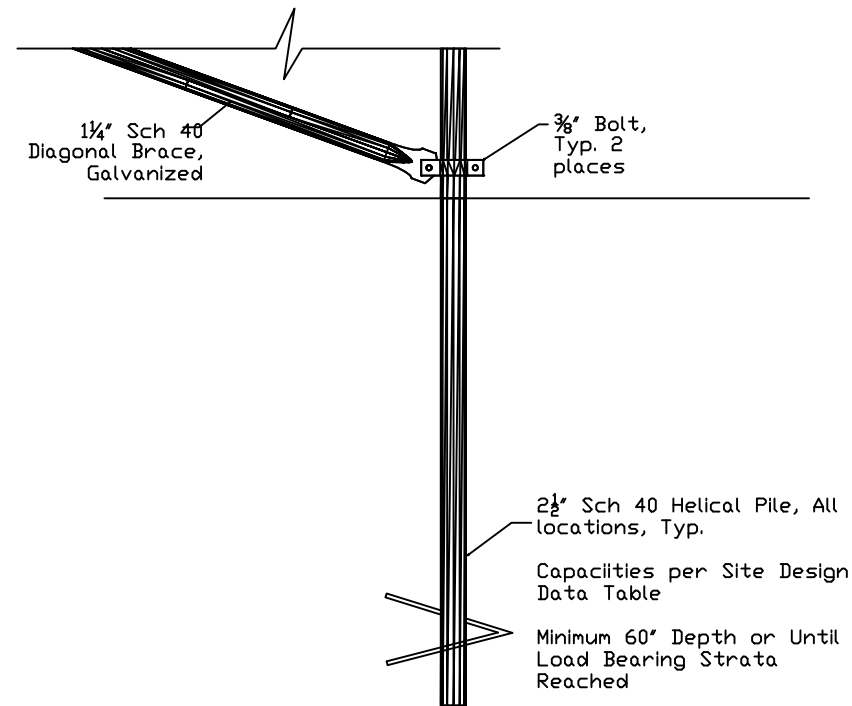

**HELICAL PILE DETAIL**

NOT TO SCALE

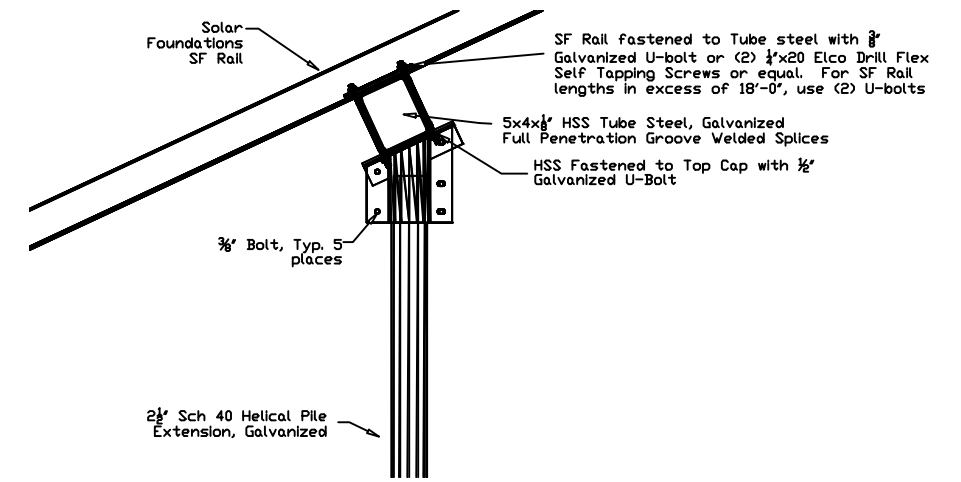

**UPPER CAP DETAIL**

NOT TO SCALE

Sheet 2 of 3


**New York State Solar Farm**

Date	Revision	Drawn By:	Review By:
04/27/2021	Original	MM	JD

Project:  
**Dysinger Residence**  
46 Odyssey Dr  
Chester, NY 10918

**Solar Foundations USA**

1142 River Road, New Castle, DE 19720 Ph: (855) 738-7200 Fax: (866) 644-5665

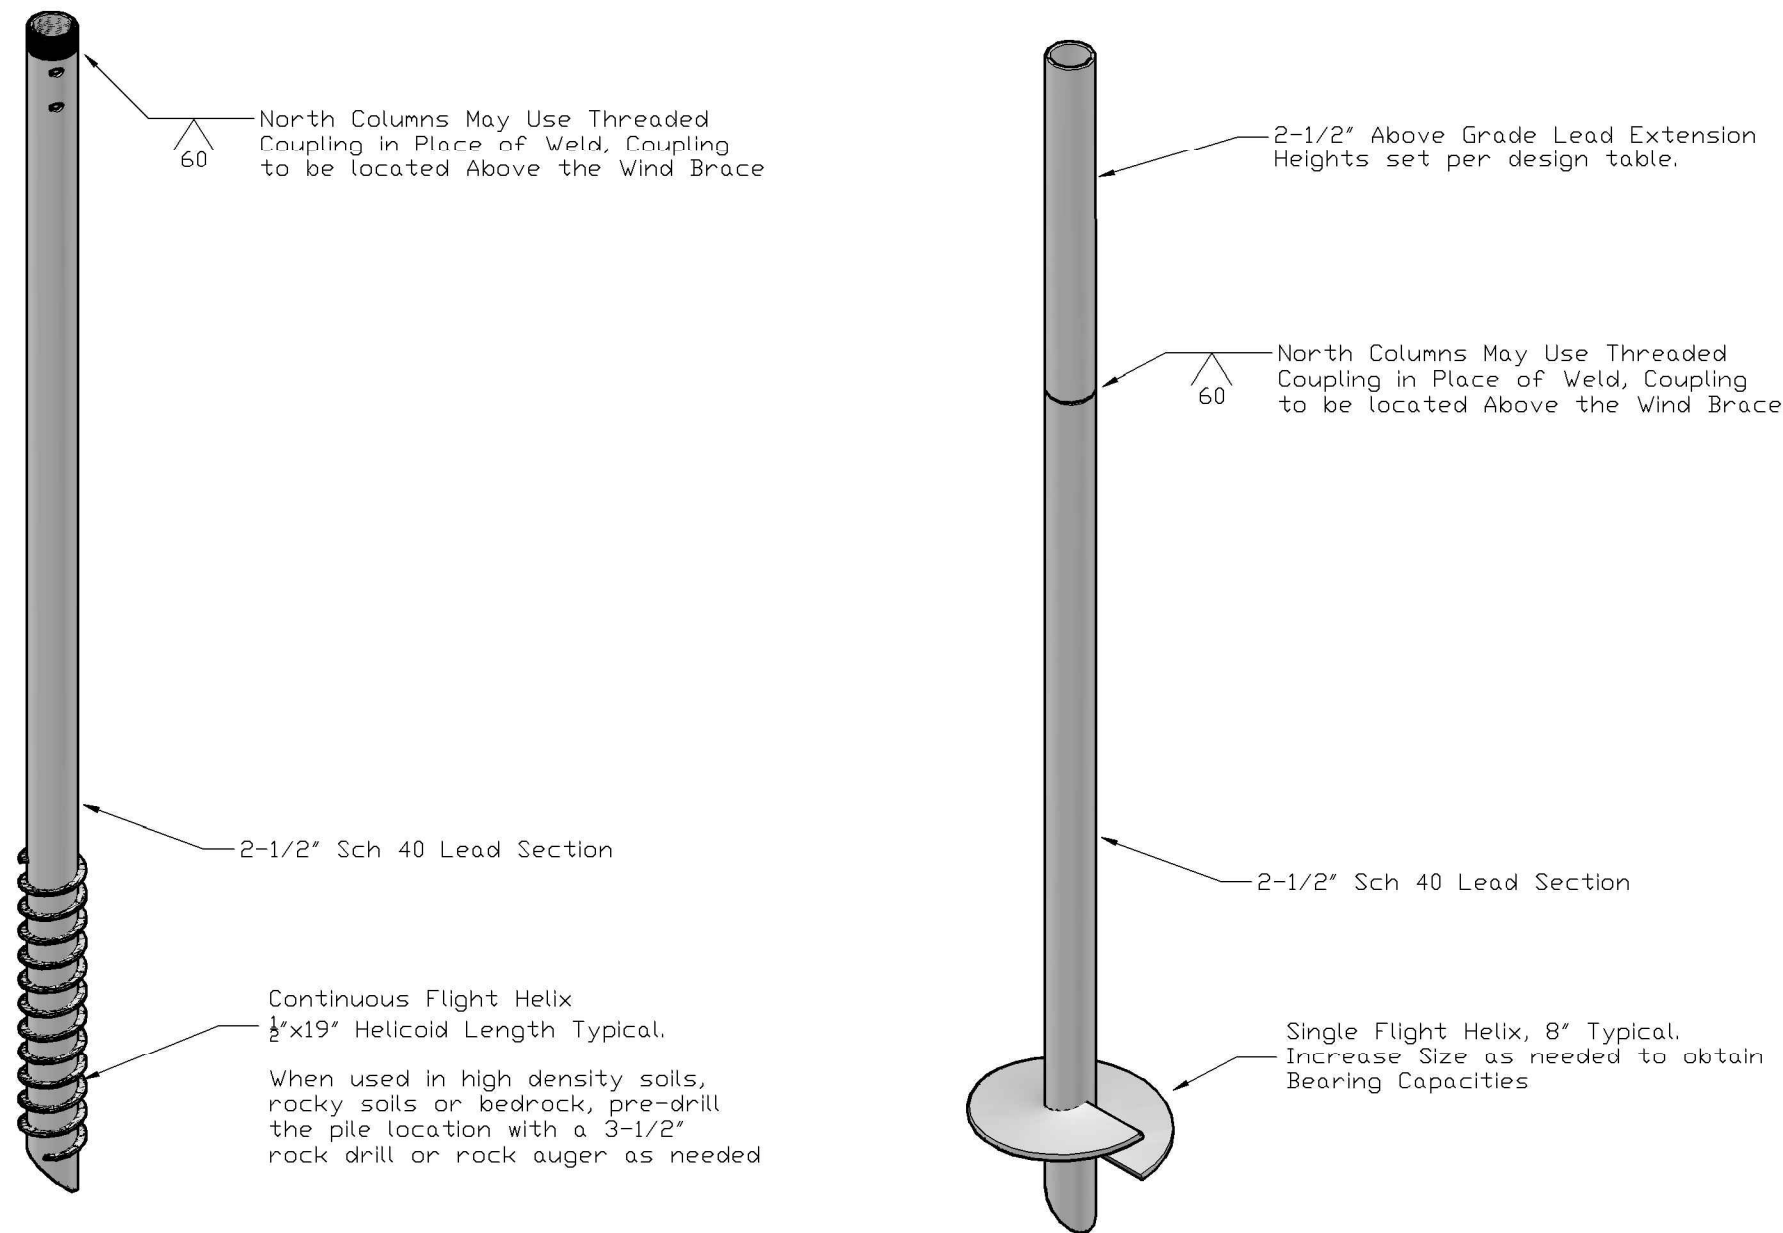

**Helical Pile Detail**

NOT TO SCALE

**Specification Requirements:**

The following material specification requirements pertain to the fabrication of the Solar Foundations USA ground mount solar support structure as indicated on these drawings.

1. Solar Foundation aluminum rails shall conform to ASTM B221.
2. Structural steel tubing shall be ASTM A500 High Yield (60 ksi).
3. Steel pipe for piles shall conform to ASTM A500 Grade C.
4. Steel pile extensions shall be ASTM A53 Grade B.
5. Steel pipe for diagonal bracing shall be ASTM A53 Grade A.
6. Fabricated steel plate for column cap assemblies, bracing clamps, etc. shall be ASTM A36 or A1011.
7. Steel bolts for cap fasteners shall conform to SAE J429 Grade 5. All other bolts shall conform to SAE J429 Grade 5 or better.
8. Steel U-bolts shall conform to ASTM 1018.
9. USS flat steel washers shall conform to ASTM F844 and nuts for steel connections shall conform to ASTM A563 Grade A.
10. All field welding shall conform to AWS D1.1/D1.1M -Structural Welding Code requirements.
11. All steel shall be hot-dip galvanized per ASTM A123 or A153 after all fabrication has been completed.

**Installation Requirements:**

1. The minimum average installation torque required to obtain the required indicated capacities and the minimum installation depth shown on the plans shall be satisfied prior to termination of the installation. The installation torque shall be an average of the installation torques indicated during the last 1 foot of installation.
2. The torsional strength rating of the torque anchor shall not be exceeded during the installation. If the torsional strength limit of the anchor has been reached, but the anchor has not reached the target depth, perform the following:
  - 2.1. If the torsional strength limit is achieved prior to reaching the target depth, the installation may be acceptable if reviewed and approved by the engineer and/or owner.
  - 2.2. The installer may remove the torque anchor and install a new one with smaller diameter helical plate.
  - 2.3. If using a continuous flight pile, pre-drill the pile location with a 3-1/2" rock auger or 3-5/8" rock drill as needed.
3. If the target depth is achieved, but the torsional requirement has not been met the installer may do one of the following:
  - 3.1. Install the torque anchor deeper to obtain the required capacity
  - 3.2. Remove the torque anchor and install a new one with a larger diameter helical plate or one with multiple helical plates.
  - 3.3. Reduce the load capacity on the individual torque anchor by providing additional torque anchors at a reduced spacing.

Sheet 3 of 3

Date	Revision	Drawn By:	Review By:
04/27/2021	Original	MM	JD

**New York State Solar Farm**

Project:  
**Dysinger Residence**  
46 Odyssey Dr  
Chester, NY 10918

**Solar Foundations USA**

1142 River Road, New Castle, DE 19720 Ph: (855) 738-7200 Fax: (866) 644-5665