



REFERENCE: GOOGLE EARTH (IMAGERY DATE 9/18/2019)

SITE PLAN FOR TRADE TRANS CORPORATION 173 BLACK MEADOW ROAD SECTION 6 BLOCK 1 LOT 106 TOWN OF CHESTER ORANGE COUNTY, N.Y.

T-1	TITLE SHEET
S-1	EXISTING CONDITIONS
S-2	SITE PLAN
S-3	GRADING & UTILITIES PLAN
S-4	STORMWATER MANAGEMENT PLAN
S-5	STORMWATER DETAILS
S-6	LIGHTING PLAN
S-7	LANDSCAPING PLAN
S-8	EROSION & SEDIMENTATION CONTROL PLAN
S-9	EROSION & SEDIMENTATION CONTROL PLAN DETAILS
S-10	SEPTIC DETAILS
S-11	CONSTRUCTION DETAILS

DRAWING LIST

TOWN OF CHESTER PLANNING BOARD APPROVAL

PROJECT INFORMATION

KIPS BAY HOLDINGS OF WARWICK, LLC. OWNER OF RECORD

IP (INDUSTRIAL PARK DISTRICT) **ZONING**

TAX ID SECTION 06 BLOCK 01

TOTAL LOT AREA 418,612 S.F. / 9.61± ACRES


THIS PLAN CONTAINS 12 SHEETS. THIS SHEET SHALL NOT BE CONSIDERED VALID UNLESS ACCOMPANIED BY THE REMAINING SHEETS.


	DWN BY	REV	DESCRIPTION	DATE	APPROVED	Λ
	DO	0	FOR APPROVAL	08/10/22		0, 1/1/1
	DO	1	REVISED PER TOWN COMMENT	11/23/22		11 Sula
UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING	DO	2	REVISED PER TOWN COMMENT	02/15/23		Allon 1. Tu
THE SEAL OF A LICENSED ENGINEER OR LAND SURVEYOR IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK						
STATE EDUCATION LAW.						
COPIES OF THIS DOCUMENT WITHOUT A FACSIMILE OF THE						,
SIGNATURE AND AN ORIGINAL EMBOSSED SEAL OR ORIGINAL STAMP OF THE PROFESSIONAL ENGINEER OR LAND SURVEYOR						JOHN D. FULLER
SHALL NOT BE CONSIDERED VALID COPIES.						REG. NO. 077703


JOHN D. FULLER, P.E., P.C. PORT JERVIS, NY 12771


SITE PLAN FOR TRADE TRANS CORPORATION 173 BLACK MEADOW ROAD SECTION 6 BLOCK 1 LOT 106 TOWN OF CHESTER, NY


TITLE SHEET T-1 SCALE AS NOTED JOB NO. 1713.003

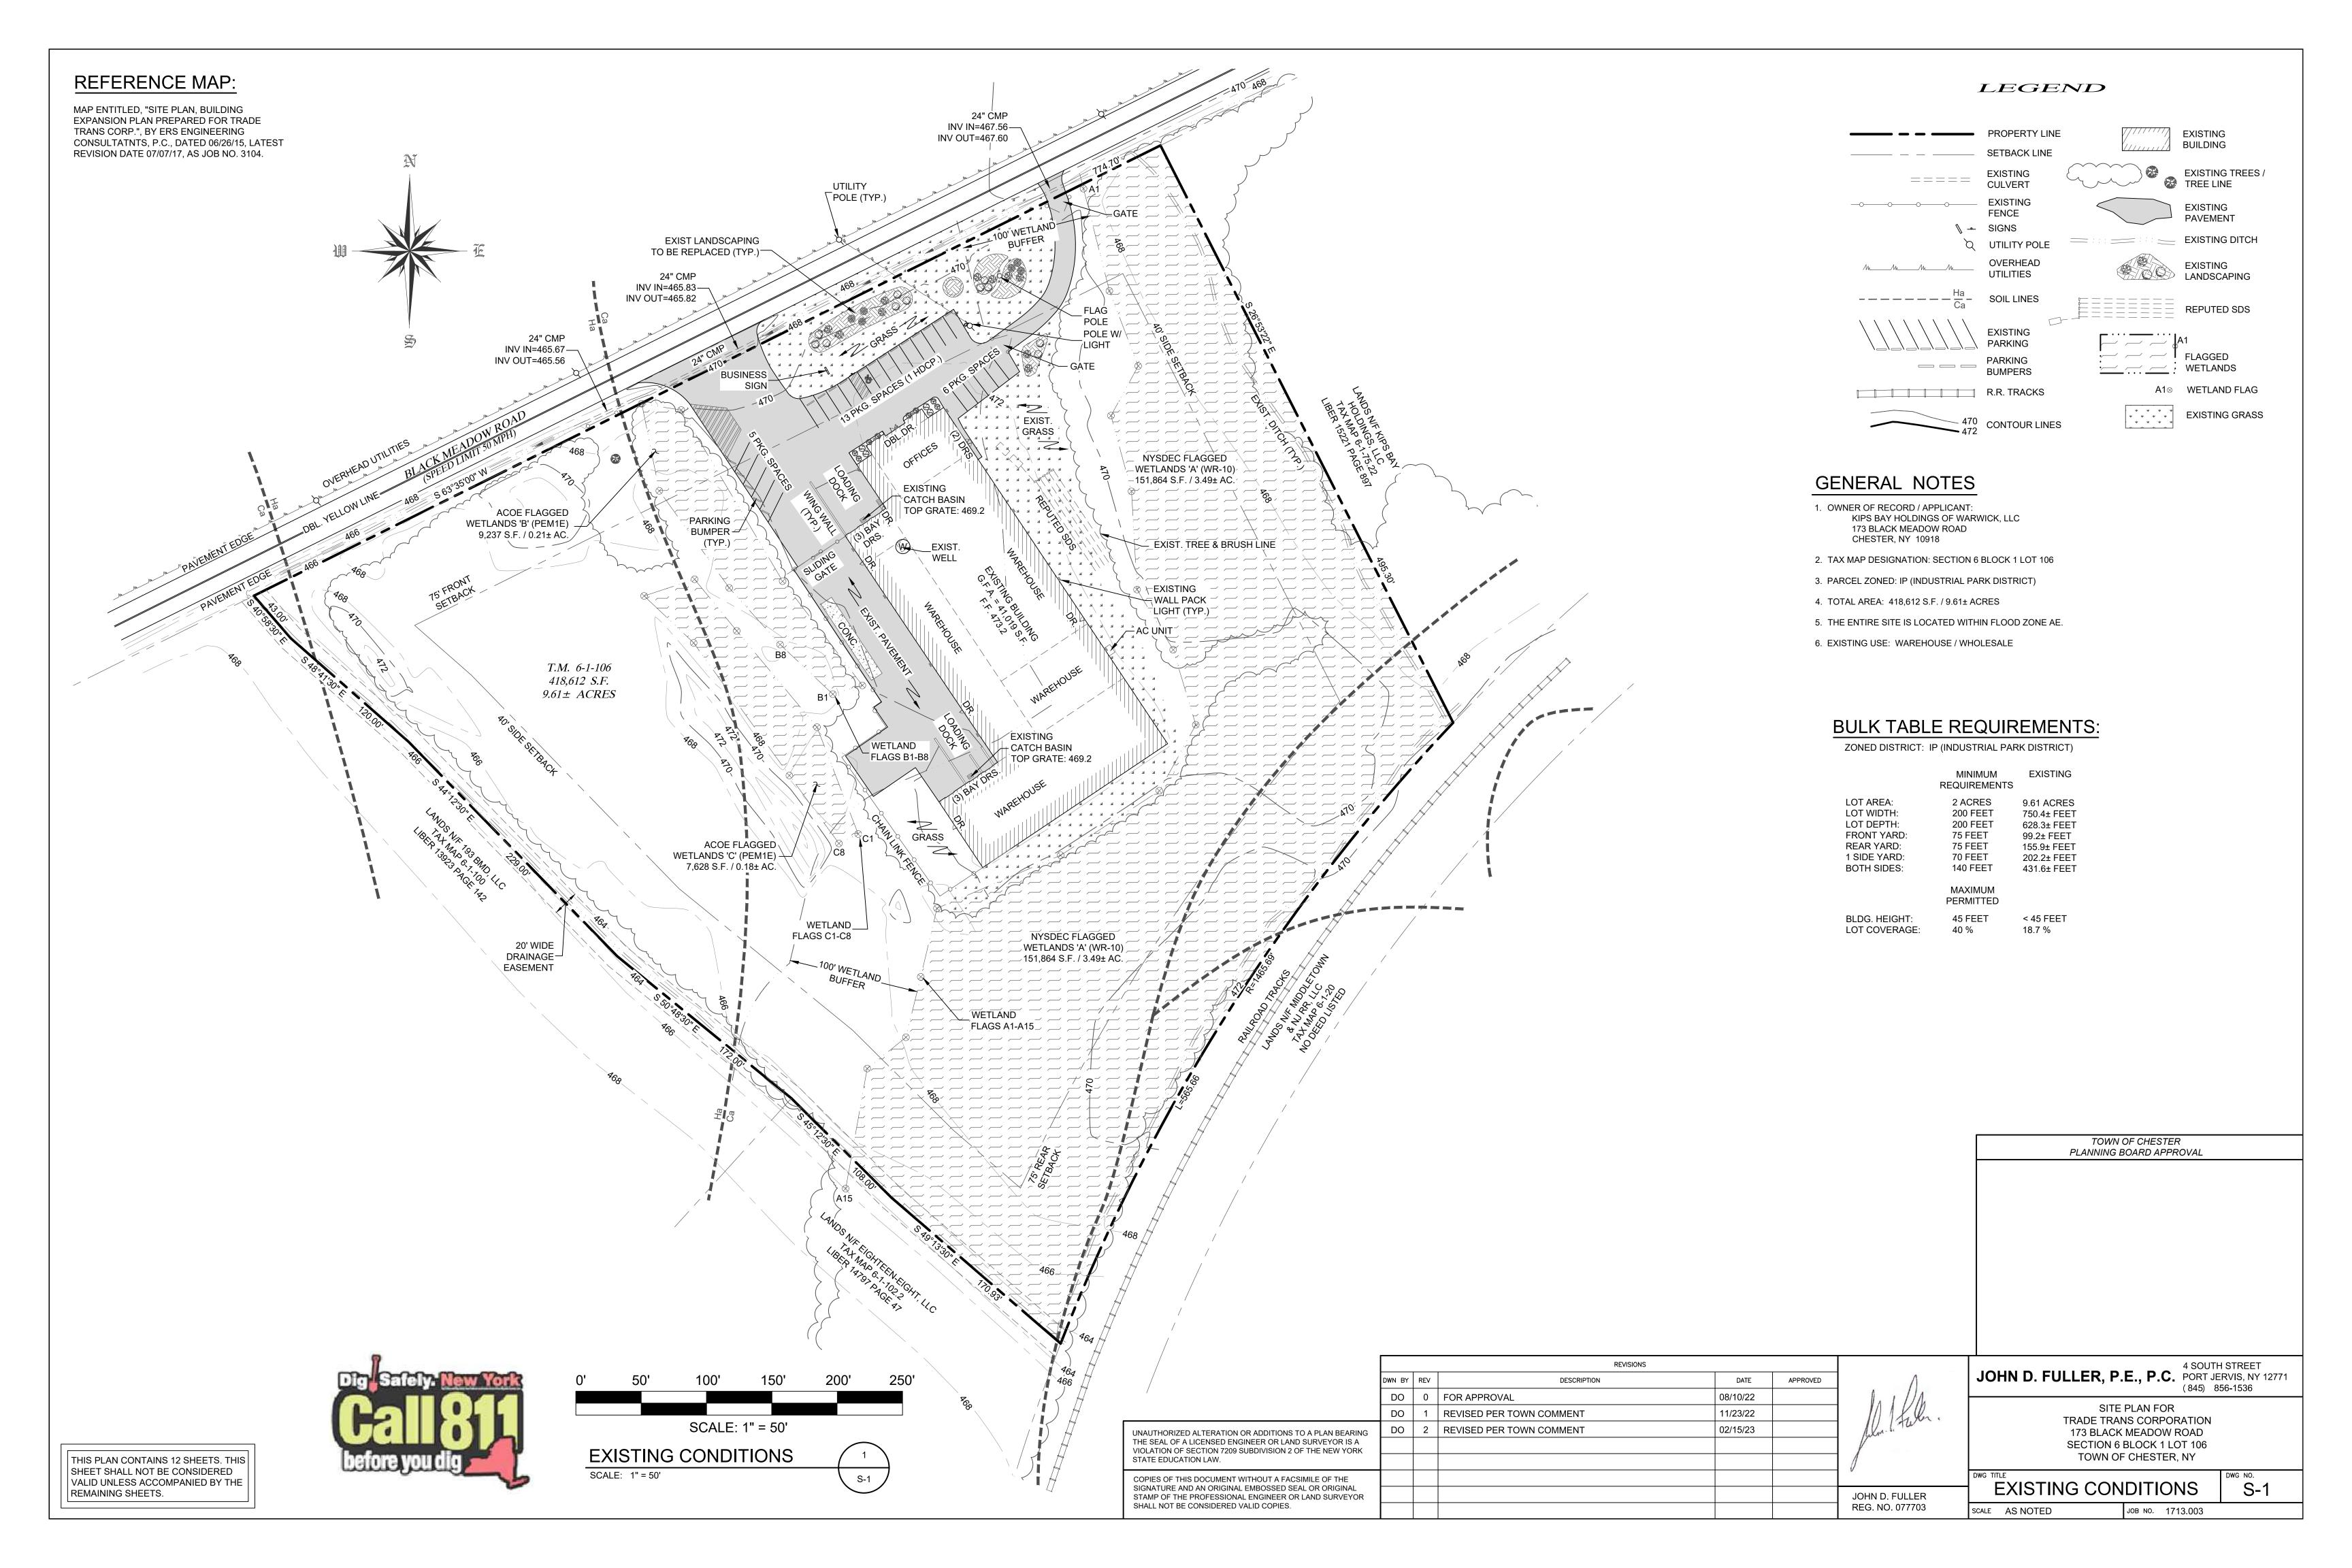


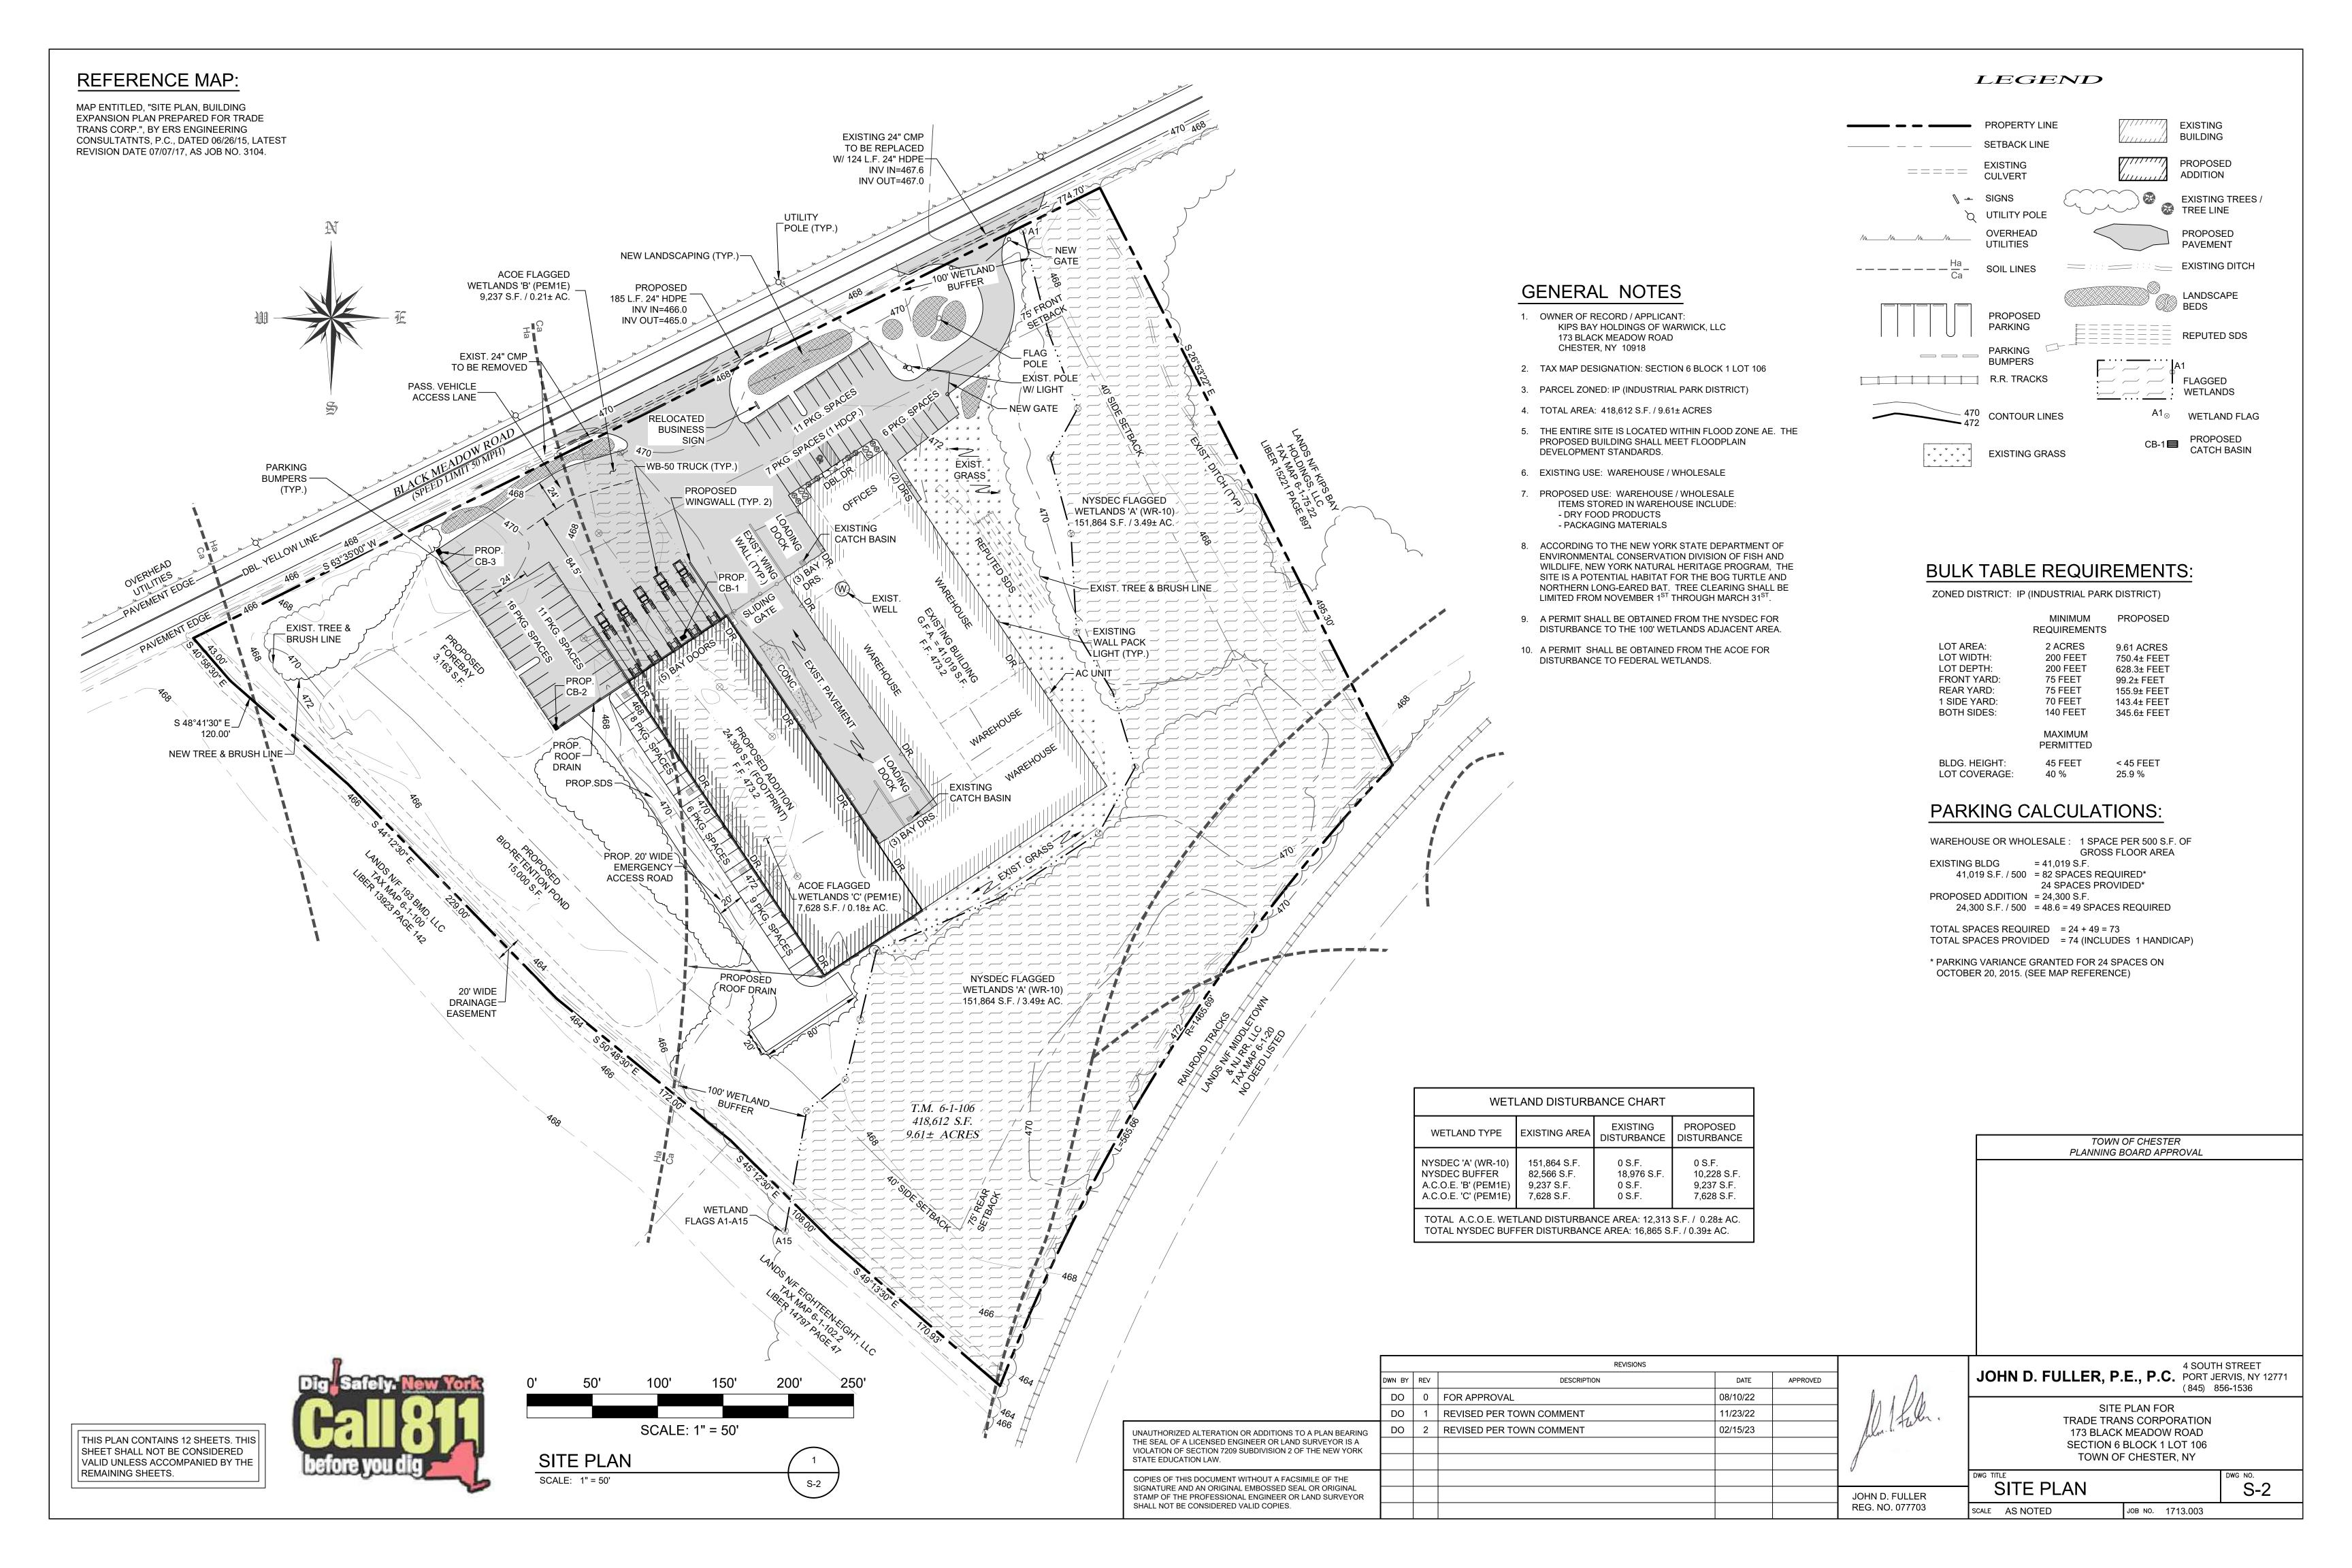


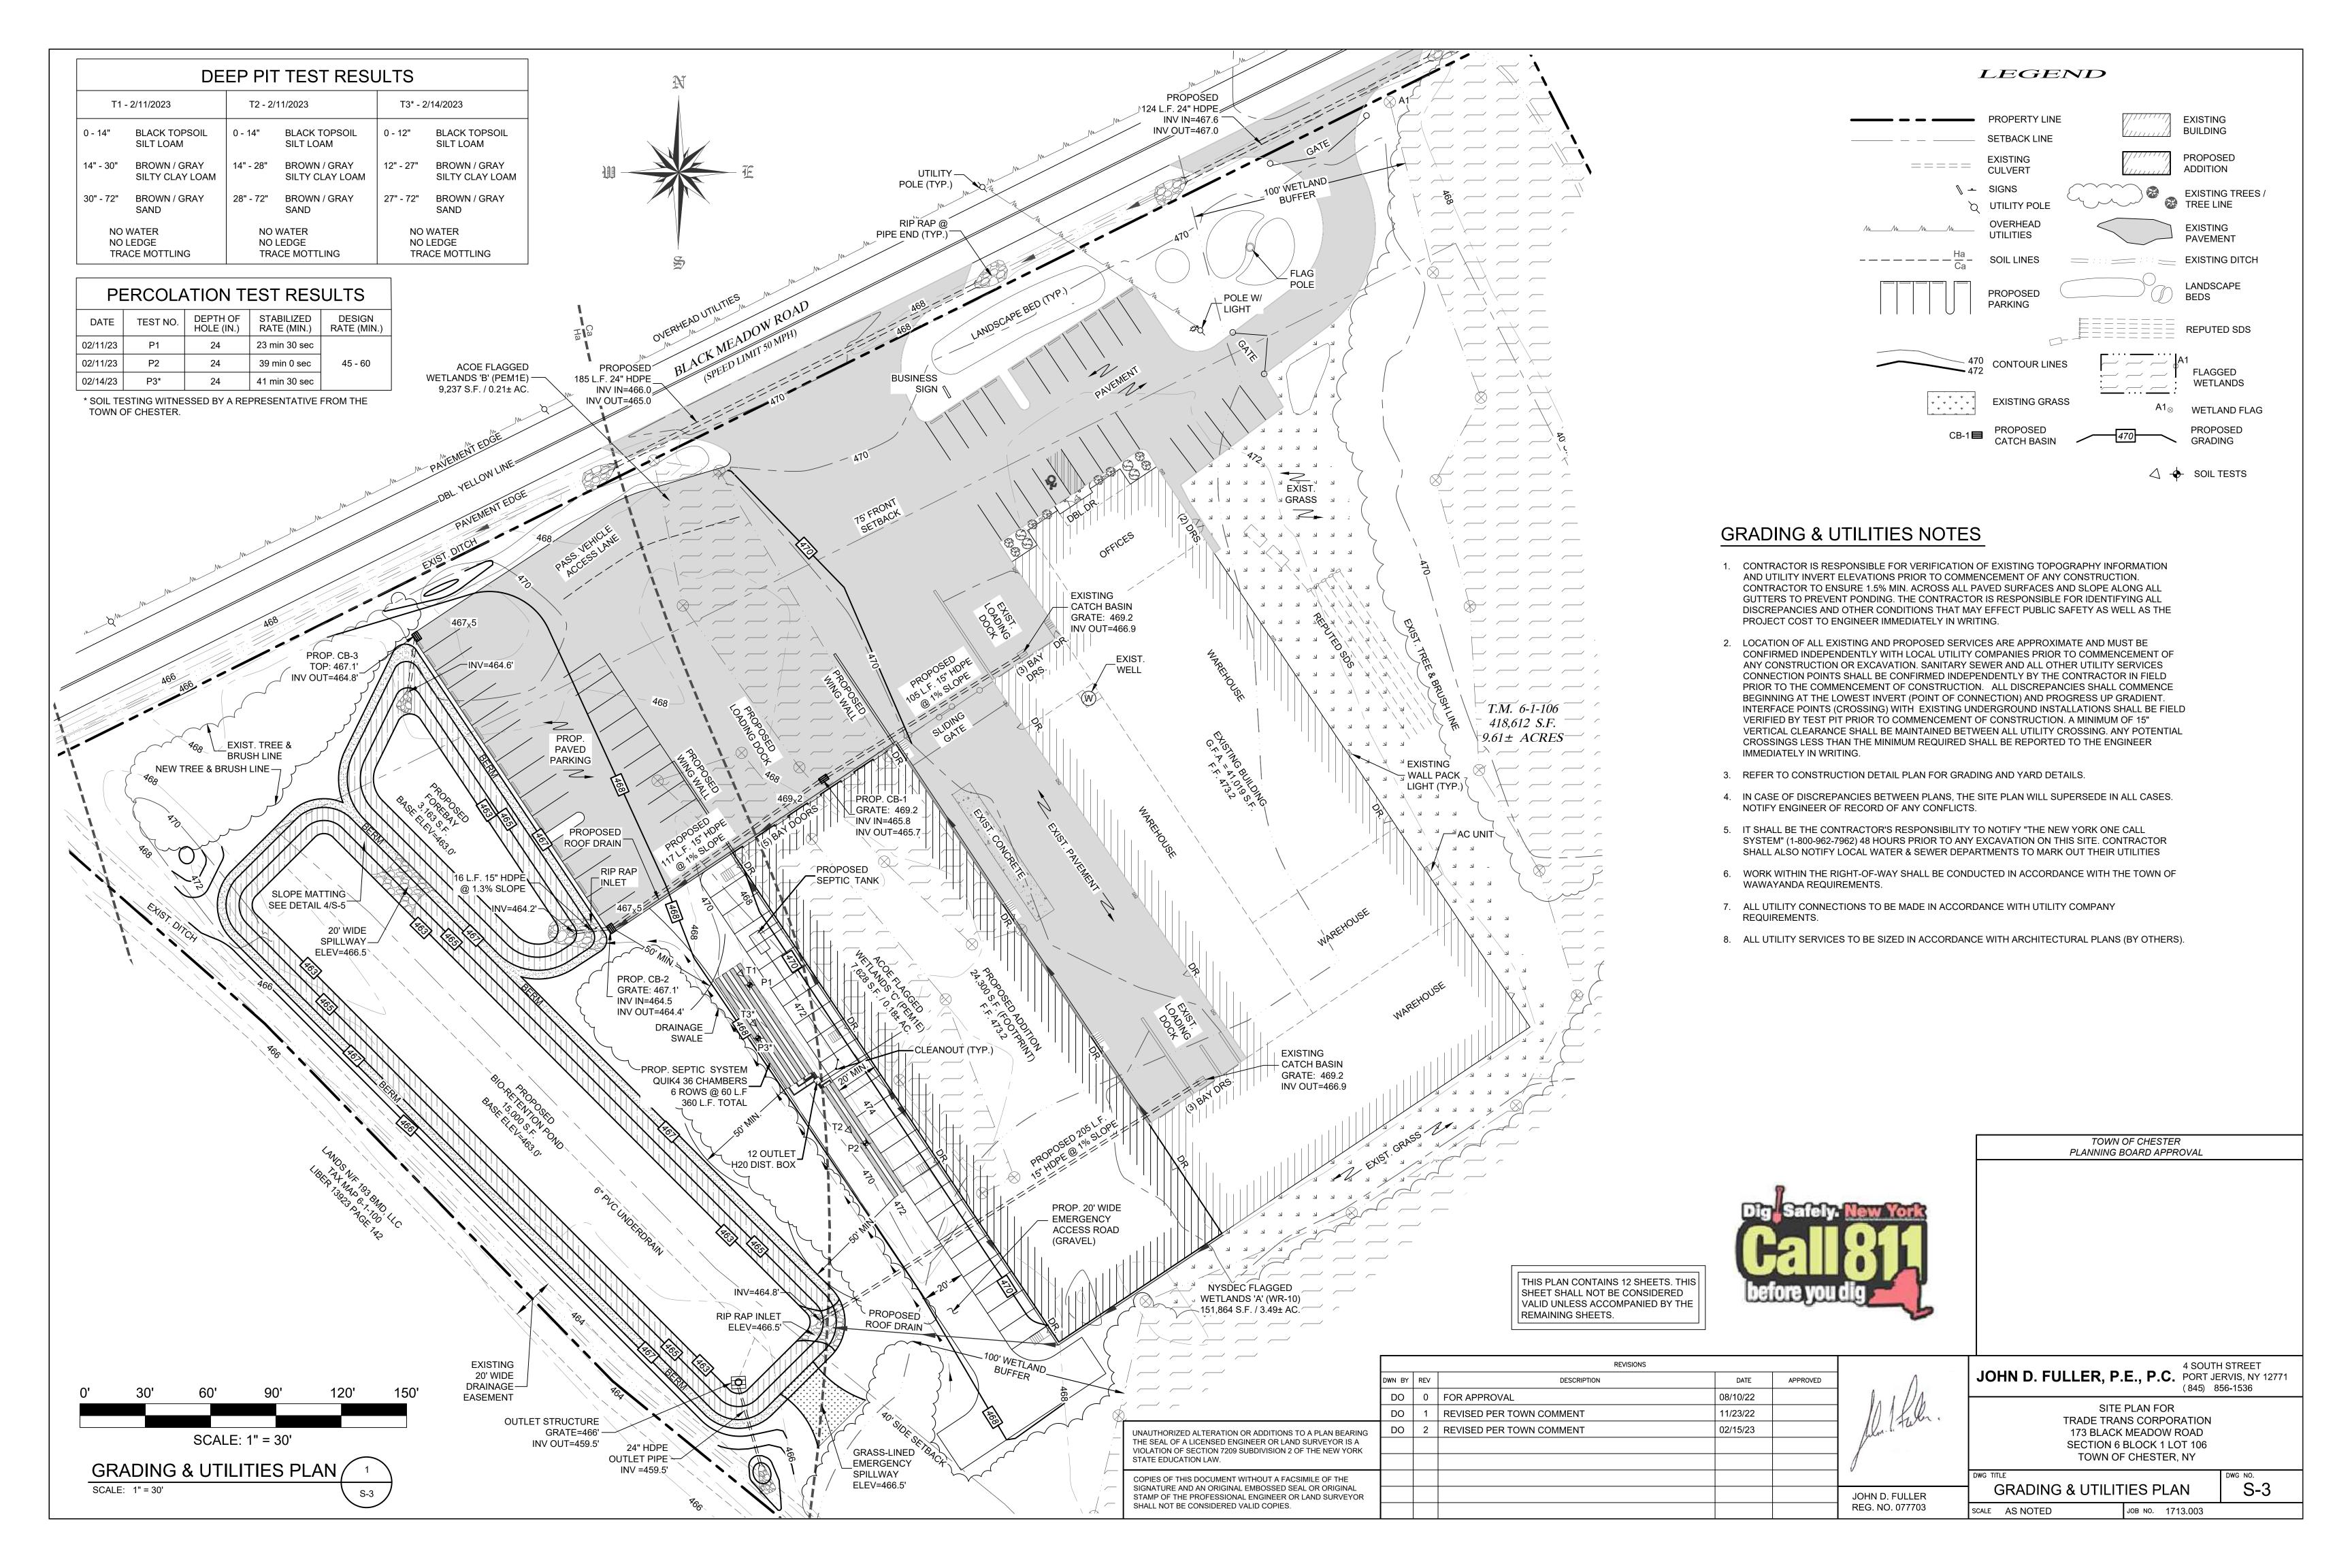


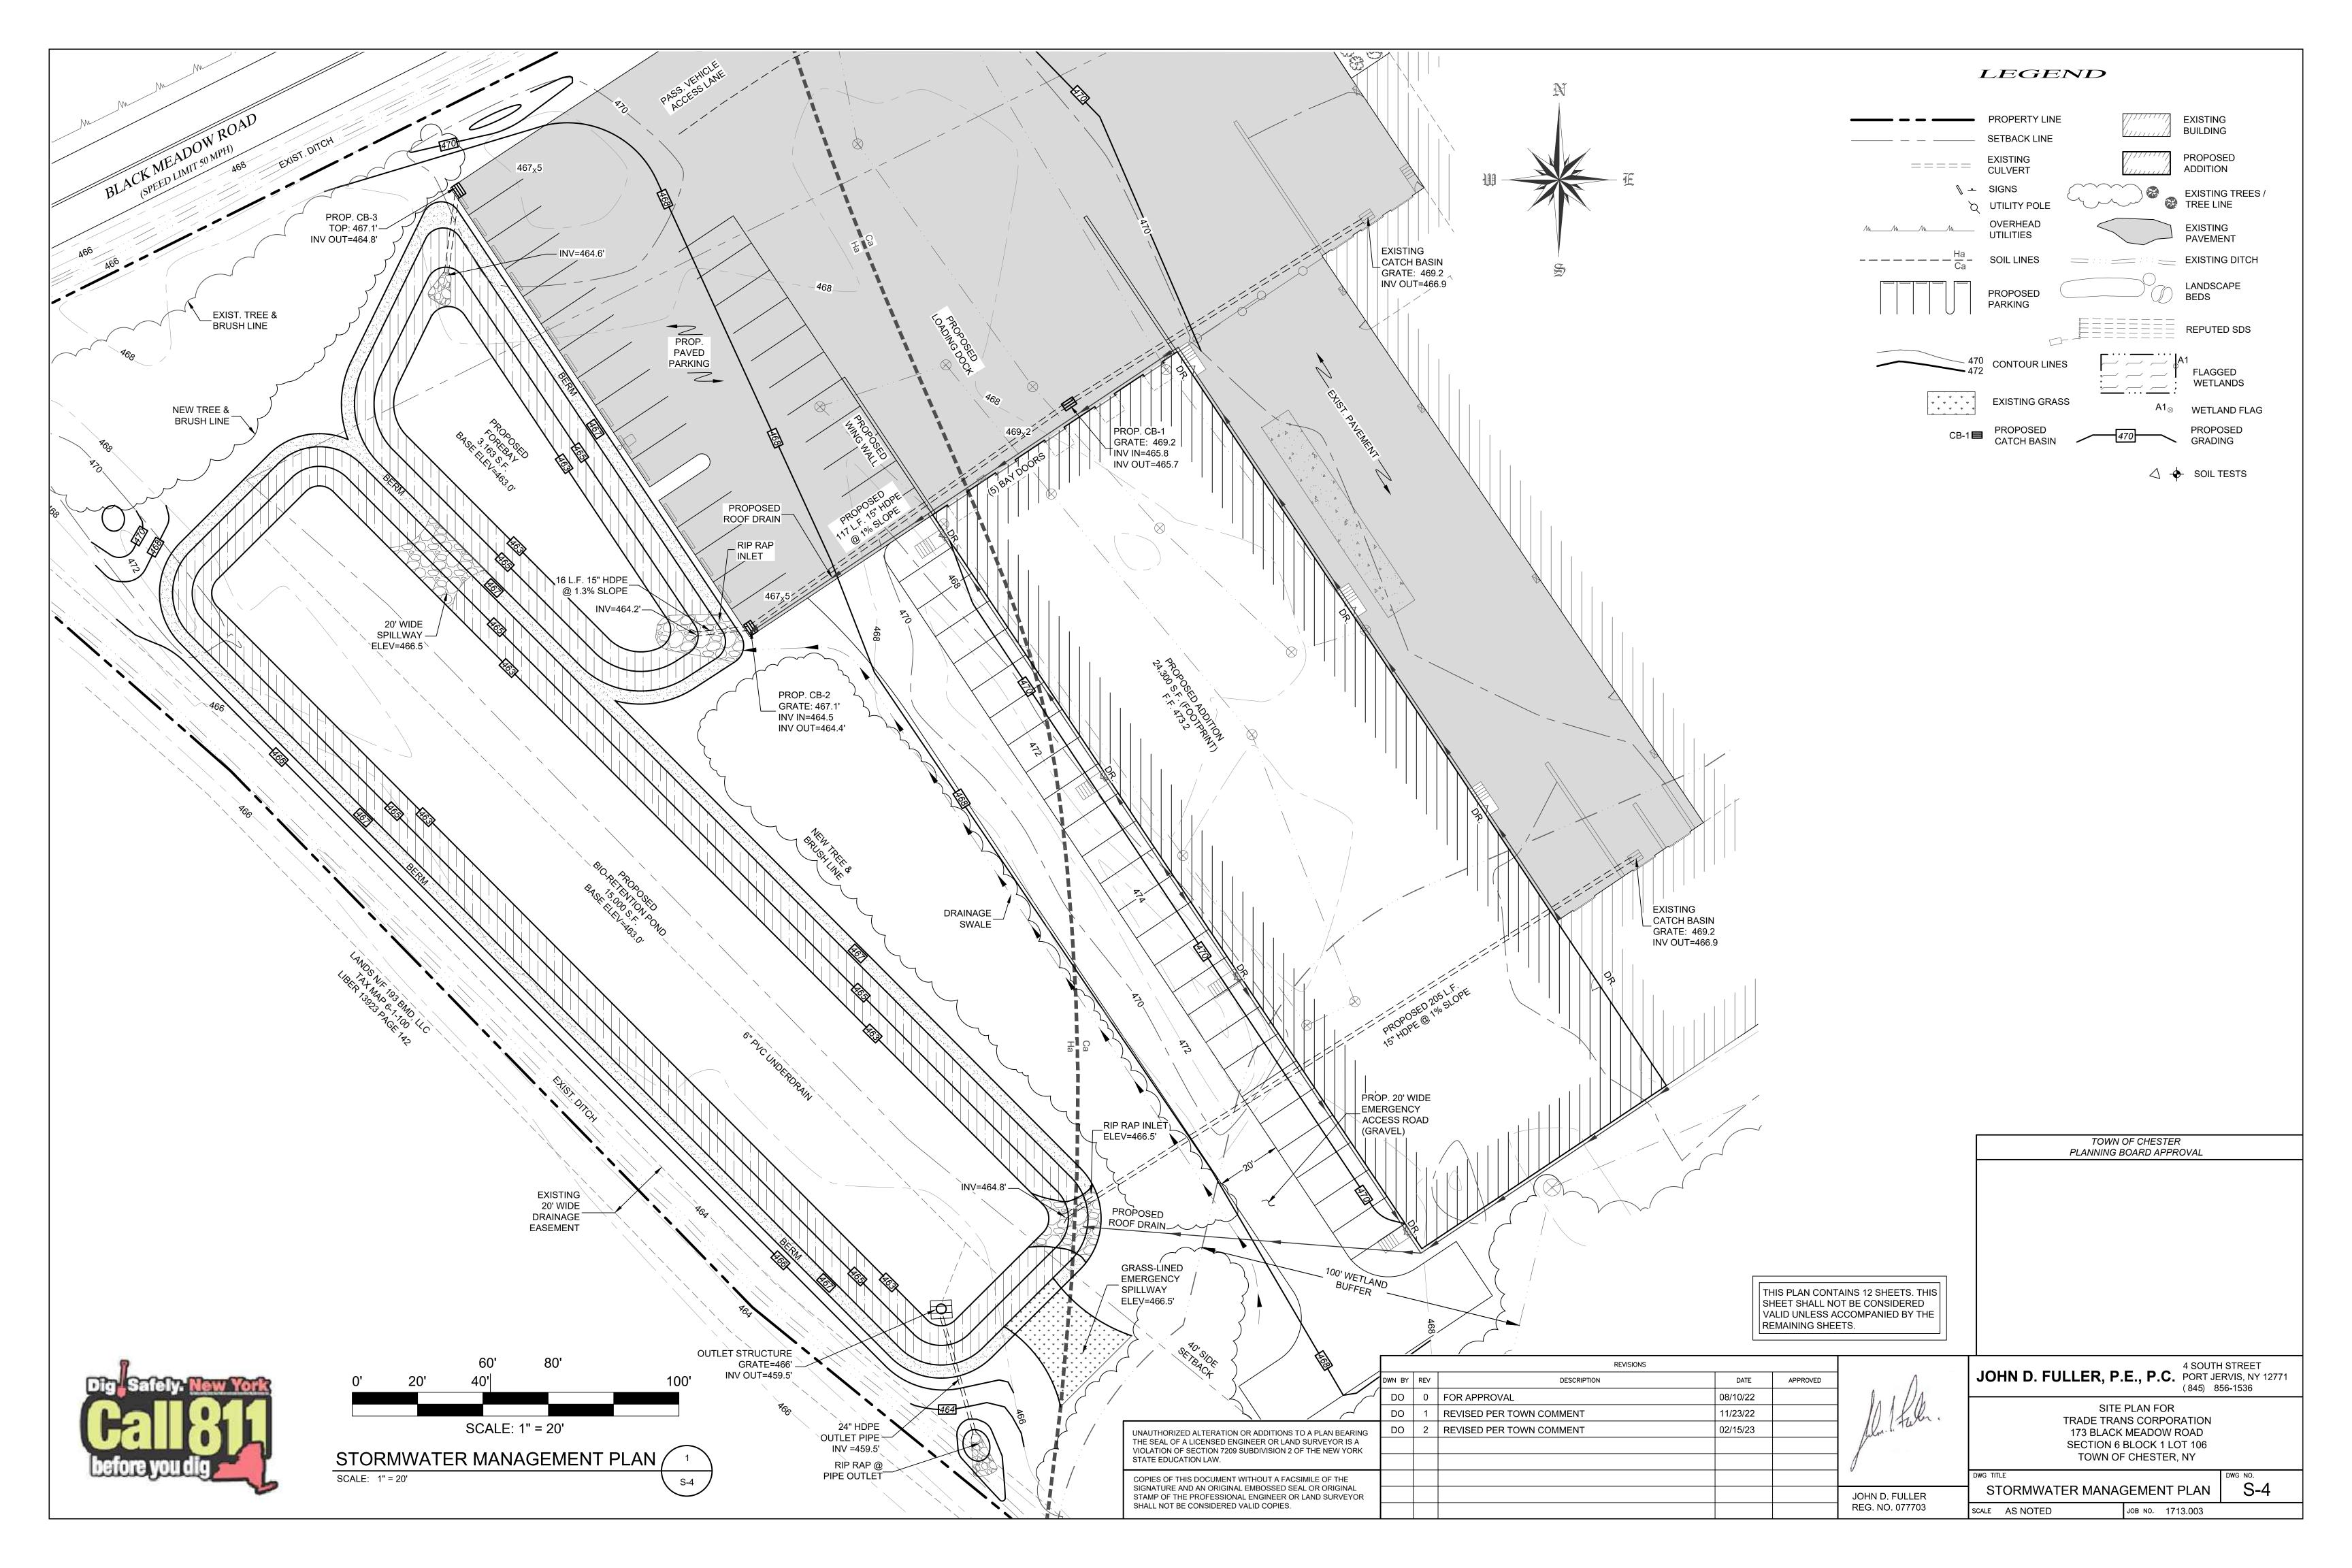


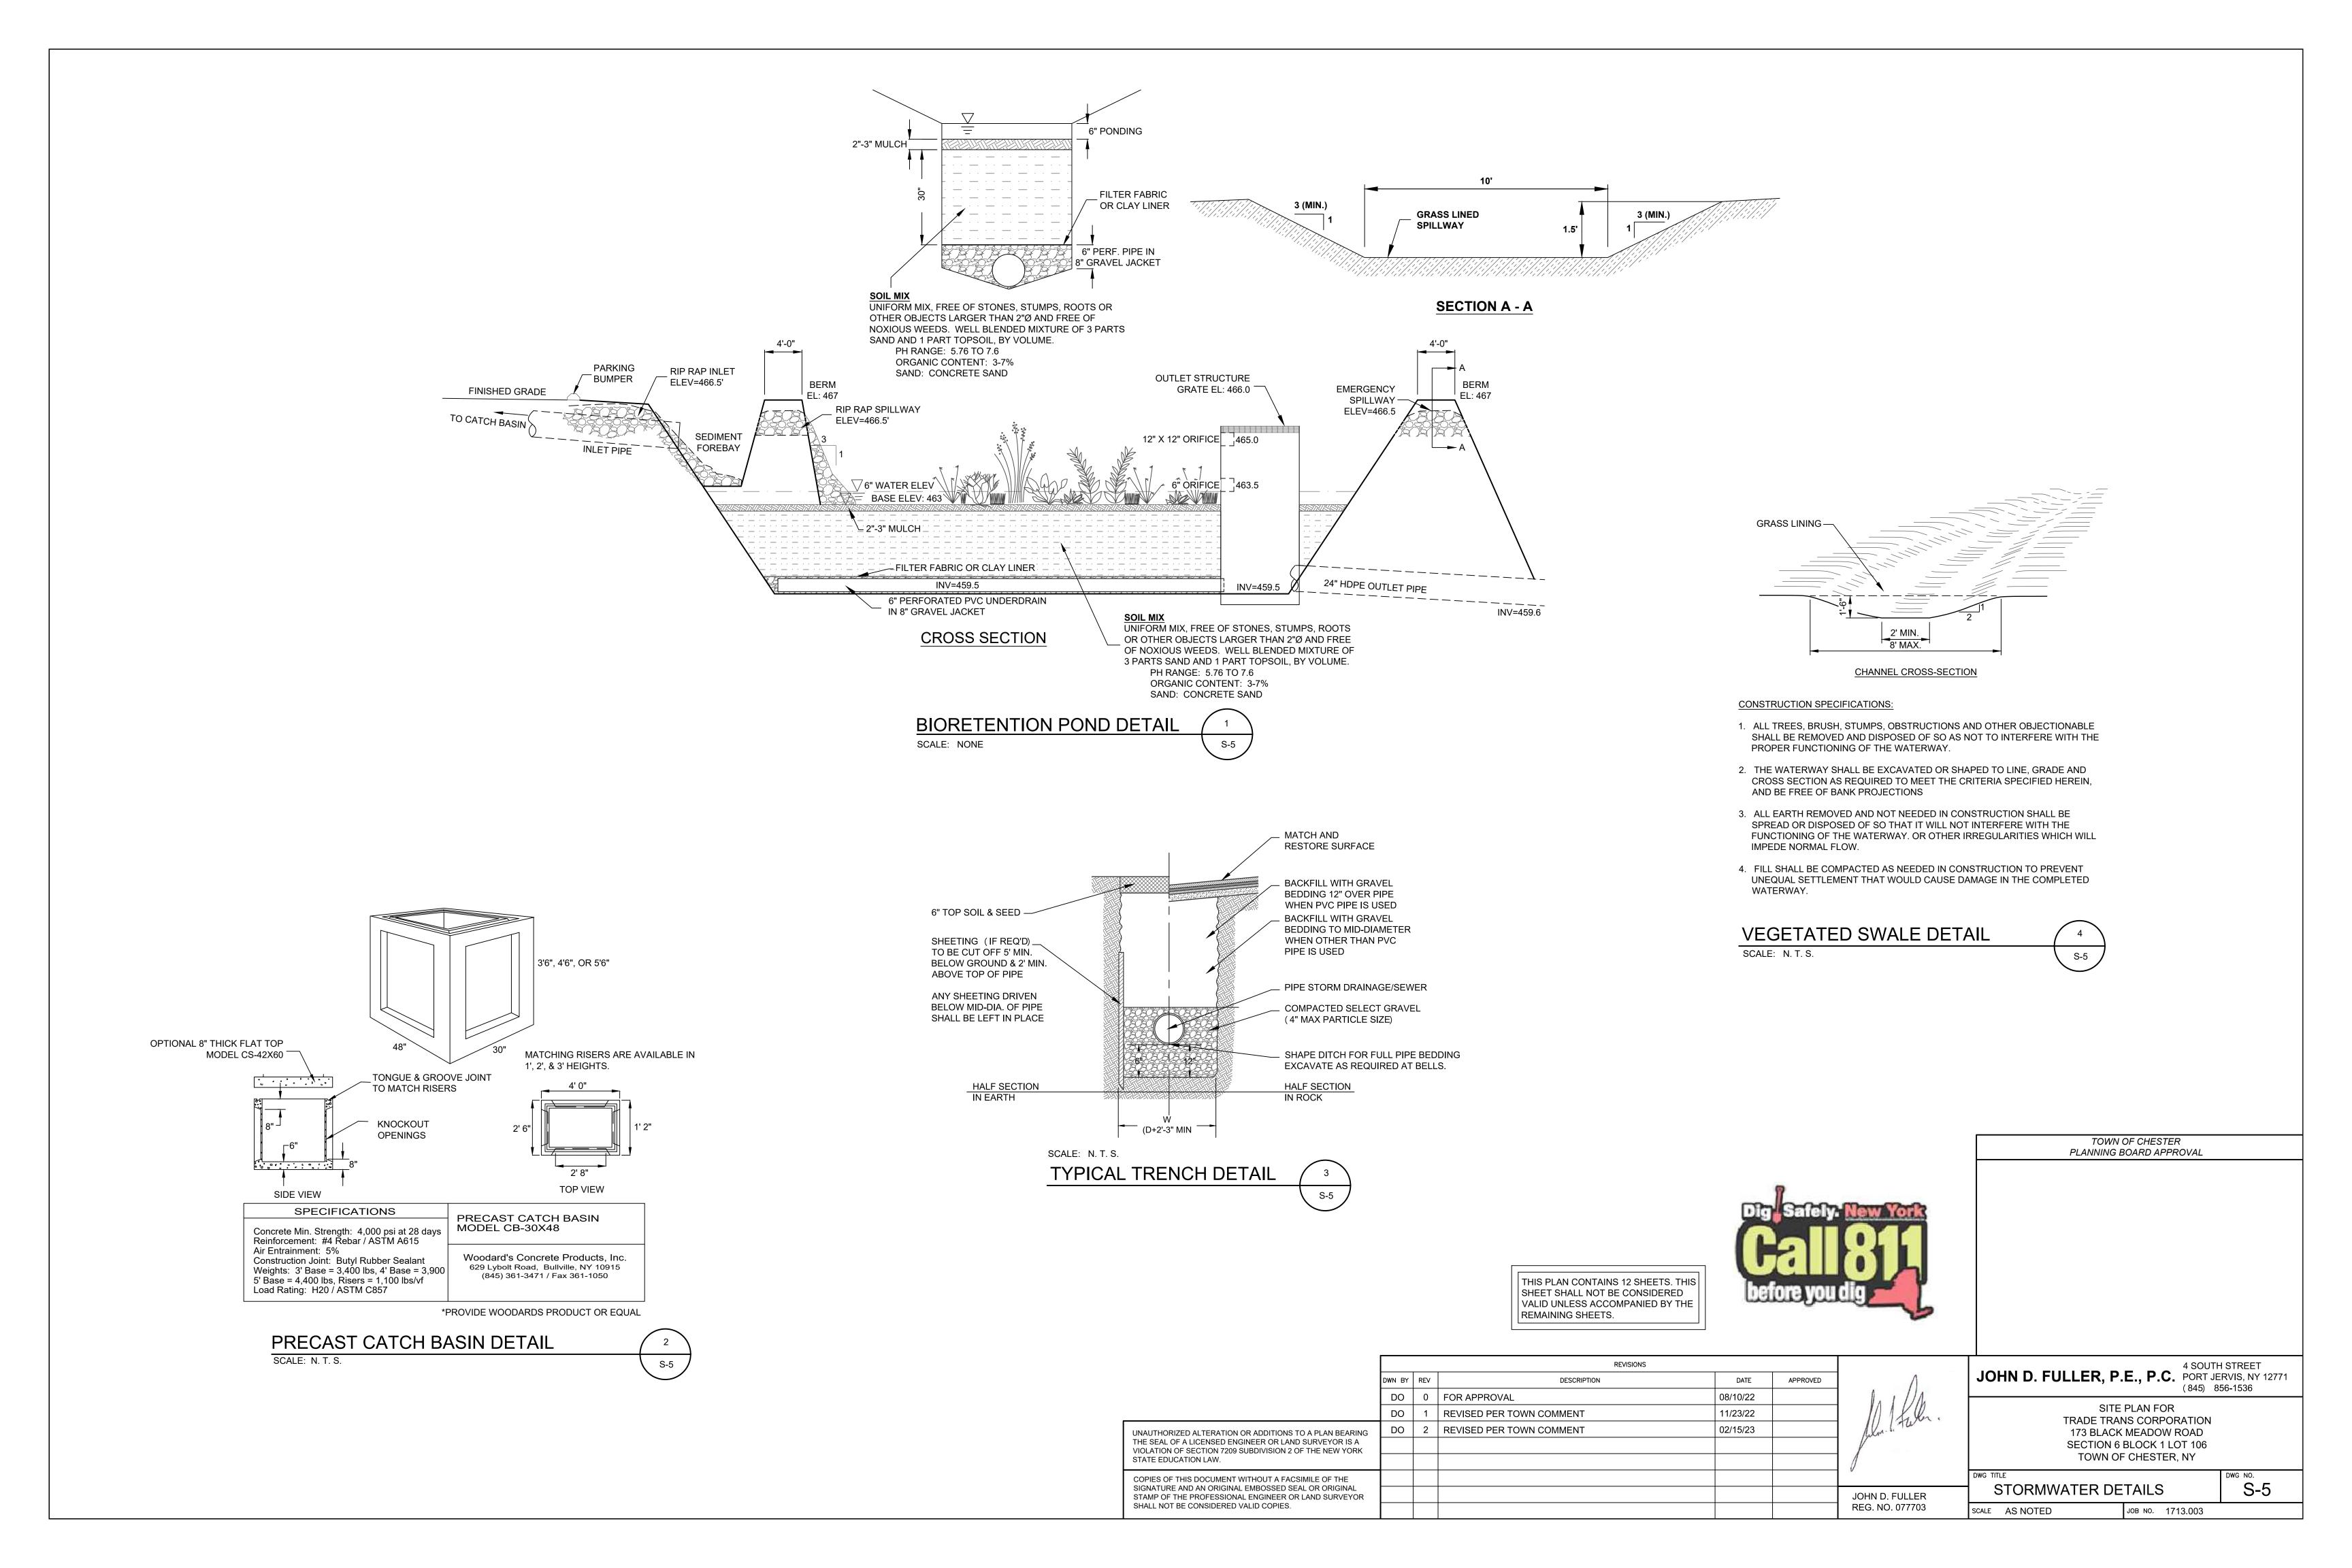

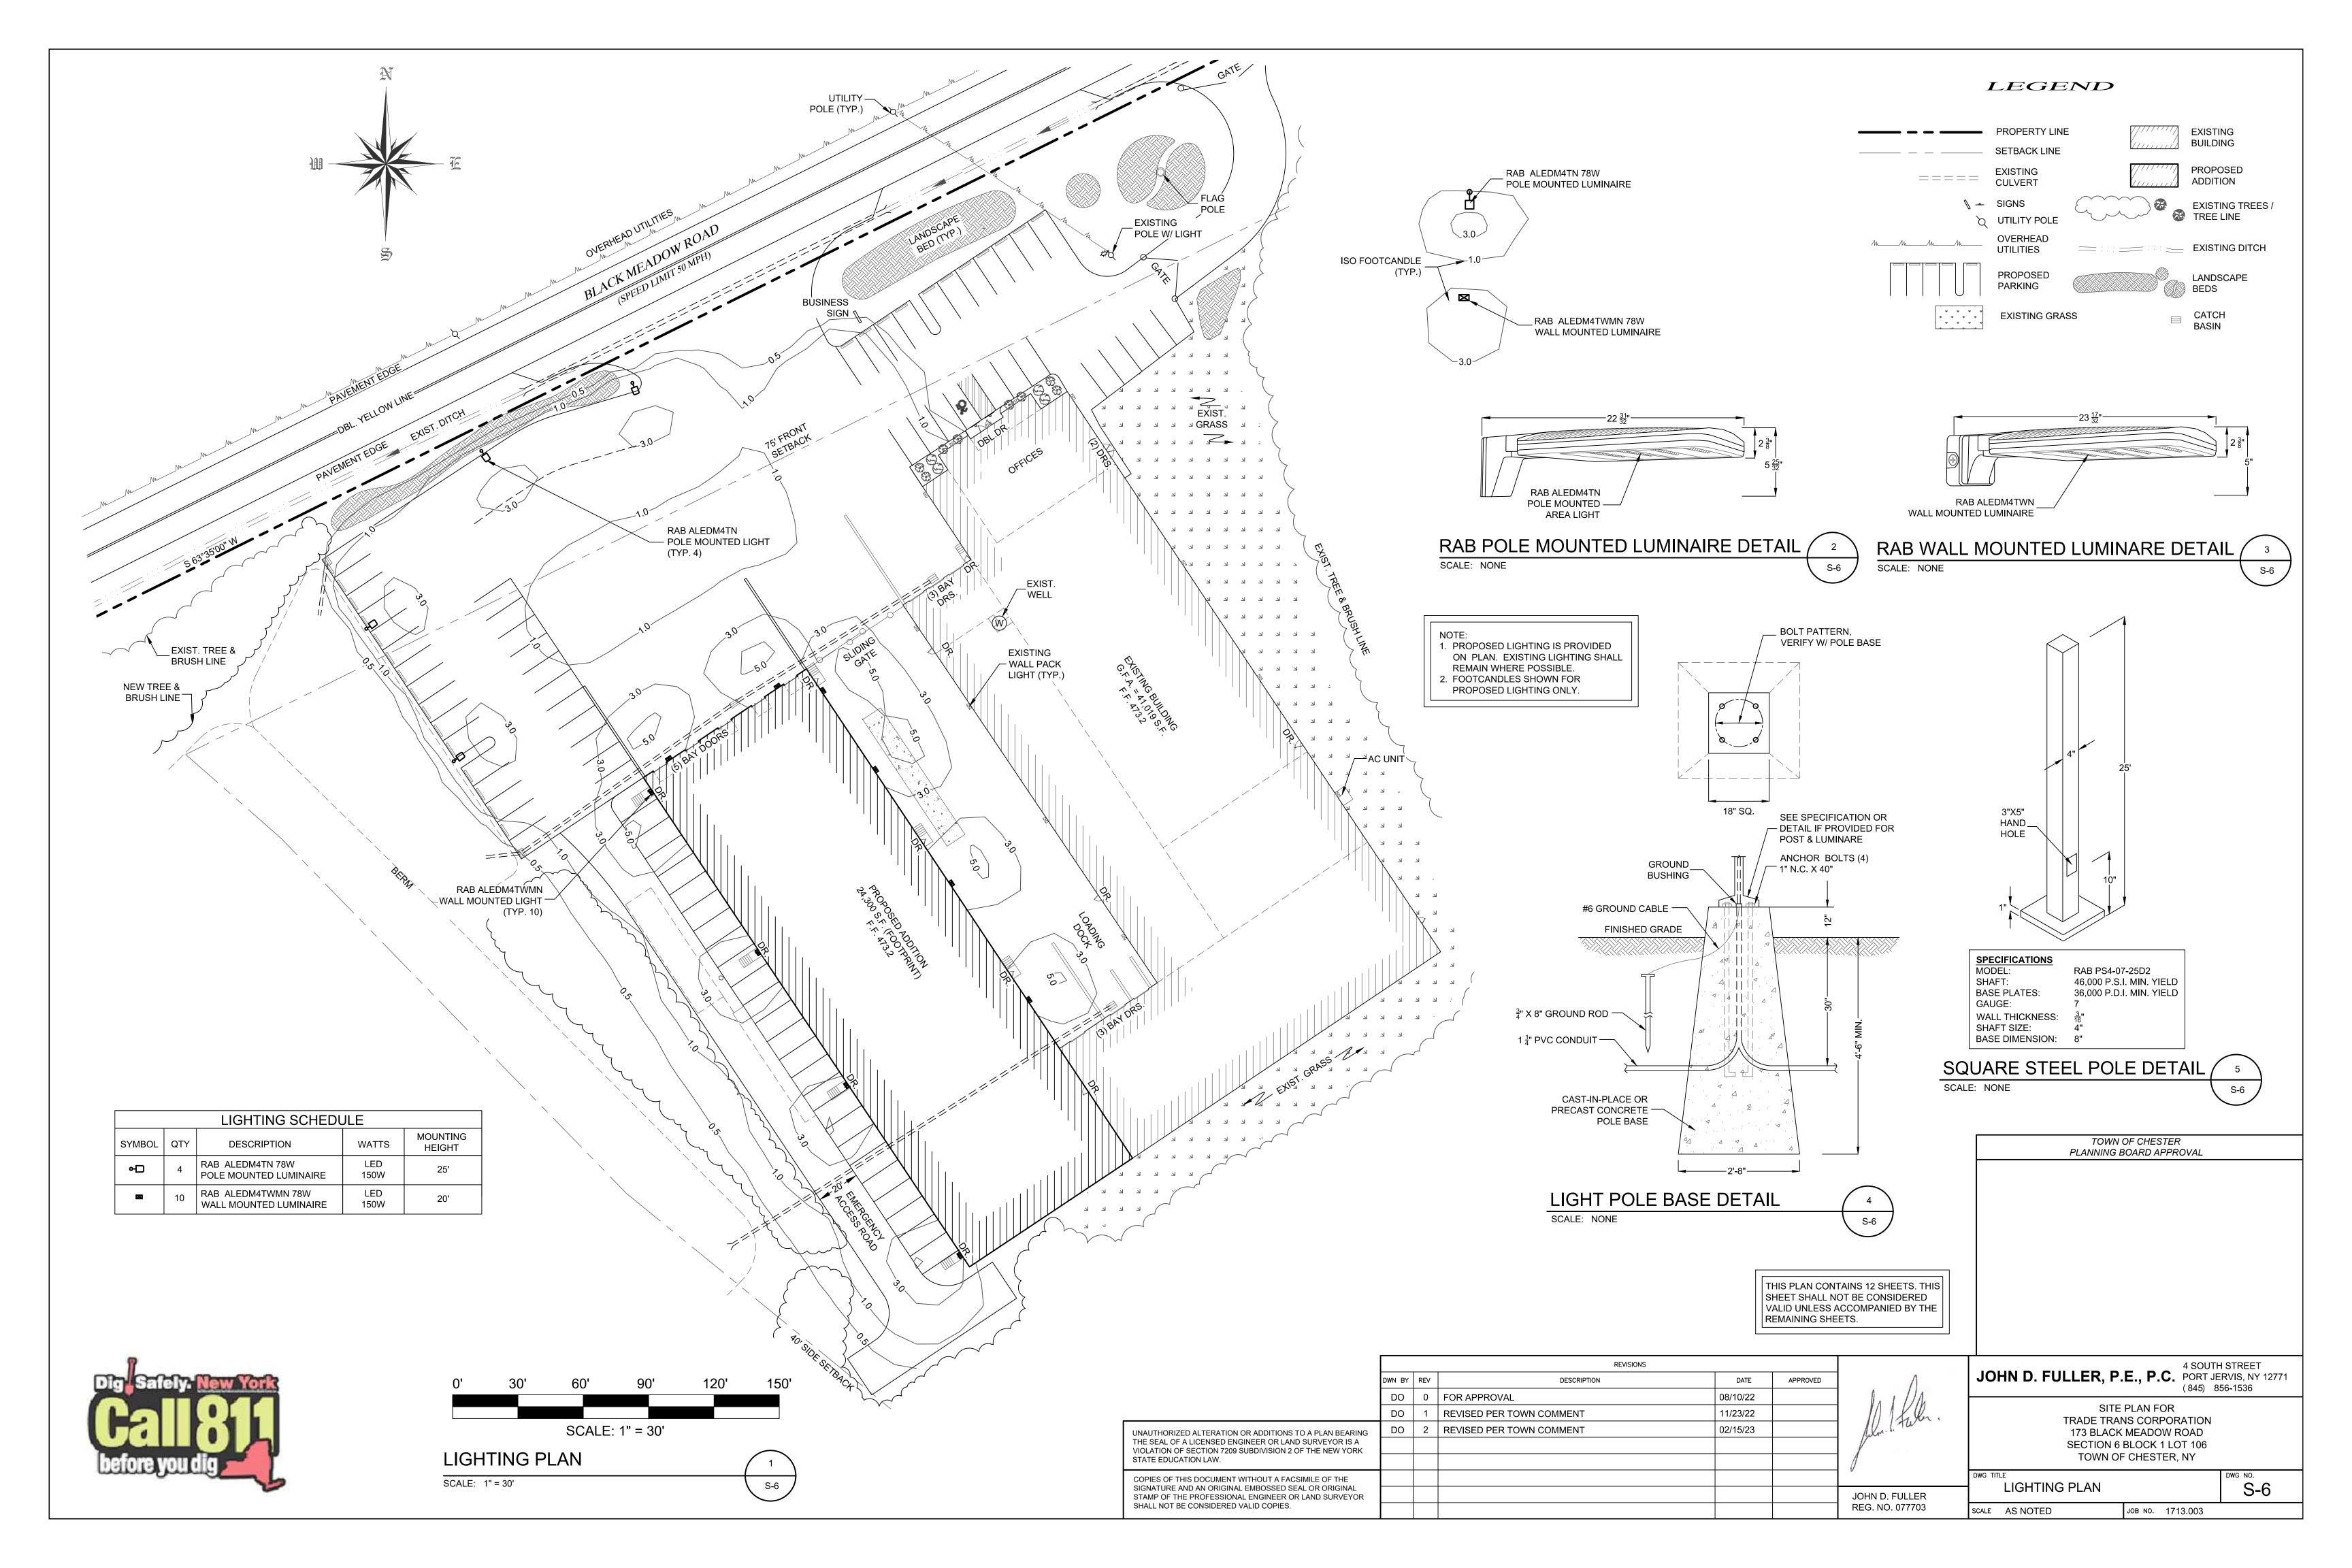


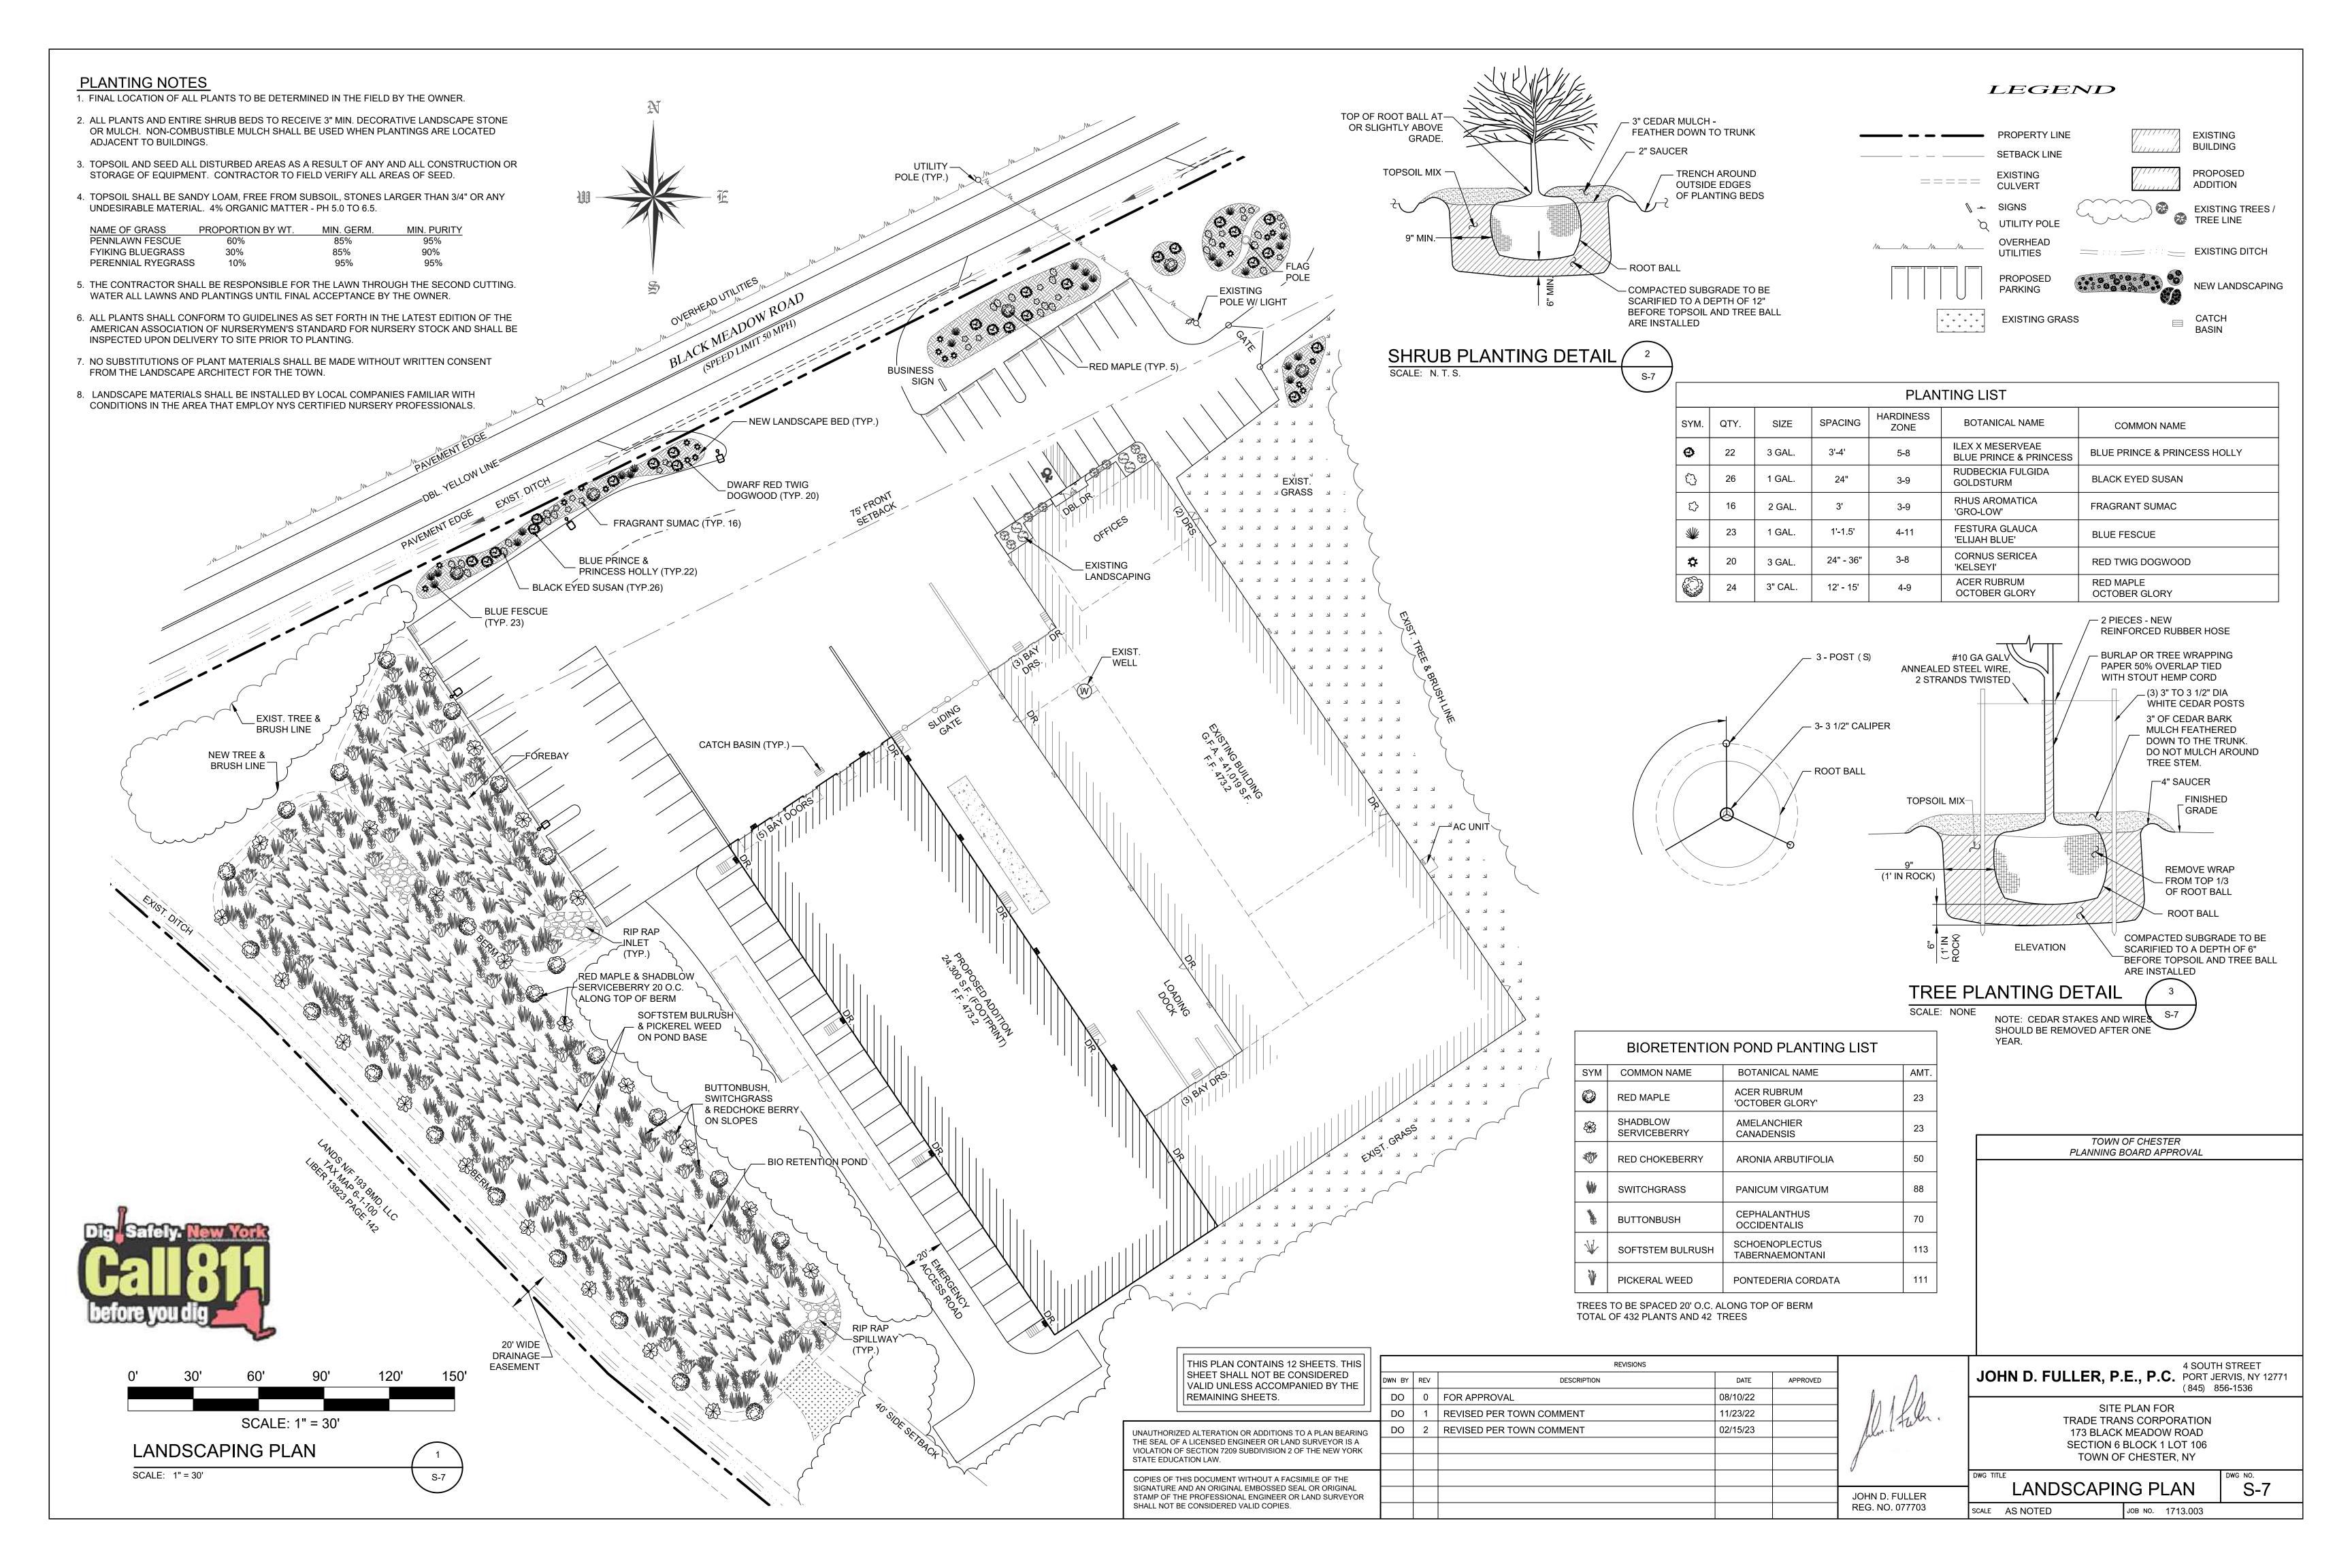


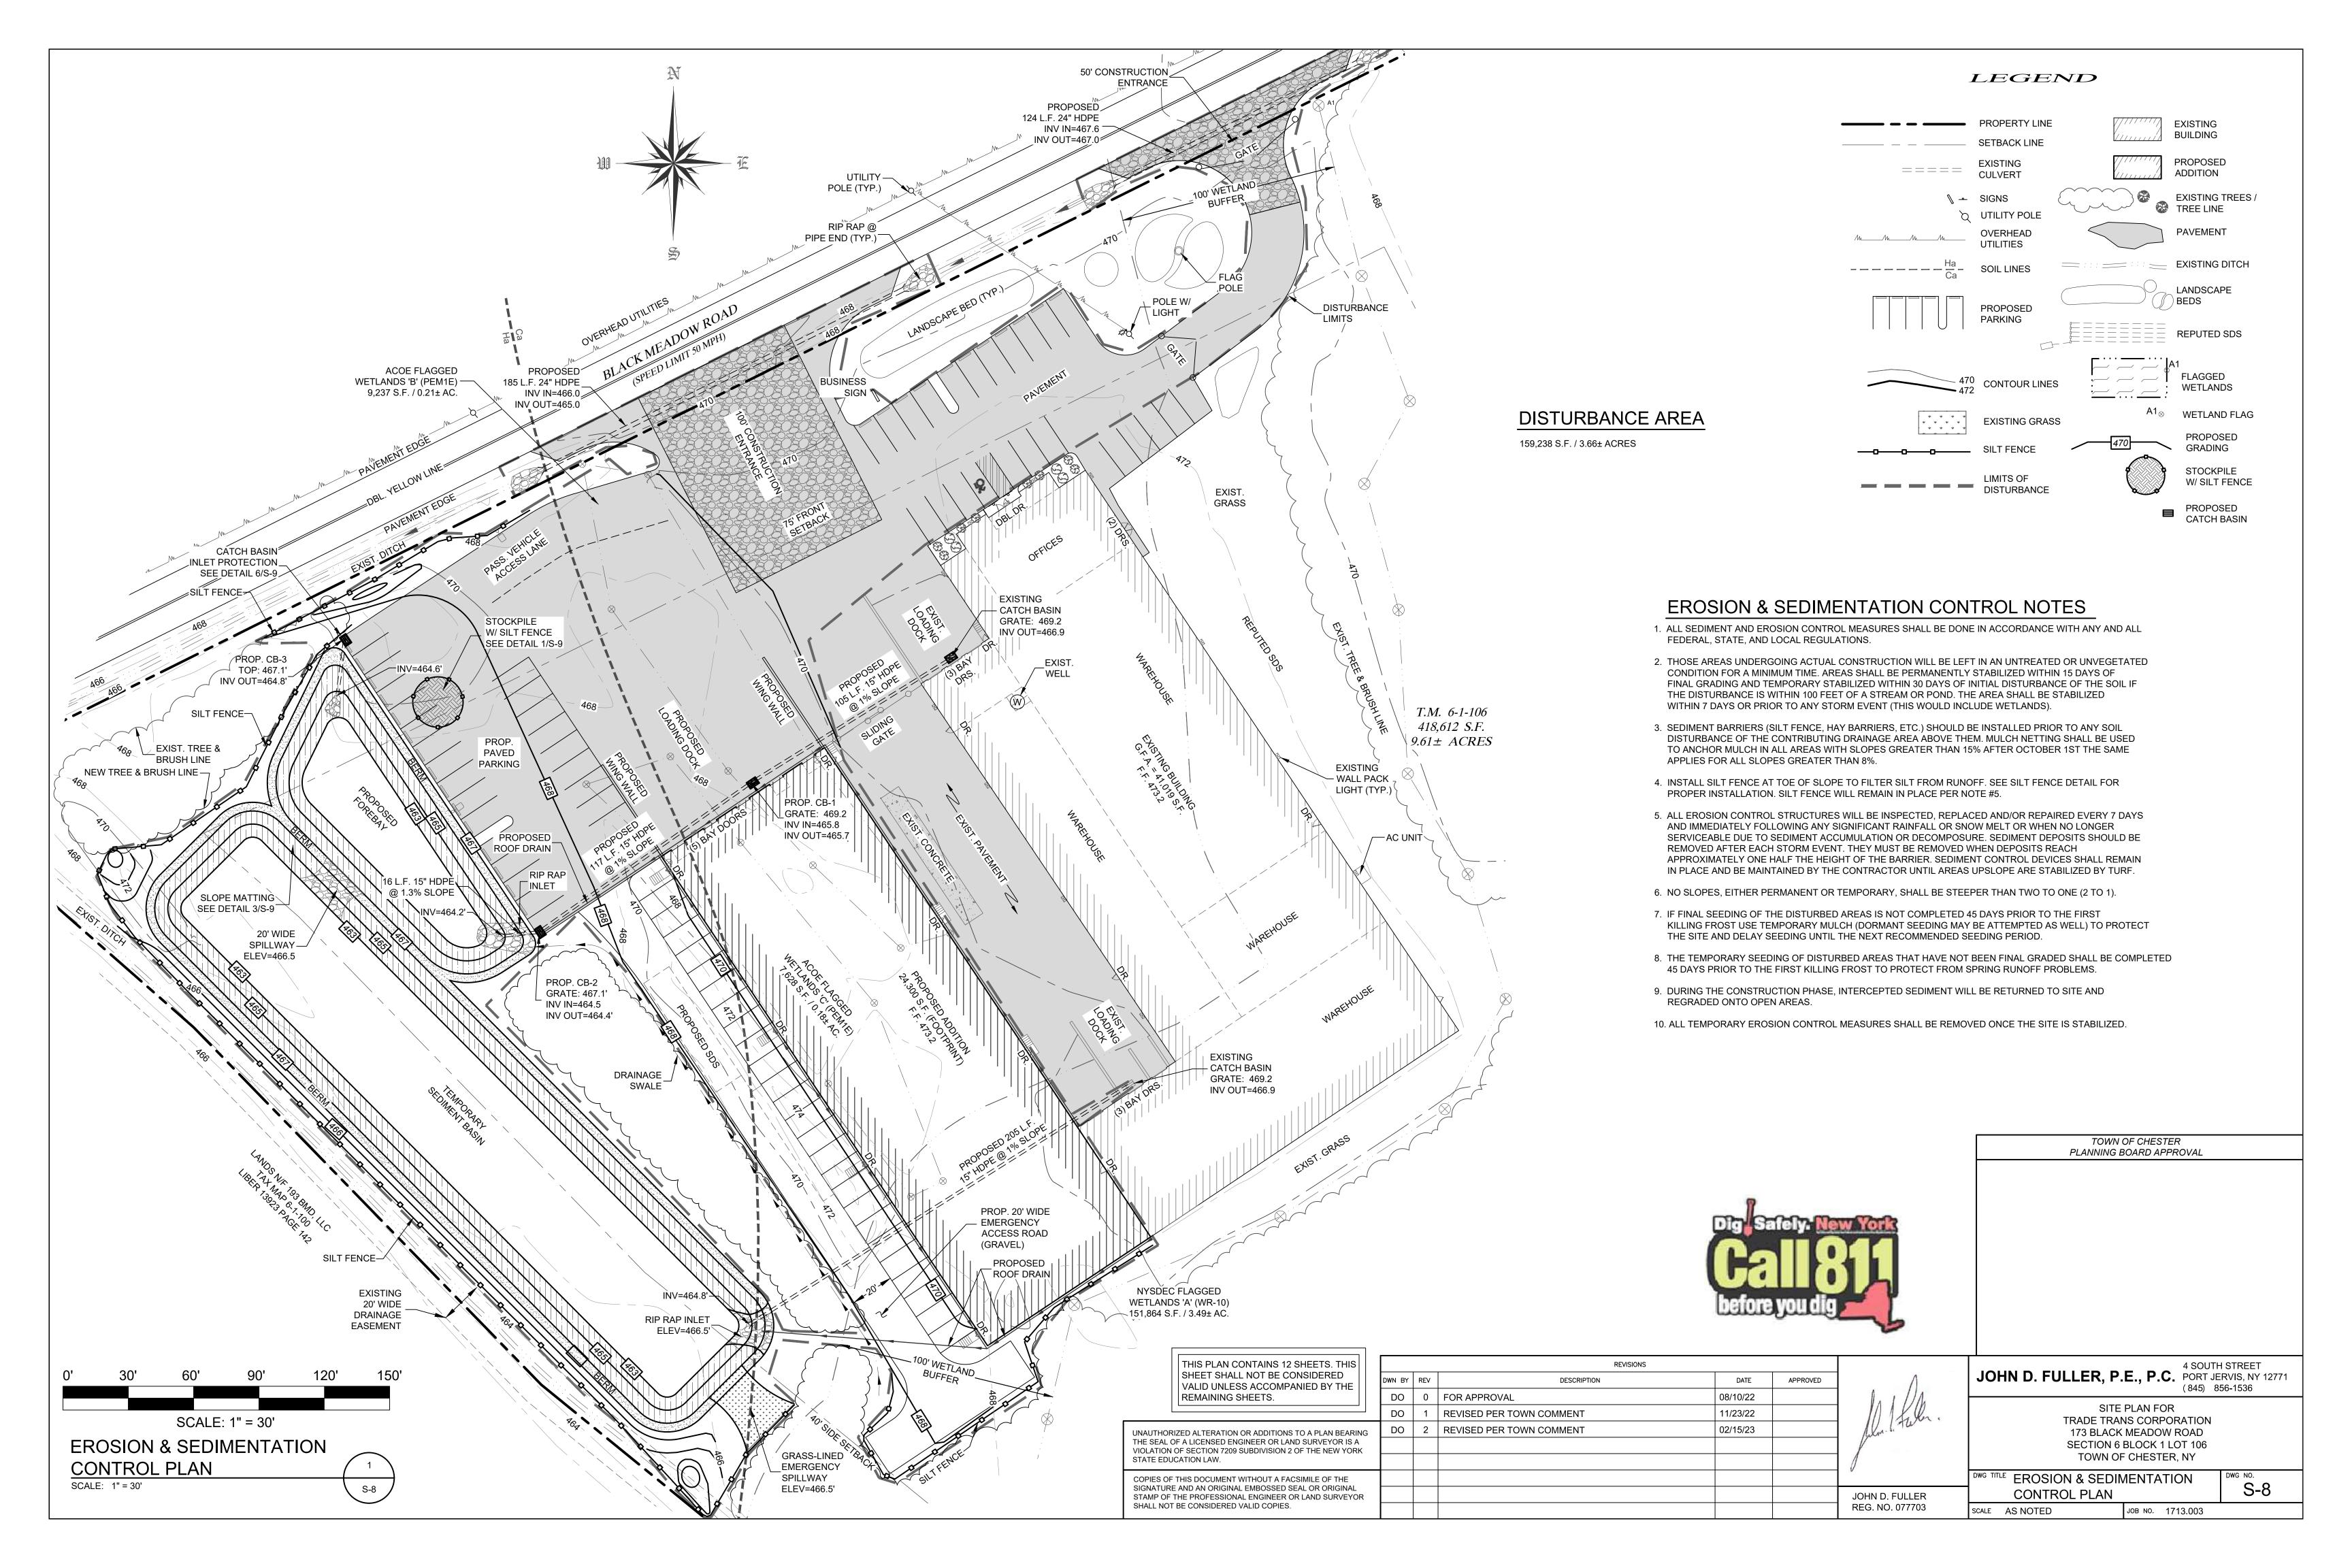

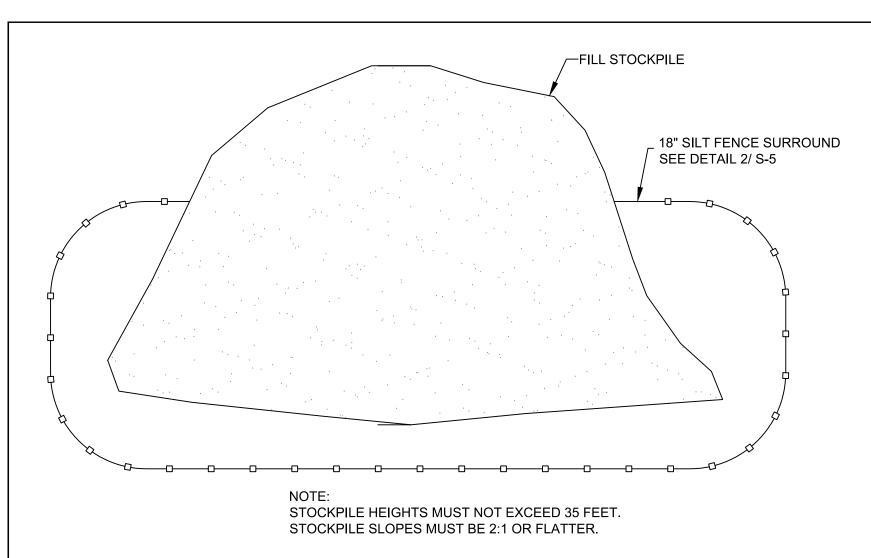

STOCKPILE DETAIL SCALE: NONE

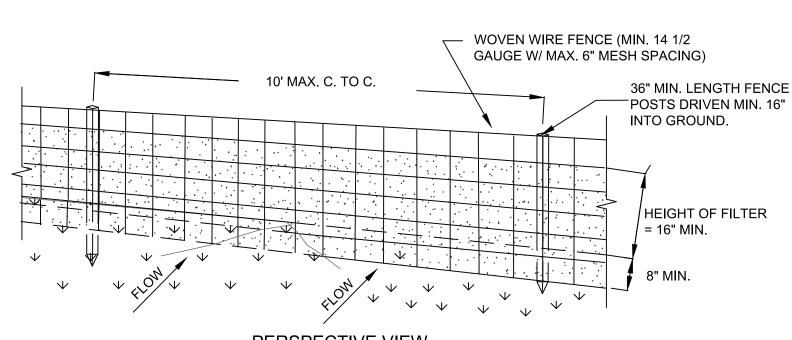


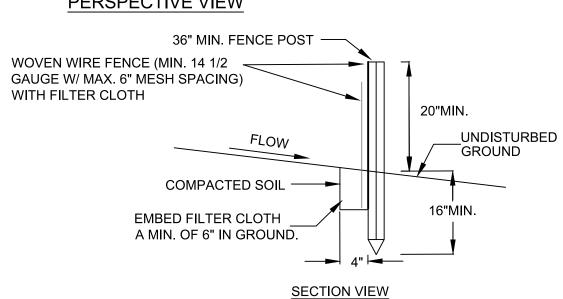

CONSTRUCTION SPECIFICATIONS

- 1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER "T" OR "U" TYPE OR HARDWOOD.
- 2. FILTER CLOTH TO BE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION. FENCE SHALL BE WOVEN WIRE, 12 1/2 GAUGE, 6" MAXIMUM MESH OPENING.
- 3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-LAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N, OR APPROVED EQUIVALENT
- 4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
- 5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.



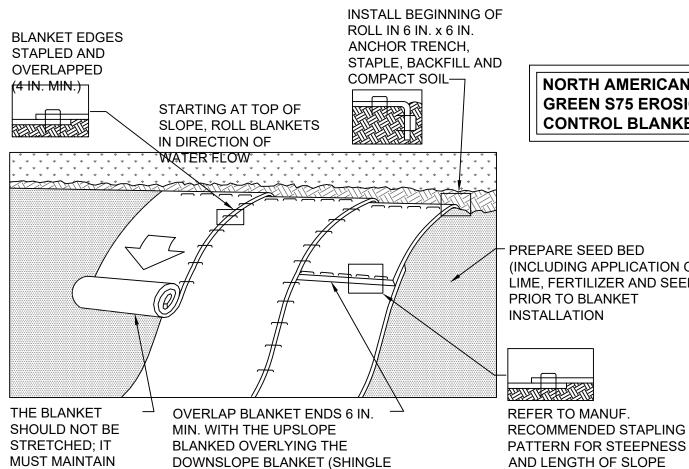

PREPARE SEED BED (INCLUDING APPLICATION OF LIME, FERTILIZER AND SEED) PRIOR TO BLANKET INSTALLATION REFER TO MANUF. RECOMMENDED STAPLING

NORTH AMERICAN

GREEN S75 EROSION

CONTROL BLANKET

BEING BLANKETED

SLOPE MATTING INSTALLATION DETAIL SCALE: NONE NOTES:

SEED AND SOIL AMENDMENTS SHALL BE APPLIED ACCORDING TO THE RATES IN THE PLAN DRAWINGS PRIOR TO INSTALLING THE BLANKET.

STYLE). STAPLE SECURELY.

GOOD SOIL

CONTACT


PROVIDE ANCHOR TRENCH AT TOE OF SLOPE IN SIMILAR FASHION AS AT TOP OF

SLOPE SURFACE SHALL BE FREE OF ROCKS, CLODS, STICKS, AND GRASS.

BLANKET SHALL HAVE GOOD CONTINUOUS CONTACT WITH UNDERLYING SOIL THROUGHOUT ENTIRE LENGTH. LAY BLANKET LOOSELY AND STAKE OR STAPLE TO MAINTAIN DIRECT CONTACT WITH SOIL. DO NOT STRETCH BLANKET.


THE BLANKET SHALL BE STAPLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

BLANKETED AREAS SHALL BE INSPECTED WEEKLY AND AFTER EACH STORMWATER EVENT UNTIL PERENNIAL VEGETATION IS ESTABLISHED TO A MINIMUM UNIFORM 70% COVERAGE THROUGHOUT THE BLANKETED AREA. DAMAGED OR DISPLACED BLANKETS SHALL BE RESTORED OR REPLACED WITHIN 4 CALENDAR DAYS.

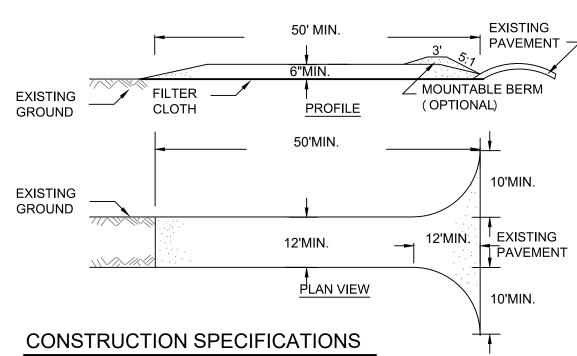



- 1. STONE SIZE = USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
- 2. LENGTH = NOT LESS THAN FIFTY (50) FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE A 30 FOOT MINIMUM LENGTH WOULD APPLY).
- 3. THICKNESS = NOT LESS THAN SIX (6) INCHES.
- 4. WIDTH = TWELVE (12) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCUR. TWENTY-FOUR (24) FEET IF SINGLE ENTRANCE TO SITE.
- 5. FILTER CLOTH WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE.
- 6. SURFACE WATER ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- 7. MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
- 8. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- 9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.


CONSTRUCTION ENTRANCE SCALE: N. T. S.



THIS PLAN CONTAINS 12 SHEETS. THIS SHEET SHALL NOT BE CONSIDERED VALID UNLESS ACCOMPANIED BY THE REMAINING SHEETS.



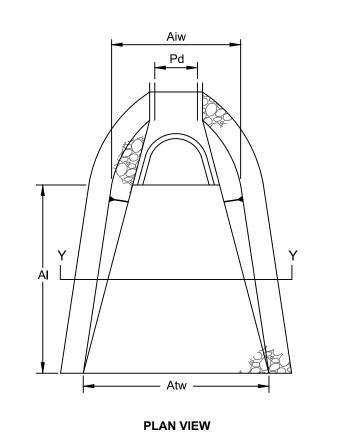

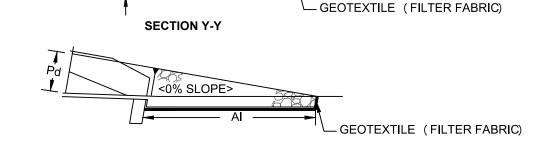


SECTION Z-Z


<0% SLOPE>

		RIP	RAP	APRON			
OUTLET NO.	PIPE DIA Pd (IN)	SIZE (R)	THICK. Rt (IN)	LENGTH AI (FT)	INITIAL WIDTH Aiw (FT)	TERMINAL WIDTH Atw (FT)	
1	15	4	6	12	3	10	
-	-	-	-	-	-	-	
-	-	=	-	-	-	-	

RIP RAP APRON AT PIPE OUTLET

SCALE: N. T. S.

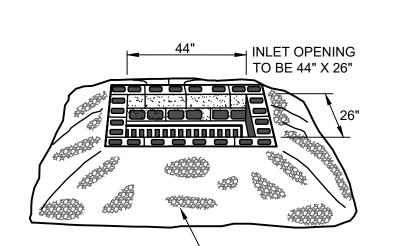

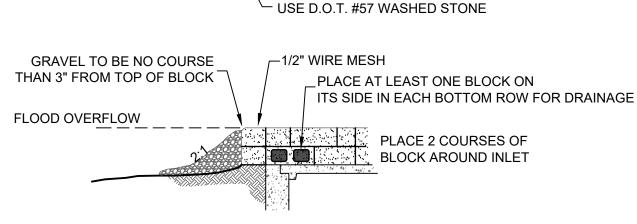

CONSTRUCTION SPECIFICATIONS

- 1. LAY CONCRETE BLOCKS ON FIRM, SMOOTH FOUNDATION EXCAUATED 3" BELOW STORM DRAIN TOP, PLACE BLOCKS AGAINST DRAIN INLET FOR LATERAL SUPPORT.
- 2. PLACE AT LEAST ONE CONCRETE BLOCK ON ITS SIDE IN EACH BOTTOM ROW OF BLOCKS.
- 3. PLACE WIRE MESH WITH 1/2" OPENINGS OVER ALL BLOCK OPENINGS USED FOR DRAINAGE.
- 4. USE D.O.T. #57 WASHED STONE TO REDUCE FLOW RATE BUT ALLOW DRAINAGE, PLACE STONE ON 2:1 SLOPE TO WITHIN 3" OF TOP OF BLOCK
- 5. ANY SOIL LEFT EXPOSED BETWEEN THE BLOCK AND CONCRETE DRAIN INLET SHOULD BE FILLED WITH 3" DIAMETER STONE TO PREVENT WASHING WHEN WATER FLOWS OVER BLOCKS INTO DRAIN.

DO 0 FOR APPROVAL

REVISED PER TOWN COMMENT

DO 2 REVISED PER TOWN COMMENT

DWN BY REV

JNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING

THE SEAL OF A LICENSED ENGINEER OR LAND SURVEYOR IS A

VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK

STATE EDUCATION LAW.

CATCH BASIN INLET PROTECTION DETAIL

CONSTRUCTION SEQUENCE

STAGE 1 (SITE PREPARATION)

- 1. SCHEDULE ON-SITE PRE-CONSTRUCTION MEETING WITH ENGINEER, CONTRACTOR, LANDOWNER, AND TOWNSHIP AT LEAST ONE WEEK PRIOR TO THE START OF CONSTRUCTION.
- 2. INSTALL CONSTRUCTION ENTRANCE AND PERIMETER SILT FENCE.
- 3. CONSTRUCT SEDIMENT INFILTRATION BASINS AS SHOWN ON THE PLAN. EROSION CONTROLS MUST BE CONSTRUCTED, STABILIZED, AND FUNCTIONAL BEFORE NEW SITE DISTURBANCE BEGINS.
- 4. CLEAR AND GRUB SITE. STRIP TOPSOIL AND STOCKPILE AS SHOWN ON THE EROSION AND SEDIMENTATION CONTROL PLAN AND STABILIZE IN ACCORDANCE WITH THE SEEDING AND MULCHING
- 5. INITIATE EARTH MOVING ACTIVITIES FOR SITE DEVELOPMENT. UNSUITABLE MATERIAL IS TO BE REMOVED FROM THE PROJECT SITE. CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ALL EROSION AND SEDIMENTATION CONTROL MEASURE AT ANY OFF-SITE SPOIL AREAS. PLACE AND COMPACT MATERIAL IN AREAS OF FILL TO OBTAIN NECESSARY GRADES.
- 6. ROUGH GRADE SITE, STABILIZE AND SEED EXCESS STOCKPILE MATERIAL AS SHOWN ON THE EROSION AND SEDIMENTATION CONTROL PLAN SHEET. INSTALL SILT FENCE AROUND THE STOCKPILE IMMEDIATELY AFTER THE SOIL IS STOCKPILED.
- 7. THE SITE GRADING ACTIVITIES SHALL BE INITIATED AND PROCEED IN SUCH A MANNER AS TO DIRECT ALL STORM WATER FROM DISTURBED AREAS TO THE SEDIMENT CONTROL STRUCTURES.
- 8. STABILIZE ALL GRASS AREAS IN ACCORDANCE WITH THE SEEDING AND MULCHING SPECIFICATIONS.

STAGE 2 (CONSTRUCTION)

- 1. INITIATE CONSTRUCTION OF BUILDING FOUNDATION AND SUPER STRUCTURE.
- 2. INSTALL WASTEWATER AND WATER SUPPLY SYSTEMS INCLUDING PIPING AND TRENCHING AS SHOWN ON THE SITE PLAN.
- 3. ROUGH GRADE SITE, WORKING GRADE TOWARDS "ROUGH" FINAL GRADE ELEVATIONS OF
- 4. PLACE AND COMPACT SUBBASE IN AREAS TO BE PAVED AND PLACE THEGRAVEL / ITEM #4 COURSE AS SOON AS IT IS PRACTICAL.
- 5. CLEAN OUT & RESEED AND RE-STABILIZE INFILTRATION BASINS WHERE NECESSARY
- 6. RESEED, RE-MULCH AND RE-STABILIZE WHERE NECESSARY.
- 7. REMOVE SILT FENCING ONLY AFTER ENTIRE SITE HAS BEEN STABILIZED, VEGETATED AREAS SHALL BE CONSIDERED PERMANENTLY STABILIZED WHEN A UNIFORM 70% VEGETATIVE COVER OF EROSION RESISTANT PERENNIAL SPECIFIED HAS BEEN ACHIEVED, OR THE DISTURBED AREA IS COVERED WITH AN ACCEPTABLE BMP WHICH PERMANENTLY MINIMIZE ACCELERATED EROSION AND SEDIMENTATION. UNTIL SUCH TIME AS THIS STANDARD IS ACHIEVED, INTERIM STABILIZATION MEASURES AND TEMPORARY EROSION AND SEDIMENT CONTROL BMPS THAT ARE USED TO TREAT PROJECT RUNOFF MAY NOT BE REMOVED. DURING PERIODS OF DROUGHT, IRRIGATION SHOULD BE UTILIZED UNTIL STABILIZATION HAS OCCURRED.

SEEDING AND MULCHING SPECIFICATIONS

TEMPORARY STABILIZATION:

	TYPE	<u>RATE</u>
SEED	ANNUAL RYE GRASS	1 LB/1,000 SQ F
MULCH	HAY	3.0 TONS/ACRE
LIME	AGRICULTURAL GRADE LIMESTONE	1.0 TONS/ACRE
FERTILIZER	10-20-10	50 LBS./ACRE

PERMANENT STABILIZATION

FERTILIZER 10-20-10

	TYPE	RATE
SEED	PERENNIAL RYE GRASS (20%) REDTOP (50%) ORCHARD GRASS (30%)	0.45 LBS/1,000 SQ FT 0.35 LBS/1,000 SQ FT 1.4 LBS/1,000 SQ FT
MULCH	HAY	3.0 TONS/ACRE
LIME	AGRICULTURAL GRADE LIMESTONE	6.0 TONS/ACRE

TOWN OF CHESTER PLANNING BOARD APPROVAL

1,000 LBS./ACRE

JOHN D. FULLER, P.E., P.C. PORT JERVIS, NY 12771

SITE PLAN FOR TRADE TRANS CORPORATION 173 BLACK MEADOW ROAD SECTION 6 BLOCK 1 LOT 106

(845) 856-1536

TOWN OF CHESTER, NY S-9

DWG TITLE EROSION & SEDIMENTATION CONTROL PLAN DETAILS



DESCRIPTION

REVISIONS

JOHN D. FULLER REG. NO. 077703

APPROVED


DATE


08/10/22


11/23/22

02/15/23

SCALE AS NOTED






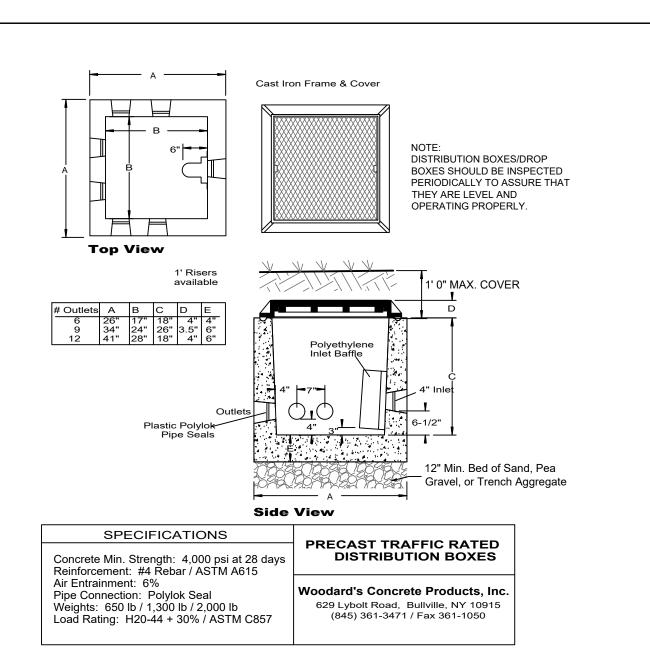


PRECAST TRAFFIC RATED

DISTRIBUTION BOX DETAIL

SCALE: N.T.S.

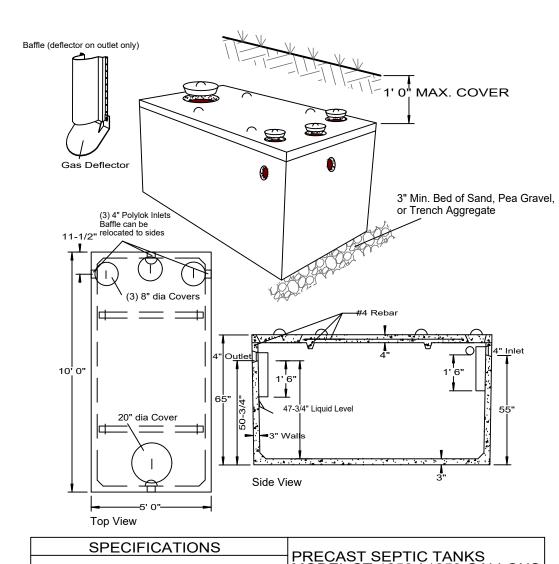

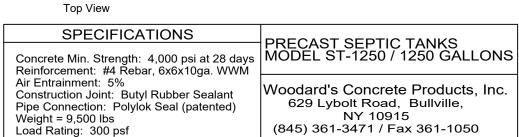



PRECAST CONCRETE SEPTIC TANK SCALE: N.T.S.



ALL LATERALS IN USE SHALL BE EQUIPPED WITH A FLOW LEVELER.
 FLOW LEVELERS SHALL NOT COMPENSATE FOR MORE THAN 1 1/4"
 DIFFERENCE IN LATERAL INVERT ELEVATIONS. THE DISTRIBUTION BOX
 SHALL BE RELEVELED AND THE FLOW LEVELERS READJUSTED.
 THE DISTRIBUTION BOX SHALL BE CHECKED 6-12 MONTHS AFTER
 INSTALLATION AND THE FLOW LEVELERS SHALL BE READJUSTED



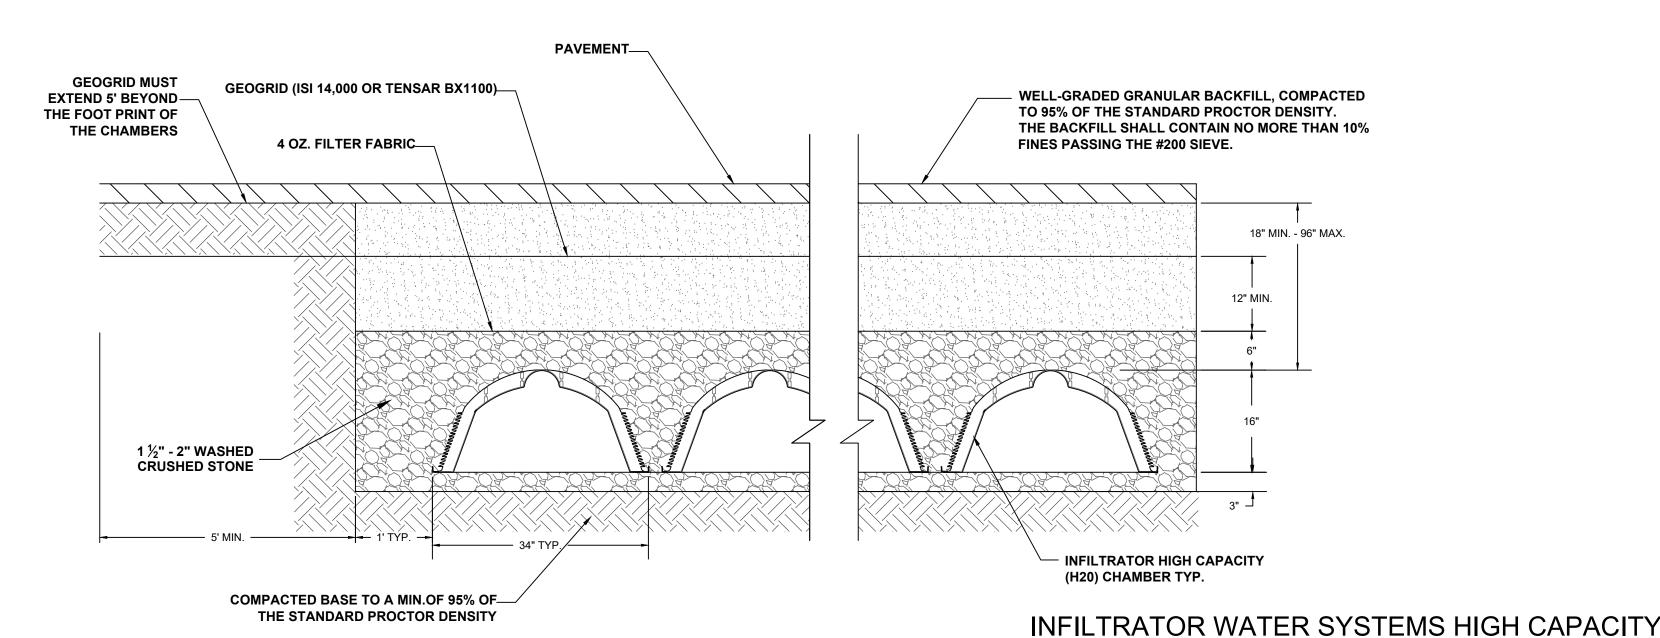

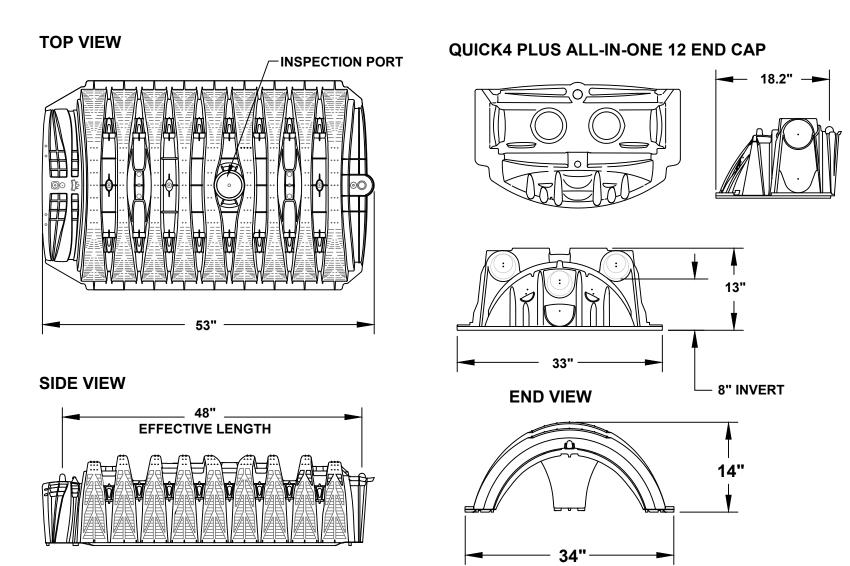


- REMOVABLE PLUG

4" PVC PIPE

AS REQUIRED

45° WYE BRANCH

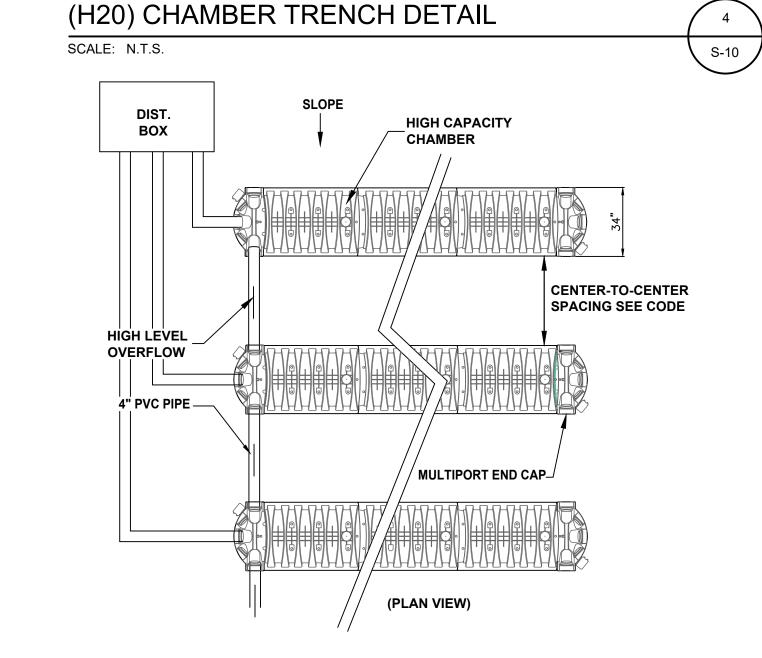

UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING

MINIMUM SEPARATION DISTANCE (FEET) FROM

		TO STREAM, LAK					
		WATERCOURSE	=,		DRAINAGE		
	WELL (f) OR	WETLAND		PROPERTY	DITCH		
	SUCTION LINE	OR WET POND (b) DWELLING	LINE	(b) (g)		
HOUSE SEWER (WATERTIGHT JOINTS)	25' IF C.I. OR PVC W/ O-RING JOINTS, 50' OTHERWISE	25'	3'	10'			
SEPTIC TANK	50'	50'	10'	10'	10'		
EFFLUENT LINE TO DIST. BO	OX 50'	50'	10'	10'	10'		
DISTRIBUTION BOX	100'	100'	20'	10'	50'		
SEEPAGE PIT	150' (a)	100'	20'	10'	50'		
DRY WELL (ROOF AND FOO	TING) _{50'}	25'	20'	10'	50'		
RAISED OR MOUND SYSTEM	И (c) 100'(a)	100'	20'	10'	50'		
INTERMITTEN SAND FILTER	(c) 100' (a)	100'	20'	10'	50'		
EVAPOTRANSPIRATION ABSORPTION SYSTEM (c)	100' (a)	50'	20'	10'	50'		
COMPOSTER	50'	50'	20'	10'	10'		
SANITARY PRIVY PIT	100'	50'	20'	10'	20'	SUBDIVI	
PRIVY, WATERTIGHT VAULT		50'	20'	10'	10'	BOUND	ARY
WELL		25'				50'	
ABSORPTION FIELD	100'(a)	100'	20'	10'	50'		TO INTERMITTENT
C	ULVERT OR STORM EWER (GASKETED,	CURTAIN DRAIN E	TOP OF	R	LID CURTAIN OOF OR FOO ES, SNOW S	OTING	STREAM, DRY WELL,CULVERT STORM SEWER (NON-GASKETED PIPE
(CON'T.)	TIGHT PIPE)		EP SLOPE (1	ON 3)	EASEMEN	١T	OR CATCH BASIN
(CON 1.)	35'	15'	25'		10'		50'

- (a) WHEN SEWAGE TREATMENT SYSTEMS ARE LOCATED IN COARSE GRAVEL OR UPGRADE AND IN THE GENERAL PATH OF DRAINAGE TO A WELL, THE CLOSEST PART OF THE TREATMENT SYSTEM SHALL BE AT LEAST 200' AWAY FROM THE WELL.
- (b) MEAN HIGH WATER MARK
- (c) FOR ALL SYSTEMS INVOLVING THE PLACEMENT OF FILL MATERIAL, SEPARATION DISTANCES ARE MEASURED FROM THE TOE OF SLOPE OF THE FILL.
- (d) ANY WATER SERVICE LINE UNDER PRESSURE (i.e., PUBLIC WATER SUPPLY MAIN, HOUSEHOLD SERVICE LINE, WELL TO HOUSEHOLD SERVICE LINE) LOCATED WITHIN TEN FEET OF ANY ABSORPTION FIELD, SEEPAGE PIT OR SANITARY PRIVY SHALL BE INSTALLED INSIDE A LARGER DIAMETER WATER MAIN TO PROTECT THE POTABLE WATER SUPPLY.
- (e) ANY WATER SERVICE LINE UNDER PRESSURE (i.e., PUBLIC WATER SUPPLY MAIN, HOUSEHOLD SERVICE LINE, WELL TO HOUSEHOLD SERVICE LINE) CROSSING A SEWER SHALL BE INSTALLED WITH ONE FULL LENGTH OF WATER MAIN CENTERED ABOVE THE SEWER SO BOTH WATER CONNECTING JOINTS ARE AS FAR AS POSSIBLE FROM THE SEWER. SECTION 8.6 OF THE GLUMRB RECOMMENDED STANDARDS FOR WATER WORKS, SHALL
- BE FOLLOWED FOR SEPARATION OF WATER MAINS, SANITARY SEWERS AND STORM SEWERS.

 (f) THE MINIMUM SEPARATION DISTANCE BETWEEN A SEPTIC TANK AND A COMMUNITY TYPE PUBLIC WATER SUPPLY WELL SHOULD BE 100'. DISTRIBUTION BOXES AND ABSORPTION FACILITIES (e.g., ABSORPTION TRENCHES/BEDS, SEEPAGE PITS, RAISED SYSTEMS, MOUND SYSTEMS, ETC.) SHOULD BE LOCATED AT LEAST 200' FROM COMMUNITY TYPE PUBLIC WATER SUPPLY WELLS.
- (g) RECOMMENDED SEPARATION DISTANCES.

MINIMUM SEPTIC TANK CAPACITIES

MINIMUM SEPTIC TANK CAPACITY = 1.5 TIMES THE DESIGN FLOW RATE 1.5 X 315 GPD = 472.5 GALLONS 1,250 GALLONS PROVIDED

SEPTIC CALCULATIONS

DESIGN FLOW = 21 EMPLOYEES @ 15 GPD PER EMPLOYEE = 315 GPD PERCOLATION RATE: 45-60 MIN.

TRENCH LENGTH REQUIRED = 315 GPD/0.45/2 = 350 L.F.

6 ROWS PROVIDED @ 60 = 360 L.F.



	PLANNING BOARD APPROVAL
-	
ork	
4	

THIS PLAN CONTAINS 12 SHEETS. THIS SHEET SHALL NOT BE CONSIDERED VALID UNLESS ACCOMPANIED BY THE REMAINING SHEETS.

WN BY	REV	DESCRIPTION	DATE	APPROVED	Λ
DO	0	FOR APPROVAL	08/10/22		0 1//
DO	1	REVISED PER TOWN COMMENT	11/23/22		1/1/164
DO	2	REVISED PER TOWN COMMENT	02/15/23		Allen 6. Tu
					V

JOHN D. FULLER, P.E., P.C. 4 SOUTH STREET PORT JERVIS, NY 12771

TOWN OF CHESTER

SITE PLAN FOR
TRADE TRANS CORPORATION
173 BLACK MEADOW ROAD
SECTION 6 BLOCK 1 LOT 106
TOWN OF CHESTER, NY

DWG TITLE
SEPTIC DETAILS

SCALE AS NOTED

DWG NO.
S-10

THE SEAL OF A LICENSED ENGINEER OR LAND SURVEYOR IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

COPIES OF THIS DOCUMENT WITHOUT A FACSIMILE OF THE SIGNATURE AND AN ORIGINAL EMBOSSED SEAL OR ORIGINAL STAMP OF THE PROFESSIONAL ENGINEER OR LAND SURVEYOR SHALL NOT BE CONSIDERED VALID COPIES.

JOHN D. FULLER REG. NO. 077703


TYPICAL CLEANOUT DETAIL

45° ELBOW

GRADE -

4" PVC PIPE

SCALE: N.T.S.

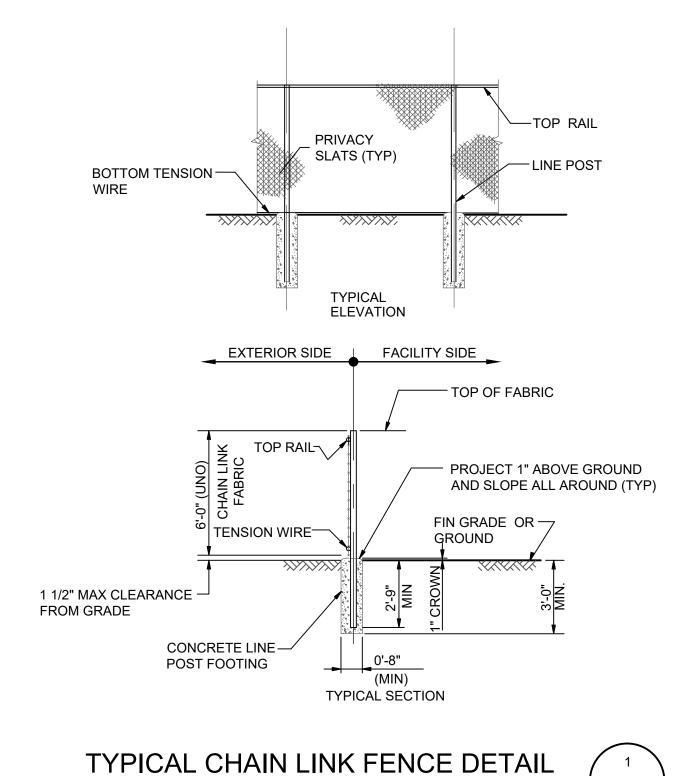


TYPICAL WOVEN WIRE FENCING NOTES

(INSTALL FENCING PER ASTM F-567)

- 1. LINE POST: 2-3/8"Ø SCHEDULE 40 PIPE PER ASTM-F1083. 2. TOP RAIL & BRACE RAIL: 1 1/4"Ø SCHEDULE 40 PIPE PER ASTM-F1083.
- 3. FABRIC: 11 GA. CORE WIRE SIZE 2" MESH, CONFORMING TO
- ASTM-A392 CLASS 1. 4. TIE WIRE: MINIMUM 11 GA GALVANIZED STEEL INSTALL A SINGLE
- WRAP TIE WIRE AT POSTS AND RAILS AT MAX. 24" INTERVALS. INSTALL HOG RINGS ON TENSION WIRE AT 24" INTERVALS.
- 5. TENSION WIRE: 7 GA. GALVANIZED STEEL.
- 6. HEIGHT = 4' VERTICAL.


SCALE: N. T. S.

7. LINE POSTS ARE 5' O.C. NOMINAL AND NOT TO EXCEED 10' 8. ALL WORK SHALL CONFORM WITH THE PROJECT SPECIFICATIONS.

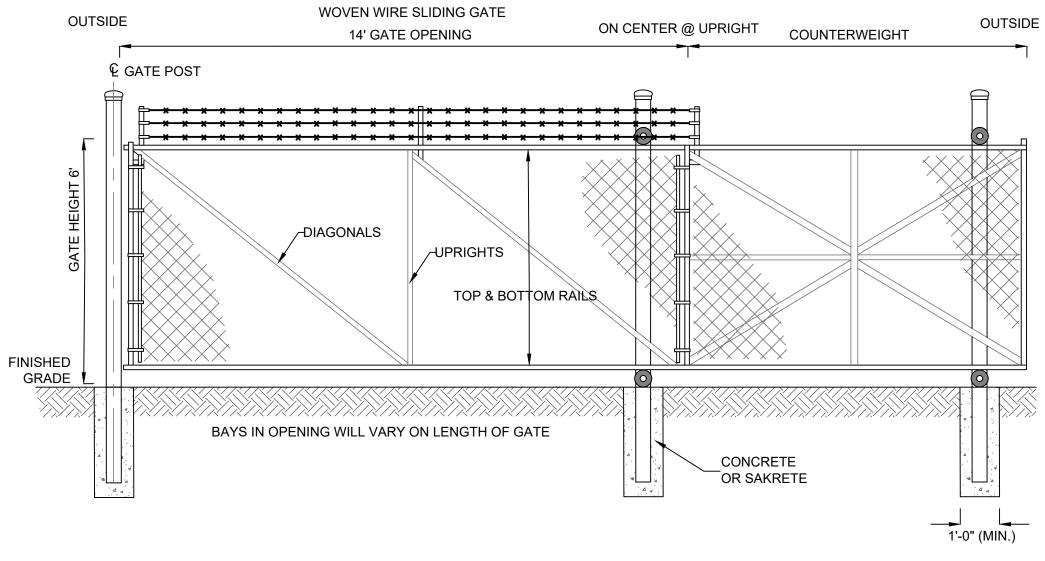


SHALL NOT BE CONSIDERED VALID COPIES.

CHAIN LINK SLIDING GATE DETAIL S-11

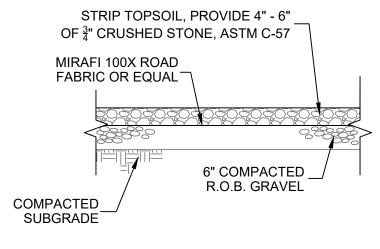

GRAVEL PARKING DETAIL SCALE: N. T. S.

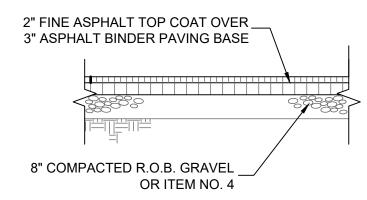

SITE PAVING DETAIL SCALE: N. T. S.

PLANNING BOARD APPROVAL

TOWN OF CHESTER

REVISIONS DWN BY REV DESCRIPTION APPROVED DATE DO 0 FOR APPROVAL 08/10/22 DO 1 REVISED PER TOWN COMMENT 11/23/22 DO 2 REVISED PER TOWN COMMENT 02/15/23 UNAUTHORIZED ALTERATION OR ADDITIONS TO A PLAN BEARING THE SEAL OF A LICENSED ENGINEER OR LAND SURVEYOR IS A VIOLATION OF SECTION 7209 SUBDIVISION 2 OF THE NEW YORK STATE EDUCATION LAW. COPIES OF THIS DOCUMENT WITHOUT A FACSIMILE OF THE SIGNATURE AND AN ORIGINAL EMBOSSED SEAL OR ORIGINAL JOHN D. FULLER STAMP OF THE PROFESSIONAL ENGINEER OR LAND SURVEYOR

REG. NO. 077703

4 SOUTH STREET JOHN D. FULLER, P.E., P.C. PORT JERVIS, NY 12771 (845) 856-1536

> SITE PLAN FOR TRADE TRANS CORPORATION 173 BLACK MEADOW ROAD SECTION 6 BLOCK 1 LOT 106 TOWN OF CHESTER, NY

CONSTRUCTION DETAILS | S-11 SCALE AS NOTED JOB NO. 1713.003

THIS PLAN CONTAINS 12 SHEETS. THIS SHEET SHALL NOT BE CONSIDERED VALID UNLESS ACCOMPANIED BY THE REMAINING SHEETS.